

ZONING ANALYSIS

ZONING: PDI - PLANNED DEVELOPMENT INDUSTRIAL COFFEE CREEK INDUSTRIAL DESIGN OVERLAY DISTRICT

<u>CHAPTER 4.135 - PLANNED DEVELOPMENT INDUSTRIAL ZONE</u> USES THAT ARE TYPICALLY PERMITTED: WAREHOUSES, FABRICATION, MANUFACTURING AND PROCESSING. LIMITED USES : OFFICE USES - LIMITED TO 20% OF MAXIMUM TOTAL FLOOR AREA RETAIL USES - LIMITED TO 3,000 SF

LOT AREA: NONE BUILDING SETBACKS, MIN: FRONT: 30 FT SIDE: 30 FT REAR: 30 FT

CHAPTER 4.155.03 MINIMUM AND MAXIMUM OFF-STREET PARKING REQUIREMENTS OFFICE:

MIN: 2.7/1,000 SF MAX: 4.1/1,000 SI RETAIL/SHOWROOM: MIN: 1.67/1,000 SF MAX: 6.2/1,000 SF WAREHOUSE/STORAGE MIN: 0.3/1,000 SF MAX: 0.5/1,000 SF MANUFACTURING:

MIN: 1.6/1,000 SF MAX: NONE

DIMENSIONS, 2-WAY, 90-DEG: 9.0'W x 20.0'L, 24.0' AISLE

CHAPTER 4.155.04 - BICYCLE PARKING OFFICE: MIN: 2 OR 1 PER 5,000 SF = 2 RETAIL/SHOWROOM: MIN: 2 OR 1 PER 8,000 SF = 2 WAREHOUSE/STORAGE: MIN: 2 OR 1 PER 20,000 SF = 2 MANUFACTURING:

MIN: 6 OR 1 PER 10,000 SF = 6 4.155.04.C.2, WHERE 6 OR MORE BICYCLE PARKING SPACES ARE REQUIRED, 50% OF REQUIRED BICYLCE PARKING TO BE LONG-TERM.

DIMENSIONS: 2.0'W x 6.0'L

CHAPTER 4.155.04 MINIMUM OFF-STREET LOADING REQUIREMENTS 2 SPACES REQUIRED: (2) 30,000 SF - 100,000 SF MIN: 12.0'W x 35.0'L x 14.0'H



PROJECT TEAM

Owner:

PRECISION COUNTERTOPS, INC. 8490 SW WARM SPRINGS ST TUALATIN, OREGON 97062 CONTACT PERSON: Robert Hausserman EMAIL: robert.h@precisioncountertops.com

Architect:

MDG ARCHITECTURE | INTERIORS 4875 SW GRIFFITH DRIVE, SUITE 300 BEAVERTON, OR 97005 VOICE: 503-244-0552 FAX: 503-244-0417 CONTACT PERSON: TUAN Q. LUU EMAIL: tuan@mdgpc.com

Civil Engineer:

T.M. RIPPEY 7650 SW BEVELAND ST SUITE 100 TIGARD, OREGON 97223 CONTACT PERSON: KARL KOROCH

Structural Engineer:

T.M. RIPPEY 7650 SW BEVELAND ST SUITE 100 TIGARD, OREGON 97223 CONTACT PERSON: RALPH TURNBAUGH

2021 (2020 N 2020 NFPA 110 STANDARD FOR EMERGENCY AND STANDBY POWER SYSTEMS

PROPOSED HEIGHT:

NOT

25540 SW GARDEN ACRES ROAD

BUILDING CODE ANALYSIS

GOVERNING CODES
2019 OREGON OREGON STRUCTURAL SPECIALTY CODE (OSSC)
2018 INTERNATIONAL FIRE CODE (IFC)
2019 OREGON MECHANICAL SPECIALTY CODE (OMSC)
2019 OREGON ELECTRICAL SPECIALTY CODE (OESC)
2019 OREGON PLUMBING SPECIALTY CODE (OPSC)
2021 OREGON ENERGY EFFICIENCY SPECIALTY CODE (OEESC)
2020 NFPA 13 STANDARD FOR INSTALLATION OF SPRINKLER SYSTEMS
2020 NFPA 72 NATIONAL FIRE ALARM AND SIGNALING CODE

2010 ADA STANDARDS FOR ACCESSIBLE DESIGN OCCUPANCY AND CONSTRUCTION ASSUMED OCCUPANCY: CONSTRUCTION TYPE: REQUIRED SEPARATION:

BUILDING HEIGHT AND AREA ALLOWABLE HEIGHT: ALLOWABLE STORIES:

PROPOSED STORIES: ALLOWABLE AREA: II-B ONE STORY SPRINKLERED

ACTUAL BUILDING AREA:

FIRE-RESISTANCE RATING REQUIREMENTS PER OSSC TABLE 601 AND 602 STRUCTURAL FRAME: EXTERIOR BEARING WALLS: EXTERIOR NON-BEARING WALLS: INTERIOR NON-BEARING WALLS: FLOOR CONSTRUCTION: ROOF CONSTRUCTION:

OPENING PROTECTION IN EXTERIOR WALLS:PER OSSC TABLE 705.85 FT TO < 10 FT</td>25%, UNPROTECTED/ SPE 30 FT OR GREATER

FIRE PROTECTION

INTERIOR FINISH F, B, M, S:

EXIT TRAVEL DISTANCE B OCCUPANCY:

F-1 OCCUPANCY:

M OCCUPANCY:

S-1 OCCUPANCY:

FREEZE PROTECTION:

PER IBC 304, 306, 311 AND 602.2 F-1, S-1, B, M II-B F-1, S-1, B, M : NO SEPARATION REQUIREMENT PER OSSC SECTION 508.3 PER OSSC TABLES 504.3, 504.4, 506.2 F-1, S-1, B, M: 75' F-1, S-1, M: 3

B:4 VARYING (35'-8" MAX) < 75', OKAY 1 < 3, OKAY B (S1) : 92,000 SF F-1 (S1): 62,000 SF

M (S1) : 50,000 SF S-1 (S1): 70,000 SF B (S1) : 6,820 SF < 92,000 SF, OKAY F-1 (S1): 20.233 SF < 62.000 SF. OKAY M (S1) : 2,973 SF < 50,000 SF, OKAY S-1 (S1): 35,976 SF < 70,000 SF, OKAY

0 HRS 0 HRS 0 HRS 0 HRS 0 HRS

0 HRS

25%, UNPROTECTED/ SPRINKLERED NO LIMIT, UNPROTECTED / SPRIKLERED

BUILDING IS EQUIPPED WITH AN AUTOMATIC FIRE PROTECTION SYSTEM THROUGHOUT IN IAW WITH OSSC 903.3.1.1 AND DESIGNED TO ACCOMMODATE HAZARD CLASSES 1-4, WITH AN INTERIOR CLEAR HEIGHT OF 22'-0"

CLASS C - ROOMS AND ENCLOSED SPACES

1006.2.1: <49 OCC, COMMON PATH OF EGRESS < 100'-0" (SPRINKLERED) 1017.2: EXIT ACESS TRAVEL DISTANCE < 300'-0" (SPRINKLERED) 1006.2.1: <49 OCC, COMMON PATH OF EGRESS < 100'-0" (SPRINKLERED) 1017.2: EXIT ACESS TRAVEL DISTANCE < 250'-0" (SPRINKLERED) 1006.2.1: <49 OCC, COMMON PATH OF EGRESS < 75'-0" (SPRINKLERED) 1017.2: EXIT ACESS TRAVEL DISTANCE < 250'-0" (SPRINKLERED) 1006.2.1: <29 OCC, COMMON PATH OF EGRESS < 100'-0" (SPRINKLERED) 1017.2: EXIT ACESS TRAVEL DISTANCE < 250'-0" (SPRINKLERED) GAS FIRED UNIT HEATING SYSTEM LOCATED IN WAREHOUSE WITH A THERMOSTAT HAVING A MAXIMUM SET POINT CAPACITY OF 45°F MOUNTED LOWER THAN THE HEATING UNIT WITH AN OUTPUT CAPACITY NOT EXCEEDING 15 Btu/hr.ft2 OR 4 Watts/ft2 OF HEATED FLOOR AREA.

ENERGY CODE ANALYSIS

ROOFS: METAL BUILDING :	R-19 + R-11 LINEAR SYSTEM OR R-25 + R-8 LINEAR SYSTEM, NON-RESIDENTIA R-19, SEMI-HEATED
VALLS ABOVE GRADE: METAL BUILDING :	R-0 + R-15.8 C.I., NON RESIDENTIAL R-13, SEMI-HEATED
VALLS BELOW GRADE: N/A	R-7.5 C.I., NON-RESIDENTIAL NR, SEMI-HEATED
SLAB-ON-GRADE FLOORS: UNHEATED HEATED	R-15 FOR 24" NR, SEMI-HEATED R-20 FOR 24"
DPAQUE DOORS: SWINGING NON-SWINGING	R-10 FOR 24" U-0.370, NON-RESIDENTIAL U-0.370, SEMI-HEATED U-0.310, NON-RESIDENTIAL U-0.360, SEMI-HEATED
/ERTICAL FENESTRATION: FIXED:	0.36, ASSY MAX U, NON-RESIDENTIAL 0.36, ASSY MAX SHGC, NON-RESIDENTIAL 1.10, ASSY MIN VT/ SHGC, NON-RESIDENTIAL
OPERABLE:	0.45, ASSY MAX U, NON-RESIDENTIAL 0.33, ASSY MAX SHGC, NON-RESIDENTIAL 1.10, ASSY MIN VT/ SHGC, NON-RESIDENTIAL
ENTRANCE DOOR:	0.63, ASSY MAX U, NON-RESIDENTIAL 0.33, ASSY MAX SHGC, NON-RESIDENTIAL 1.10, ASSY MIN VT/ SHGC, NON-RESIDENTIAL
SKYLIGHT: ALL TYPES:	0.50, ASSY MAX U, NON-RESIDENTIAL 0.40, ASSY MAX SHGC, NON-RESIDENTIAL NR, SEMI-HEATED NR, SEMI-HEATED
SKYLIGHT SIZE/ QUANTITY: DAYLIGHT AREA UNDER SKYLIGHT	.7 x 27.00' FT CEILING HEIGHT = 18.90' x 2 = 37.80' EW (37.80' EW + 2.5'W) X (37.80' EW + 10.0'L) = 40.30'W + 47.80'L DAYLIGHT AREA PER SKYLIGHT = 40.30'W x 47.80'L = 1,926.4 SF
BUILDING AREA PER 5.5.4.2.3 CEILING HEIGHT ≥ 15.0'	53,166.47 SF
BUILDING AREA / DAYLIGHT AREA	50% x 53,166.47 SF = 26,583.24 SF 26,583.24 SF / 1,926.4 SF = 13.80 SKYLIGHTS, MIN SKYLIGHTS TO BE 2.5'W x 10.0'L
SECTION 5.4.3.1.2 CONTINUOUS AIR BARRIER	DESIGN AND INSTALLATION
CONTINUOUS AIR BARRIER SHALL BE DESIGN	IED TO RESIST POSITIVE AND NEGATIVE PRESURES FROM WIND, STACK EFFECT, FOR ANTICIPATED MOVEMENTS.

ROOFS. PENETRATIONS THROUGH THE CONTINUOUS AIR BARRIER IN BUILDING ENVELOPE ROOFS, WALLS AND FLOORS. BUILDING ASSEMBLIES USED AS DUCTS OR PLENUMS.

VICINITY MAP



PORTLAND, OREGON 97239 CONTACT PERSON: ERIN HOLSONBACK

Planner:

FIRST FORTY FEET 1716 SE 29TH AVE PORTLAND, OREGON 97214 CONTACT PERSON: WILLIAM GRIMM

Surveyor

PLS SURVEYING 604 W EVERGREEN BLVD VANCOUVER, WA 98660

General Contractor:

PHI CONSTRUCTION 4817 SE 61ST AVE PORTLAND, OREGON 97206 CONTACT PERSON: ROBERT ILOSVAY






WILSONVILLE, OREGON

JUNCTIONS BETWEEN WALLS AND FLOORS, BETWEEN WALLS AT BUILDING CORNERS AND BETWEEN WALLS AND

JOINTS, SEAMS, CONNECTIONS BETWEEN PLANES AND OTHER CHANGES IN CONTINUOUS AIR BARRIER MATERIALS.

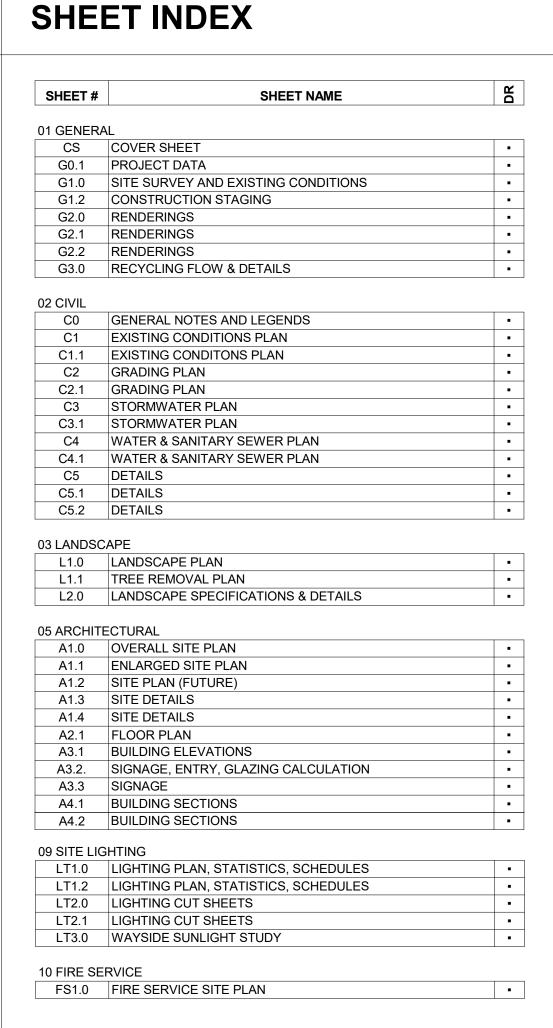

PROJECT SUMMARY

PROJECT DESCRIPTION


THE PROPOSED DEVELOPMENT SCOPE IS CONSTRUCTING A NEW HEADQUARTERS AND COUNTERTOP FABRICATION FACILITY FOR PRECISION COUNTERTOPS. THE PROPOSED BUILDING IS APPROXIMATELY 65,800 SF CONSISTS OF A 3000SF SHOWROOM, OFFICE, STORAGE, AND FABRICATION SPACES. THE BUILDING WILL BE CONSTRUCTED WITH METAL CONSTRUCTION. THE STRUCTURE WILL HAVE A VARYING HEIGHT OF 25'-40'. THE DEVELOPMENT WILL BE OCCUPYING APPROXIMATELY 4.34 ACRES OF THE 9.32 ACRES PROPERTY. THE EASTERN PORTION OF THE SITE WOULD BE HELD FOR FUTURE DEVELOPMENT OR EXPANSION. NO WORK SHALL BE DONE BEYOND THE LIMIT OF THE CONSTRUCTION BOUNDARY.

LOT DESCRIPTION

MAP & TAX LOT ID #2S128BC00700 A PORTION OF LOT 12, GARDEN ACRES, LOCATED IN THE WEST 1/2 OF THE WEST 1/2, OF SECTION 2, TOWNSHIP 3 SOUTH, RANGE 1 WEST, OF THE WILLAMETTE MERIDIAN, WASHINGTON COUNTY, OREGON

PLANNING APPROVALS

DB22-0011, SEE CONDITIONS OF APPROVAL ON SHEET G.02.

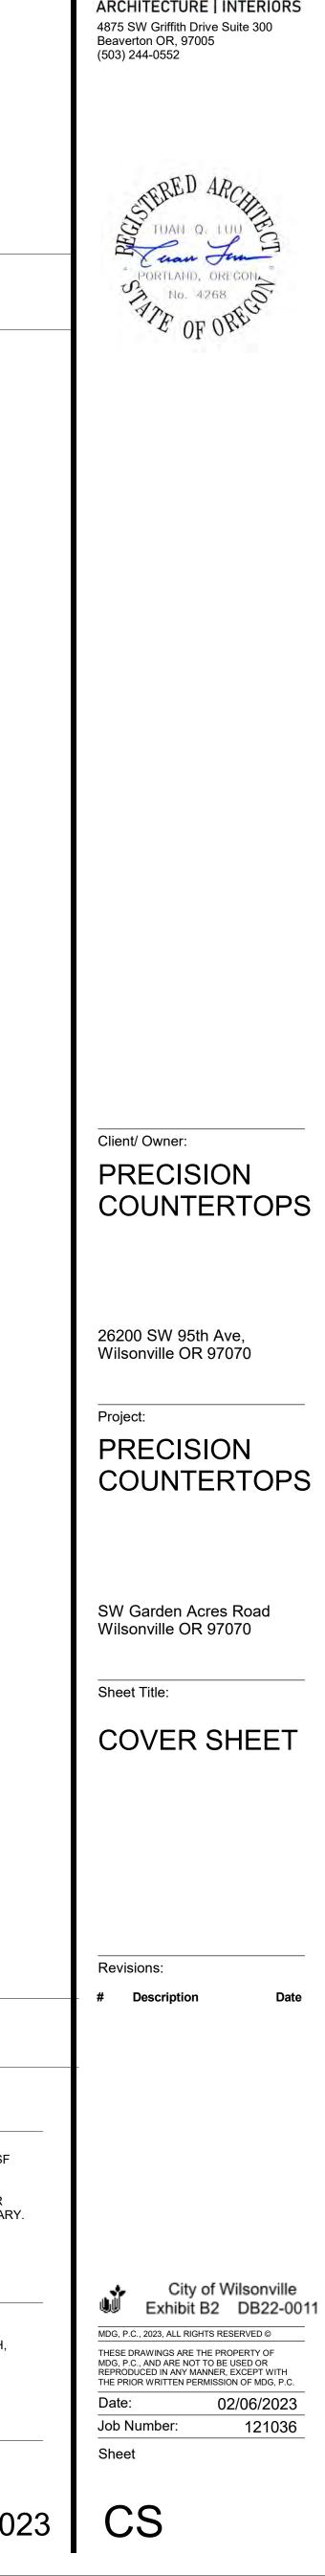

ABREVIATIONS

ACT AD ADJ AFF AL ALUM APPROX ARCH	AUDIO VISUAL ANCHOR BOLT AIR CONDITIONING, ASPHALTIC CONCRETE ACOUSTICAL ACOUSTICAL CEILING TILE AREA DRAIN ADJUST, ADJUSTABLE ABOVE FINISH FLOOR ALIGN ALUMINUM APPROXIMATELY ARCHITECTURAL ASPHALT AUTOMATIC
BKR BLDG BLKG BM BOC BOT/BTM BOW	BASE BALCONY BOARD BITUMINOUS BACKER BUILDING BLOCKING BEAM BOTTOM OF CURB BOTTOM BOTTOM OF WALL BASEMENT BETTER BUILT-UP
CONC COND CONSTR	CARPET CURTAIN WALL CABINET CABLE TV CATCH BASIN CEMENT, CEMENTITIOUS CORNER GUARD CHEMICAL CONTROL JOINT CENTER LINE CEILING CLEAR COLUMN COMPOSITE CONCRETE CONDITION CONSTRUCTION CONSTRUCTION CORRIDOR CARPET CENTER CUBIC CUSTOM
DEMO	DISHWASHER DOUBLE DEFLECTION DEMOLITION DEPARTMENT DIAMETER DIMENSION DOWNSPOUT DRAWING
ELEC ELEV EMER ENCL ENTR EPS EQ EQPM EW EXIST EXP EXPO	EXISTING EACH ELECTRICAL ELEVATOR EMERGENCY ENCLOSURE ENTRANCE EXPANDED POLYSTYRENE EQUAL EQUIPMENT EACH WAY EXISTING EXPANSION EXPOSED EXTERIOR
FAB FD FDN FE FEC FF FF SAM FFE FG FGL FHC FIN FIXT FLR FLRG FOC FOF FOM FOS FR FRT FT FTG FUT	EXHAUST FAN FABRIC, FIBER FIRE ALARM, FLUID APPLIED FABRICATIONS FLAT BAR FLOOR DRAIN FOUNDATION FIRE EXTINGUISHER FIRE EXTINGUISHER CABINET FINISH FLOOR, FACTORY FINISH FOIL FACED SELF-ADHERED MEMBRANE FINISH FLOOR ELEVATION FULL GLASS FIBERGLASS FIRE HOSE CABINET FINISH FIXTURE FLOOR FLOORING FACE OF CONCRETE FACE OF FINISH FACE OF MASONRY FACE OF STUD FIRE RATED, FIRE RESISTIVE FIRE RATED, FIRE RESISTIVE FIRE RETARDANT TREATED FOOT, FEET FOOTING FUTURE
GA GAL GAR GB GFRG GL GLB GND GR GYP	GAUGE GALLON GALVANIZED GARAGE GRAB BAR GLASS FIBER REINFORCED GYPSUM GLASS, GLAZING GLU-LAMINATED BEAM GROUND GRADE GYPSUM
HB HC HM	HOSE BIBB HOLLOW CORE HOLLOW METAL HORIZONTAL HOUR HEIGHT HIGH TEMPERATURE SELF-ADHERED MEMBRANE
IAW ICF ID IN INSUL INT	IN ACCORDANCE WITH INSULATED CONCRETE FORMS INSIDE DIAMETER INCH, INCHES INSULATION INTERIOR
JAN JST JT LAM LAV LF LIN LIN FT LT	JANITOR JOIST JOINT, JOINTS LAMINATE LAVATORY LINEAL FEET LINEAR LINEAL FEET LIGHT

ABREVIATIONS MACH MACHINE MAINT MAINTENANCE MAXIMUM MEDIUM DENSITY FIBERBOARD MEDIUM DENSITY OVERLAY MECH MECHANICAL

MAX

MDF

MDO

MED

MFR

MH

MO

MR

MTL

MUL

N-C

NIC

NO

NOM

NTS

OC

OD

OH

OFF

OPNG

OPP

ΟZ

P/L

PC

PH

ΡL

PL#

PNL

PP

PR

PSI

PT

PTD

PWD

RAD

RB

RCP

RD

REF

REQ

RFG

RF

RM

RO

RR

SAM

SBS

SCD

SECT

SF

SG

SGL

SHT

SIM

SND

SNR

SOG

SQ

SS

SS#

STD

STL

STR

SV

T#

T&B

T&G

T&M

TEL

THK

TOC

TOPL

TOPV

TOW

TPD

TU

ΤV

TYP

UNO

UTIL

VCT

VEG

VERT

VEST

VFY

VG VNR

VP

W/

W/H

W/O

WC

WD

WF

WН

WP

WPFG

WR

WΤ

WRB

WWF

XPS

YD

VR

WITH

WITHOUT

WOOD

WEIGHT

YARD

WATER HEATER

WOOD FLOORING

WOVEN WIRE FABRIC

EXTRUDED POLYSTYRENE

WALL HUNG

WATERPROOF WATERPROOFING

WALLCOVERING, WATER CLOSET

WATER RESISTANT, WATER RESISTIVE

WEATHER RESISTIVE BARRIER

SYM

SHTG

SC

PKG

PED

PERF

MIN

MISC

MEDICATION. MEDICAL MEMB MEMBRANE MANUFACTURER MANHOLE MINIMUM MISCELLANEOUS MASONRY OPENING MOISTURE RESISTANT METAL MULLION NO CEILING NON-COMBUSTIBLE NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE ON CENTER OUTSIDE DIAMETER OFFICE OVERHEAD OPENING OPPOSITE, OPPOSITE HAND OUNCE PAINT PROPERTY LINE PRECAST PEDESTRIAN PERFORATED PENTHOUSE PARKING PLATE PLASTIC LAMINATE (PLAM) PLAST PLASTER, PLASTIC PANEL POLYISO POLYISOCYANURATE POWER POLE PAIR PREFIN PREFINISHED PRELIM PRELIMINARY PREM PREMIUM PROP PROPERTY POUNDS PER SQUARE INCH PRESERVATIVE TREATED, POST-TENSIONED PAPER TOWEL DISPENSER PTD/R PAPER TOWEL DISPENSER AND RECEPTACLE PLYWOOD RISER, RISERS RADIUS RUBBER BASE REFLECTED CEILING PLAN ROOF DRAIN REFERENCE REHAB REHABILITATION REINF REINFORCED, REINFORCING REQUIREMENTS, REQUIRED **RESILIENT FLOORING** ROOFING ROOM ROUGH OPENING REST ROOM SELF-ADHERED MEMBRANE STYRENE BUTADIENE STYRENE SEALED CONCRETE, SOLID CORE SEAT COVER DISPENSER SCHED SCHEDULE SECTION, SECTIONAL SQUARE FEET, STOREFRONT SAFETY GLASS SINGLE SHEET SHEATHING SIMILAR SANITARY NAPKIN DISPENSER SANITARY NAPKIN RECEPTACLE SLAB ON GRADE SQUARE STAINLESS STEEL SOLID SURFACE STANDARD STEEL STOR STORAGE STAIR, STAIRS STRUCT STRUCTURAL SUSP SUSPENDED SHEET VINYL SYMMETRICAL, SYMBOL TREAD, TREADS TILE TOP AND BOTTOM TONGUE AND GROOVE TIME AND MATERIALS TELEPHONE, TELECOMM THICK TOP OF CURB TOP OF PLATE TOP OF PAVEMENT TOP OF WALL TOILET PAPER DISPENSER TILT-UP TELEVISION TYPICAL UNDLY UNDERLAYMENT UNLESS NOTED OTHERWISE UTILITY VINYL COMPOSITION TILE VEGETATED VERTICAL VESTIBULE VERIFY VERTICAL GRAIN VENEER VENEER PLASTER VAPOR RETARDER

SYMBOLS

GRID NORTH ARROWS

ELEVATION DATUM

DOOR	(A101) -	DOOR NUMBER
KEYNOTE	< ? →	—— KEYNOTE NUMBER
VINDOW		
REVISION		—— WINDOW TYPE
EXTERIOR ELEVATION		REVISION NUMBER
NTERIOR ELEVATION	SIM A101	ELEVATION NUMBER
BUILDING SECTION		ELEVATION NUMBER SHEET NUMBER
WALL SECTION	SIM	SECTION NUMBER
DETAIL		SHEET NUMBER
FLOOR, ROOF OR WALL ASSEMBLY	1 A101	SECTION NUMBER
CEILING	SIM A101	SECTION NUMBER SHEET NUMBER
ROOM	6A.8 0 555 B	ASSEMBLY NUMBER MODIFIER CORE WIDTH
DRAWING / DETAIL TITLE	10'-0'-	FIRE RATING
FIRE LIFE / SAFETY	ROOM UNIT TYPE <u>ROOM NAME</u> 101 1,500 SF -	ROOM NUMBER ROOM AREA
		SCALE NUMBER ON SHEET
	NAME ARE FUNCTION X 14 OCC. LOAD OAD FACTOR X/Y Y	 ROOM FUNCTION OCCUPANT LOAD FACTOR OCCUPANT AREA (SF) ROOM OCCUPANT LOAD
MATERIALS		
DIVISION 03		

MATERIALS

TAGS

DIVISION 04

DIVISION 05

DIVISION 06


DIVISION 07

DIVISION 09

ISION 03	
CONCRETE	
ISION 04	
BRICK VENEER	
СМИ	
ISION 05	
ALUMINUM	
STEEL	
ISION 06	
PLYWOOD	
MOISTURE RESISTANT SHEATHING	
SAWN LUMBER: CONTINUOUS	
SAWN LUMBER: BLOCKING	
FINISH LUMBER	
GLUE LAMINATED BEAM/ COLUMN	
ISION 07	
BATT INSULATION	
RIGID BOARD INSULATION	
MINERAL FIBER INSULATION	

FOAMED-IN-PLACE INSULATION BACKER ROD AND SEALANT

GYPSUM WALLBOARD




 $\bigcirc (\mathbb{C}$

PROJECT NOTES

- GENERAL THESE DRAWINGS AND THE ACCOMPANYING SPECIFICATIONS ARE THE PROPERTY OF MDG AND 1 SHALL NOT BE COPIED OR REUSED FOR ANY OTHER PROJECT. THE VARIOUS CONSTRUCTION DRAWINGS AND SPECIFICATIONS ARE COMPLEMENTARY, WHAT IS SHOWN FOR EITHER IS BINDING AND REQUIRED FOR ALL. PROVIDE WORK SHOWN OR REFERRED TO ON ONE SET OF DRAWINGS AS THOUGH SHOWN ON ALL RELATED DRAWINGS. CONTRACTOR TO COORDINATE ALL DRAWINGS AND SPECIFICATIONS TO COMPLETE THE WORK. NOTIFY THE ARCHITECT OF ANY DISCREPENCIES OR CONFLICTS. THE SPECIFICATIONS AND/ OR BASIS OF DESIGN SCHEDULE CONTAIN PERTINENT DETAILED
- INFORMATION ABOUT EACH BUILDING COMPONENT; THEY ARE A PART OF THE CONTRACT DOCUMENTS AND MUST BE USED IN CONJUNCTION WITH THE DRAWINGS. NO BUILDING COMPONENT SHOWN ON THESE DRAWINGS SHALL BE INCORPORATED INTO THE WORK UNTIL SHOP DRAWINGS, SAMPLES, BROCHURES OR OTHER SUBMITTALS CALLED FOR IN THE SPECIFICATIONS HAVE BEEN REVIEWED AND APPROVED BY THE GENERAL CONTRACTOR AND SUBSEQUENTLY REVIEWED BY THE ARCHITECT.
- VERIFY SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH CONSTRUCTION. COORDINATE THE WORK OF DELEGATED DESIGNERS WITH THE WORK OF OTHER TRADES. WOOD IN CONTACT WITH CONCRETE SHALL BE PRESERVATIVE-TREATED.
- CONCEALED WOOD USED IN TYPE I AND TYPE II CONSTRUCTION SHALL BE FIRE RETARDANT TREATED FASTENERS IN CONTACT WITH TREATED WOOD SHALL BE CORROSION RESISTANT.
- 10. PROVIDE BLOCKING OR OTHER CONCEALED SUPPORTS WITHIN WALLS AS REQUIRED FOR HANDRAILS, CASEWORK, GRAB BARS, ART WORK, SHELVING, AND OTHER APPLIED WALL MOUNTED FIXTURES, FINISHES OR EQUIPMENT. 11. COORDINATE MECHANICAL, PLUMBING, AND ELECTRICAL ACCESS DOOR LOCATIONS WITH
- ARCHITECT. DIMENSIONS
- DO NOT SCALE THE DRAWINGS. WRITTEN DIMENSIONS GOVERN. DO NOT ADJUST CLEAR DIMENSIONS WITHOUT APPROVAL OF THE ARCHITECT. DIMENSIONS ARE MEASURED FROM GRID LINES, PROPERTY LINES, FACE OF CONCRETE, FACE OF MASONRY, CENTERLINE OF STUD OR CENTERLINE OF THE AIR GAP (AT DOUBLE STUD ROW
- WALLS) UNLESS OTHERWISE NOTED. DIMENSIONS NOTED AS 'CLEAR' OR 'INSIDE CLEAR' ARE MEASURED FROM THE FACE OF FINISHED SURFACE(S) NOTES TO 'ÁLIGN' REFER TO FINISHED FACE OF INDICATED SURFACES.
- LOCATE FACE OF HINGE SIDE DOOR JAMBS 4" AWAY FROM ADJACENT WALL UNLESS NOTED OTHERWISE 'FLOOR LINE', 'FLOOR', 'FINISH FLOOR' OR 'FLOOR LEVEL' REFER TO TOP OF CONCRETE SLAB OR TOP OF CEMENTITIOUS UNDERLAYMENT; SCHEDULED FLOORING MATERIAL IS INSTALLED ABOVE THE FLOOR LINE.
- ACCESSIBILITY REFER TO SHEETS STARTING AT G0.2 FOR SPECIFIC ACCESSIBILITY REQUIREMENTS PERTAINING TO OUTLET LOCATIONS AND HEIGHTS, SWITCH LOCATIONS AND HEIGHTS, GRAB BARS, WALL
- CHANGES IN FINISH FLOOR ELEVATION IN EXCESS OF 1/4", MEASURED FROM LOWEST POINT ON EITHER SIDE OF THRESHOLD TO HIGHEST POINT ON THRESHOLD, SHALL BE BEVELED AT 1:2, 1/2" MAX. IN NO CASE SHALL FLOOR TRANSITIONS AND CHANGES IN LEVEL IN FLOOR SURFACE BE MORE THAN 1/4" MAX IN VERTICAL HEIGHT.
- SIGNAGE PROVIDE EXIT SIGNAGE IN ACCORDANCE WITH OSSC 1013. PROVIDE ACCESSIBILITY SIGNAGE IN ACCORDANCE WITH OSSC 1111.
- PROVIDE CODE-REQUIRED 'IN CASE OF FIRE...' SIGNAGE AT ELEVATOR CALL STATIONS. IDENTIFY ALL FIRE-RATED ENCLOSURES CONCEALED ABOVE CEILINGS USING MIN. 3" HIGH RED
- LETTERING READING: 'FIRE AND/OR SMOKE BARRIER PROTECT ALL OPENINGS'. AT ROOMS WITH AN OCCUPANT LOAD OF 50 OR GREATER, SIGNAGE WITH THE MAXIMUM ALLOWABLE OCCUPANT LOAD SHALL BE POSTED AT THE MAIN ENTRANCE TO THE ROOM.
- PROVIDE SIGNAGE IN EXIT STAIRWAYS AS FOLLOWS: a. AT EACH FLOOR LANDING IN BUILDING GREATER THAN 3 STORIES b. A SIGN INDICATING IF THE STAIR PROVIDES ROOF ACCESS c. AT LANDINGS OF STAIRS WITH MULTIPLE DOORS, INDICATE ANY DOOR WITH DIRECT ACCESS TO AN ENCLOSED ELEVATOR LOBBY
- HORIZONTAL AND VERTICAL ASSEMBLIES
- REFER TO STRUCTURAL DRAWINGS FOR LOCATIONS OF, AND ADDITIONAL REQUIREMENTS FOR LOAD-BEARING AND SHEAR WALLS. STUD SIZE AND CORE THICKNESSES ARE INDICATED ON THE ASSEMBLY TYPE TAGS ON THE
- DRAWINGS; REFER TO THE TAG LEGEND ON SHEET G0.1. GYPSUM WALLBOARD IS 5/8" TYPE 'X' UNLESS NOTED OTHERWISE. WEATHER-RESISTIVE BARRIERS AND/OR VAPOR RETARDERS DESIGNATED AS "AB" ALSO
- FUNCTION AS AIR BARRIERS. SEAL ALL EDGES, INTERSECTIONS AND LAPS, TO CREATE AN AIR-TIGHT ENCLOSURE 5. FIRE RATED ASSEMBLIES: SEAL ALL EDGES AND INTERSECTIONS WITH FIRE CAULKING; COVER ALL RECESSED DEVICES WITH FIRE PROTECTIVE COVERINGS TO MEET THE REQUIREMENTS OF THE LISTING SOURCE AND AUTHORITY HAVING JURISDICTION (AHJ). INSTALL ALL MATERIALS IN STRICT ACCORDANCE WITH THE PUBLISHED REQUIREMENTS OF THE LISTING SOURCE, INCLUDING BUT NOT LIMITED TO: STUD GAGE AND SPACING, FASTENER SIZE AND SPACING,
- ORIENTATION OF GYPSUM WALLBOARD, OFFSETS OF JOINTS BETWEEN ADJACENT LAYERS OR OPPOSITE SIDES OF WALL, BRIDGING AND CROSS BRACING. FIRE RATING AGENCY REQUIREMENTS INDICATE THE MINIMUM NEEDED TO ACHIEVE FIRE RATING; ADDITIONAL LAYERS, OR THICKER LAYERS, OF GYPSUM WALLBOARD OR SHEATHING MAY BE
- SHOWN TO MEET OTHER PROJECT REQUIREMENTS. 7. SEAL AND OTHERWISE PROTECT PENETRATIONS THROUGH FIRE-RATED CONSTRUCTION USING APPROVED FIRESTOPPING SYSTEMS TO MAINTAIN THE FIRE RATING OF THE ASSEMBLY BEING PENETRATED.
- 8. USE ACOUSTICALLY RATED FIRE SEALANT WHEREVER FIRE RATED CONSTRUCTION IS ALSO ACOUSTICALLY RATED. 9. SEAL PENETRATIONS THROUGH ACOUSTICALLY-RATED CONSTRUCTION TO MAINTAIN THE ACOUSTICAL RATING OF THE ASSEMBLY BEING PENETRATED.
- 10. SEAL PENETRATIONS IN ACOUSTICALLY RATED WALLS. WRAP BACKS OF ALL RECESSED DEVICES WITH ACOUSTIC PADS RATED FOR THE ASSEMBLY. 11. PROVIDE WATERSTOPS AT COLD JOINTS IN BELOW GRADE CONCRETE ASSEMBLIES AT THE
- EXTERIOR WALLS OF THE BUILDING. 12. PROVIDE DEFLECTION COMPENSATION AT TOP OF WALLS SECURED TO THE UNDERSIDE OF CONCRETE SLABS OR METAL DECK.
- 13. INSTALL FIREBLOCKING IN WALLS OF COMBUSTIBLE FRAMING AT THE CEILING AND FLOOR LEVELS AND AT MAX HORIZONTAL INTERVALS OF 10 FEET OR AS REQUIRED BY THE AHJ. 14. INSTALL FIREBLOCKING AT THE INTERSECTION OF COMBUSTIBLE WALLS AND HORIZONTAL
- ASSEMBLIES WITH CONCEALED SPACES OF AS REQUIRED BY THE AHJ. 15. INSTALL FIREBLOCKING IN STAIRS OF COMBUSTIBLE FRAMING IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF EACH RUN OR AS REQUIRED BY THE AHJ. 16. INSTALL FIREBLOCKING IN CONCEALED SPACES BEHIND EXTERIOR WALL COVERINGS OF
- COMBUSTIBLE MATERIALS AT MAX. 20 FOOT INTERVALS WITH NO CONCEALED SPACE EXCEEDING 100 SQUARE FEET OR AS REQUIRED BY THE AHJ.

DESIGN REVIEW SET - FEBRUARY 2023

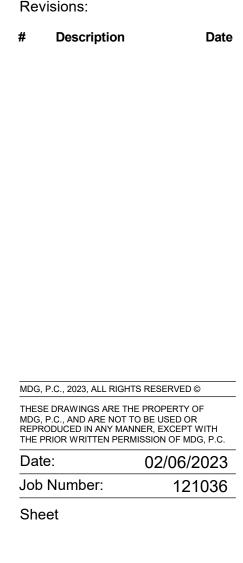

G0.′

PROJECT DATA

Sheet Title:

SW Garden Acres Road Wilsonville OR 97070

Project: PRECISION **COUNTERTOPS**

26200 SW 95th Ave, Wilsonville OR 97070

COUNTERTOPS

Client/ Owner: PRECISION

BLOCKING, FLOOR CLEARANCES, COUNTERTOP HEIGHTS, LOCATION OF PLUMBING CONTROLS,


ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552

uan tem

ORTLAND, OREGON

OF OF


No. 4268

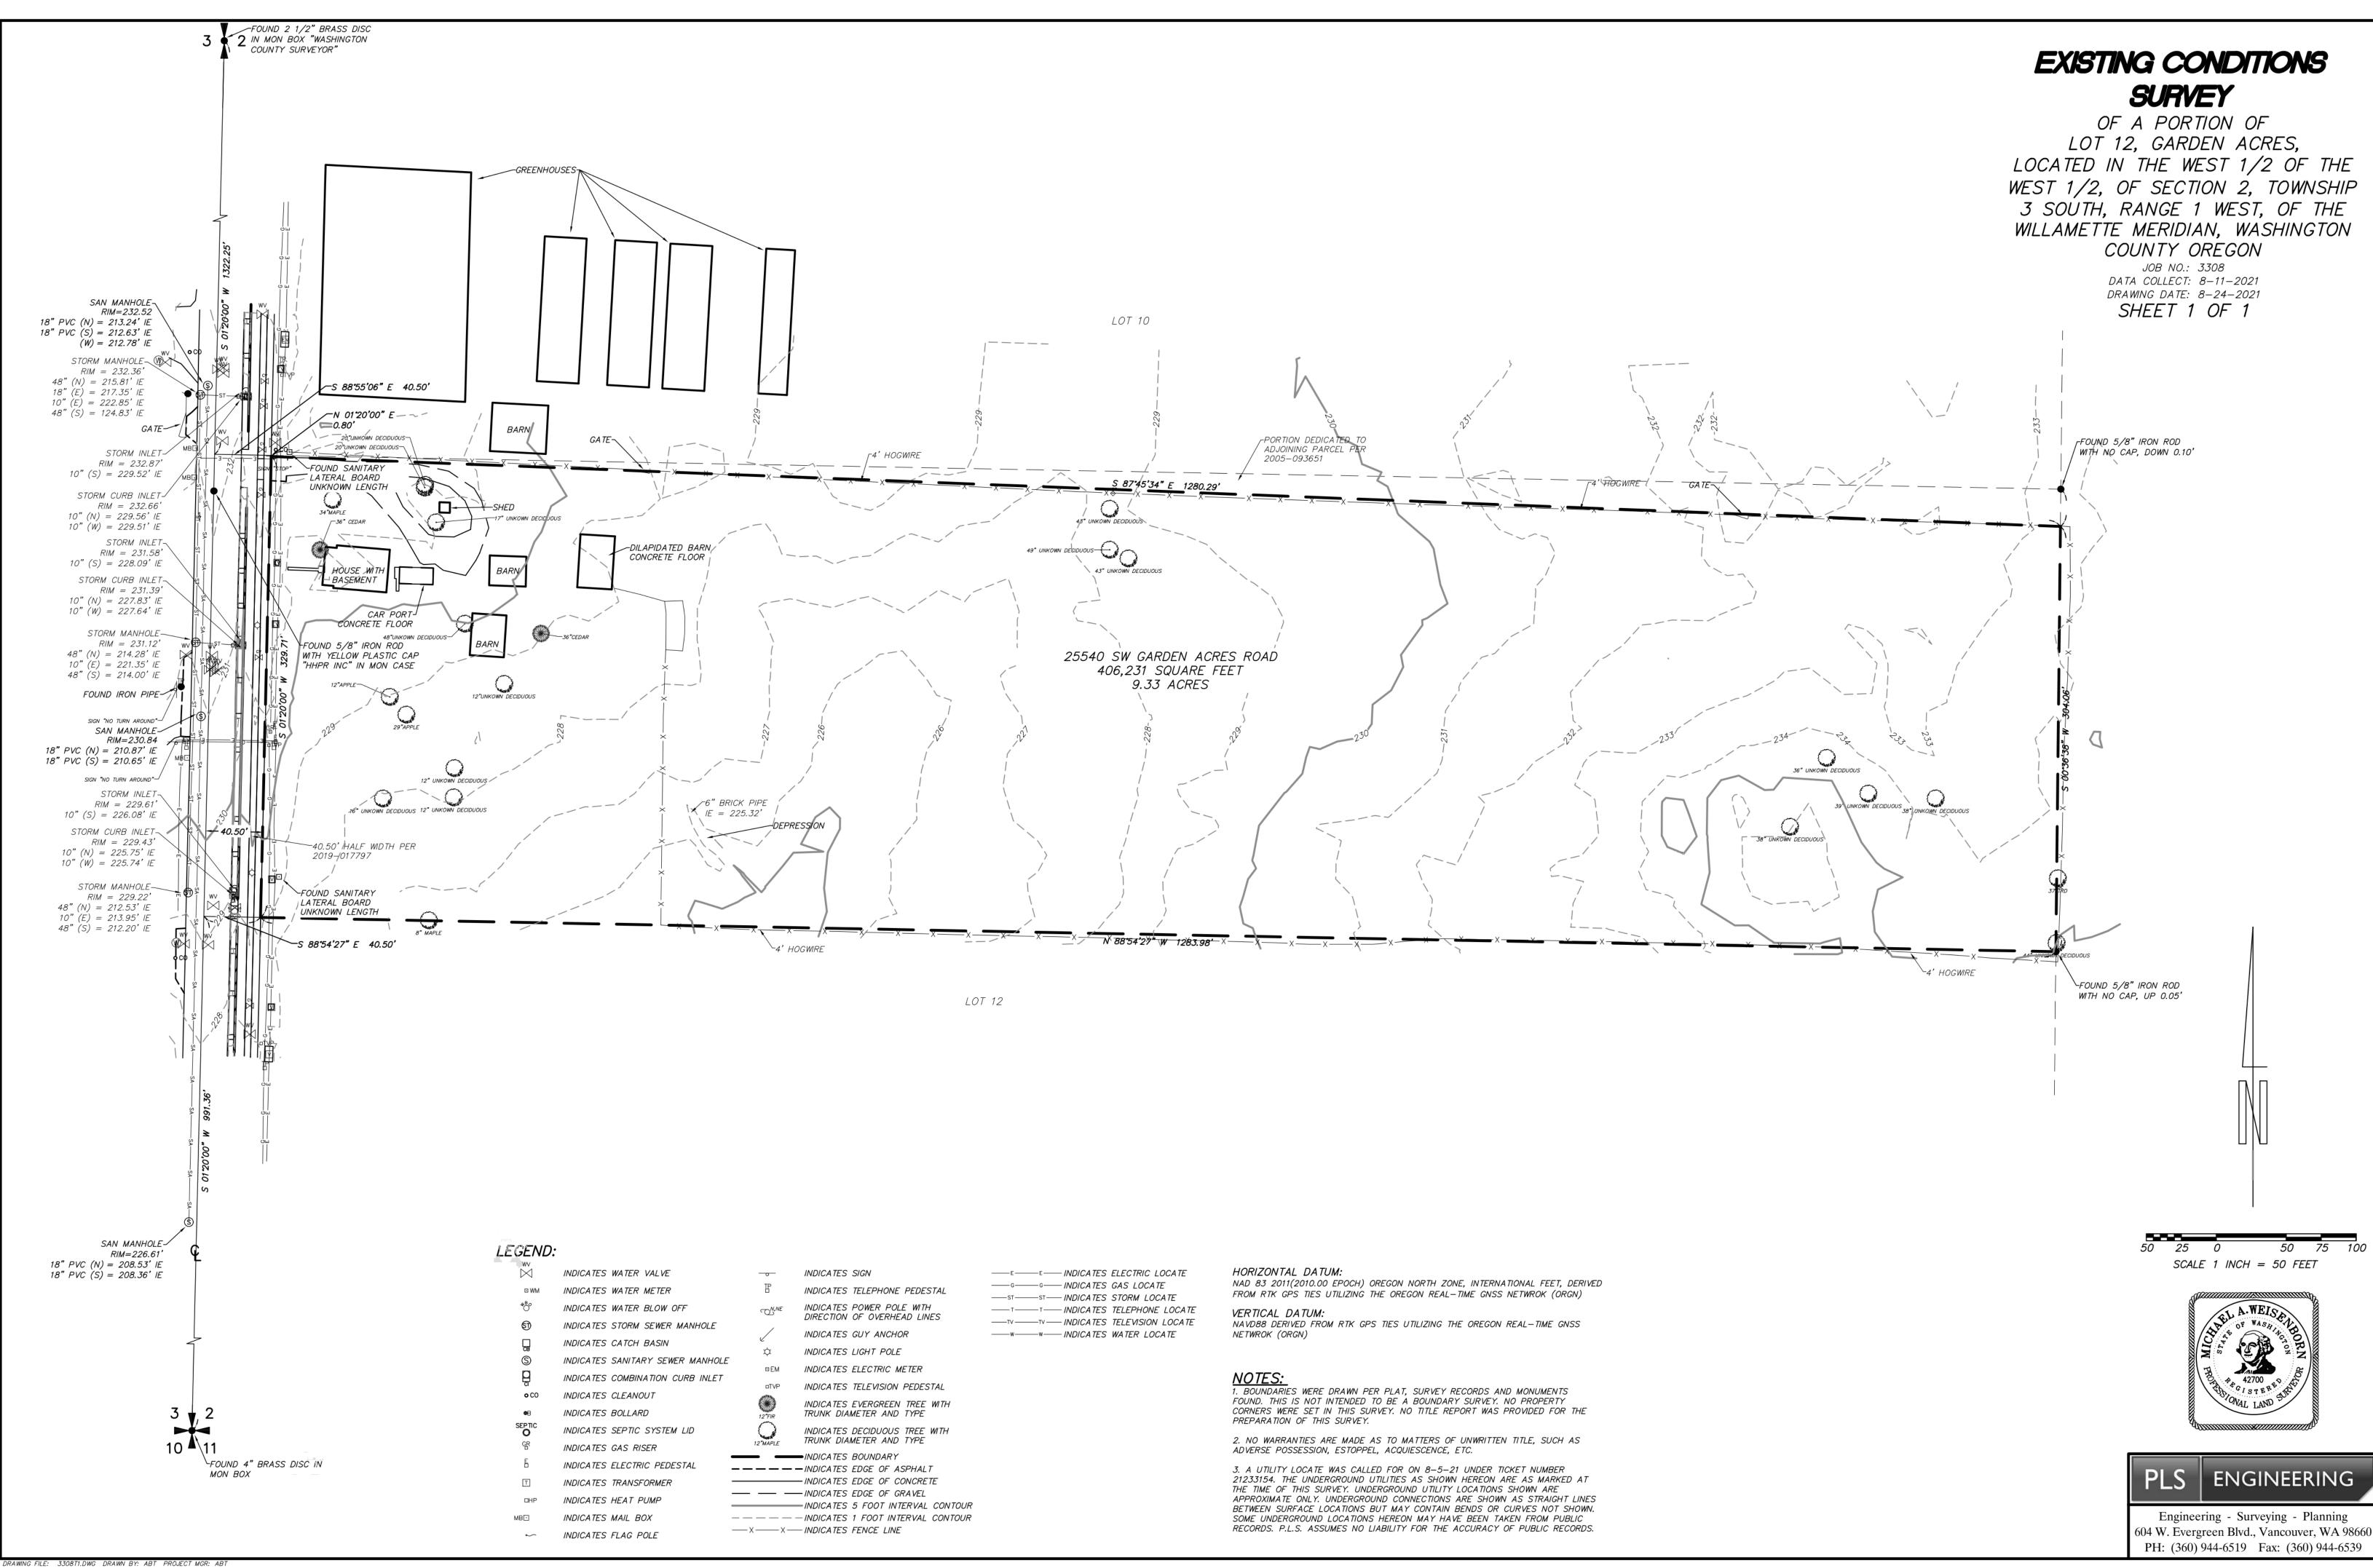

DESIGN REVIEW SET - FEBRUARY 2023





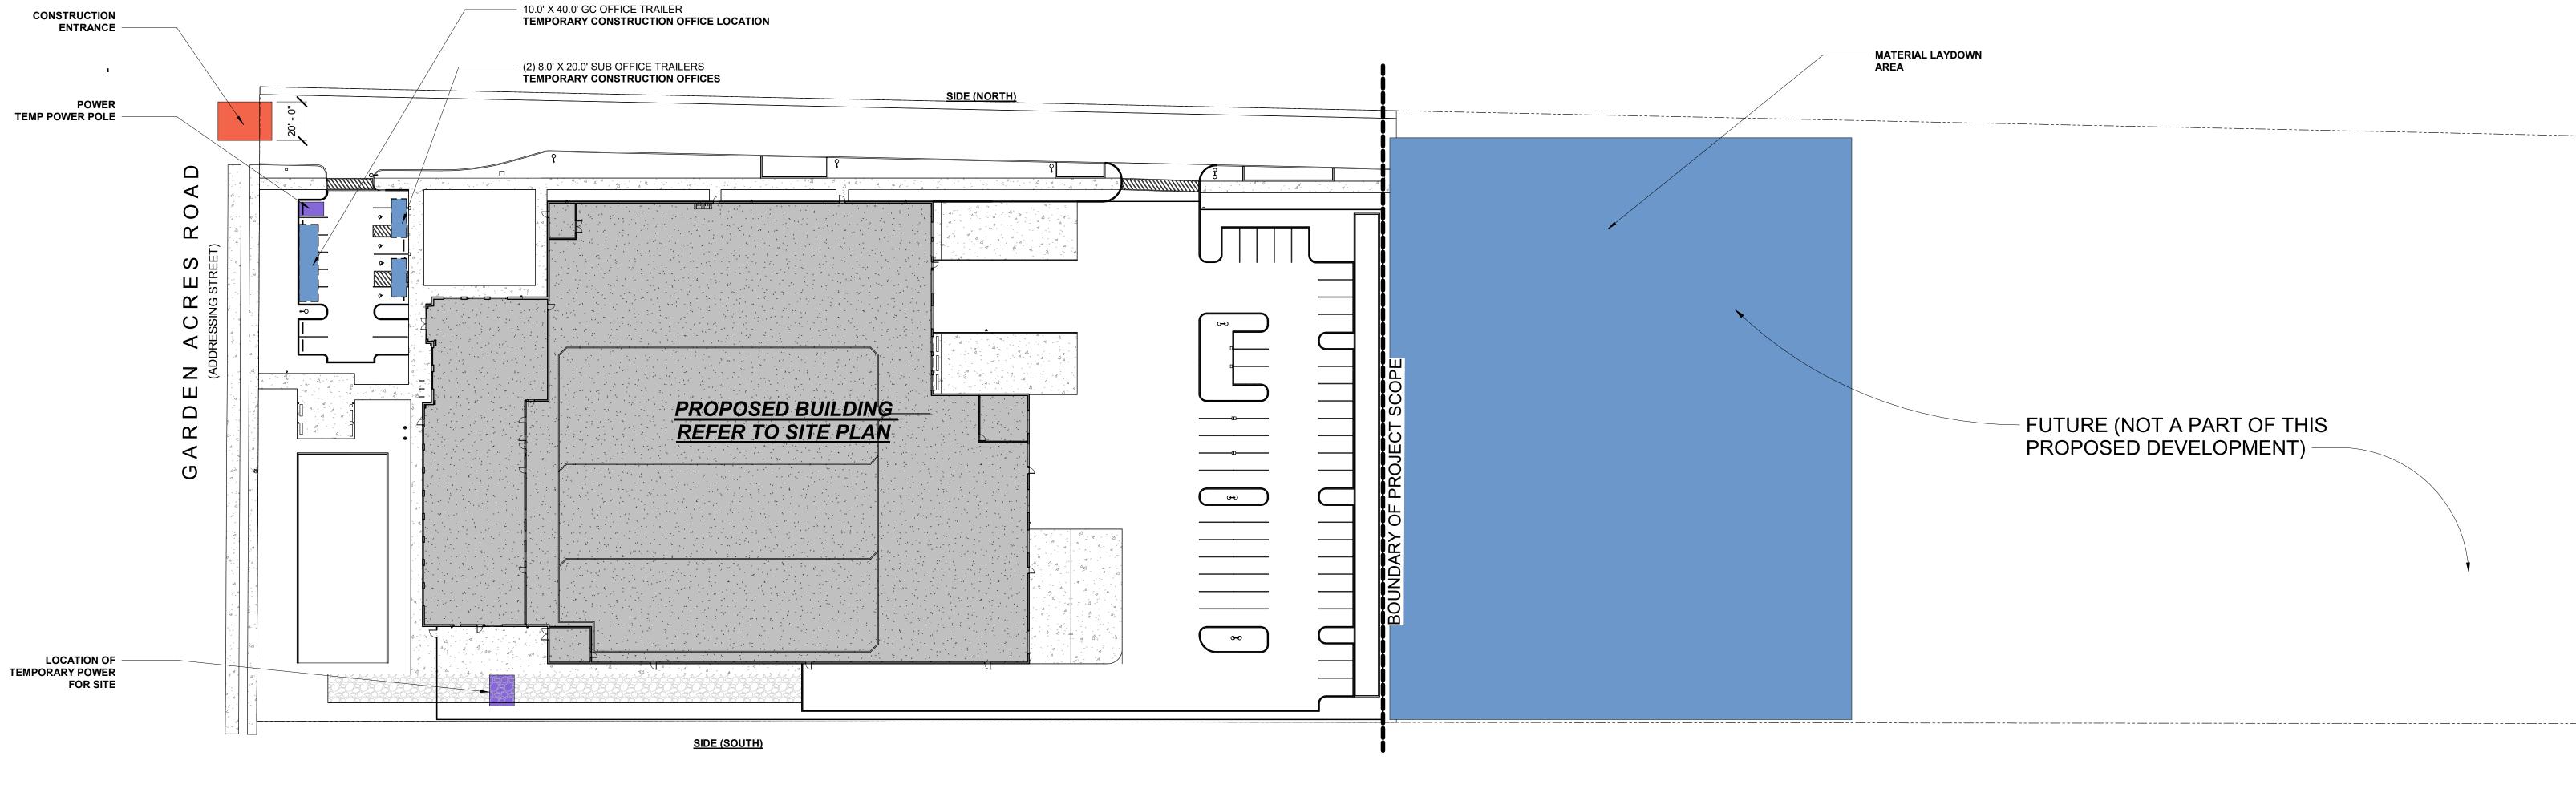


CONSTRUCTION STAGING PLAN

DURATION OF THE TEMPORARY CONSTRUCTION OFFICE 18-24 MONTHS


TIP **ARCHITECTURE | INTERIORS** 4875 SW GRIFFITH DRIVE, SUITE 300 BEAVERTON, OREGON 97005 0 | 503.244.0552 RED uan Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: CONSTRUCTION STAGING Revisions: Descriptio MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: Job Number: 121036 Sheet G1.2





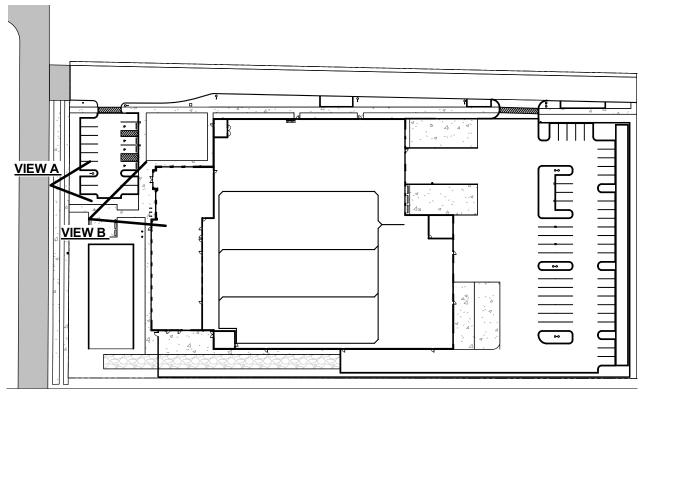

DESIGN REVIEW SET - FEBRUARY 2023

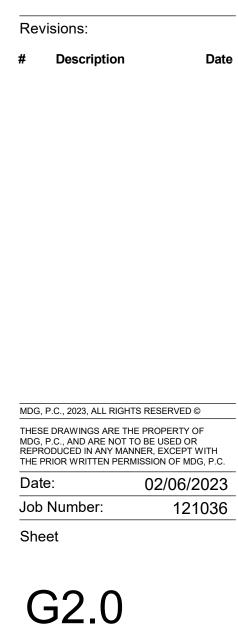

RENDERINGS

Sheet Title:

SW Garden Acres Road Wilsonville OR 97070

Project: PRECISION COUNTERTOPS

26200 SW 95th Ave, Wilsonville OR 97070





VIEW C - LOADING DOCK VIEW - CURRENT CONDITION



VIEW C - LOADING DOCK VIEW - FUTURE JAVA ROAD CONDITION

ı, i -----

DESIGN REVIEW SET - FEBRUARY 2023



MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 121036 Date: Job Number: Sheet

Revisions:

RENDERINGS

Sheet Title:

SW Garden Acres Road Wilsonville OR 97070

Project: PRECISION COUNTERTOPS

26200 SW 95th Ave, Wilsonville OR 97070


uan T No. 4268 170





VIEW D - FRONT DOCK VIEW - CURRENT CONDITION



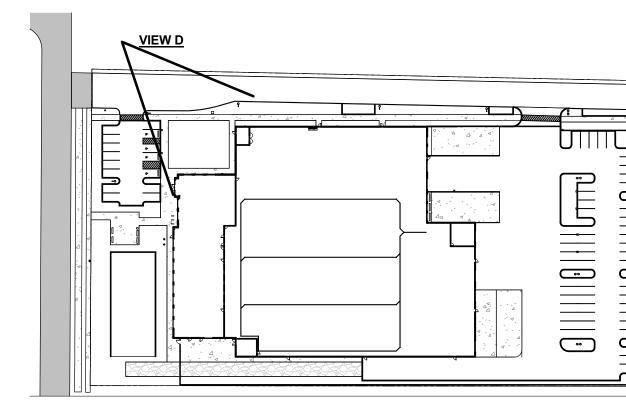

DESIGN REVIEW SET - FEBRUARY 2023



 THESE DRAWINGS ARE THE PROPERTY OF

 MDG, P.C., AND ARE NOT TO BE USED OR

 REPRODUCED IN ANY MANNER, EXCEPT WITH

 THE PRIOR WRITTEN PERMISSION OF MDG, P.C.

 Date:
 02/06/2023

 Job Number:
 121036

 Sheet

MDG, P.C., 2023, ALL RIGHTS RESERVED ©

Description

Revisions:

Date

RENDERINGS

Sheet Title:


SW Garden Acres Road Wilsonville OR 97070


Project: PRECISION COUNTERTOPS

26200 SW 95th Ave, Wilsonville OR 97070

uan 5 ATE OF OR



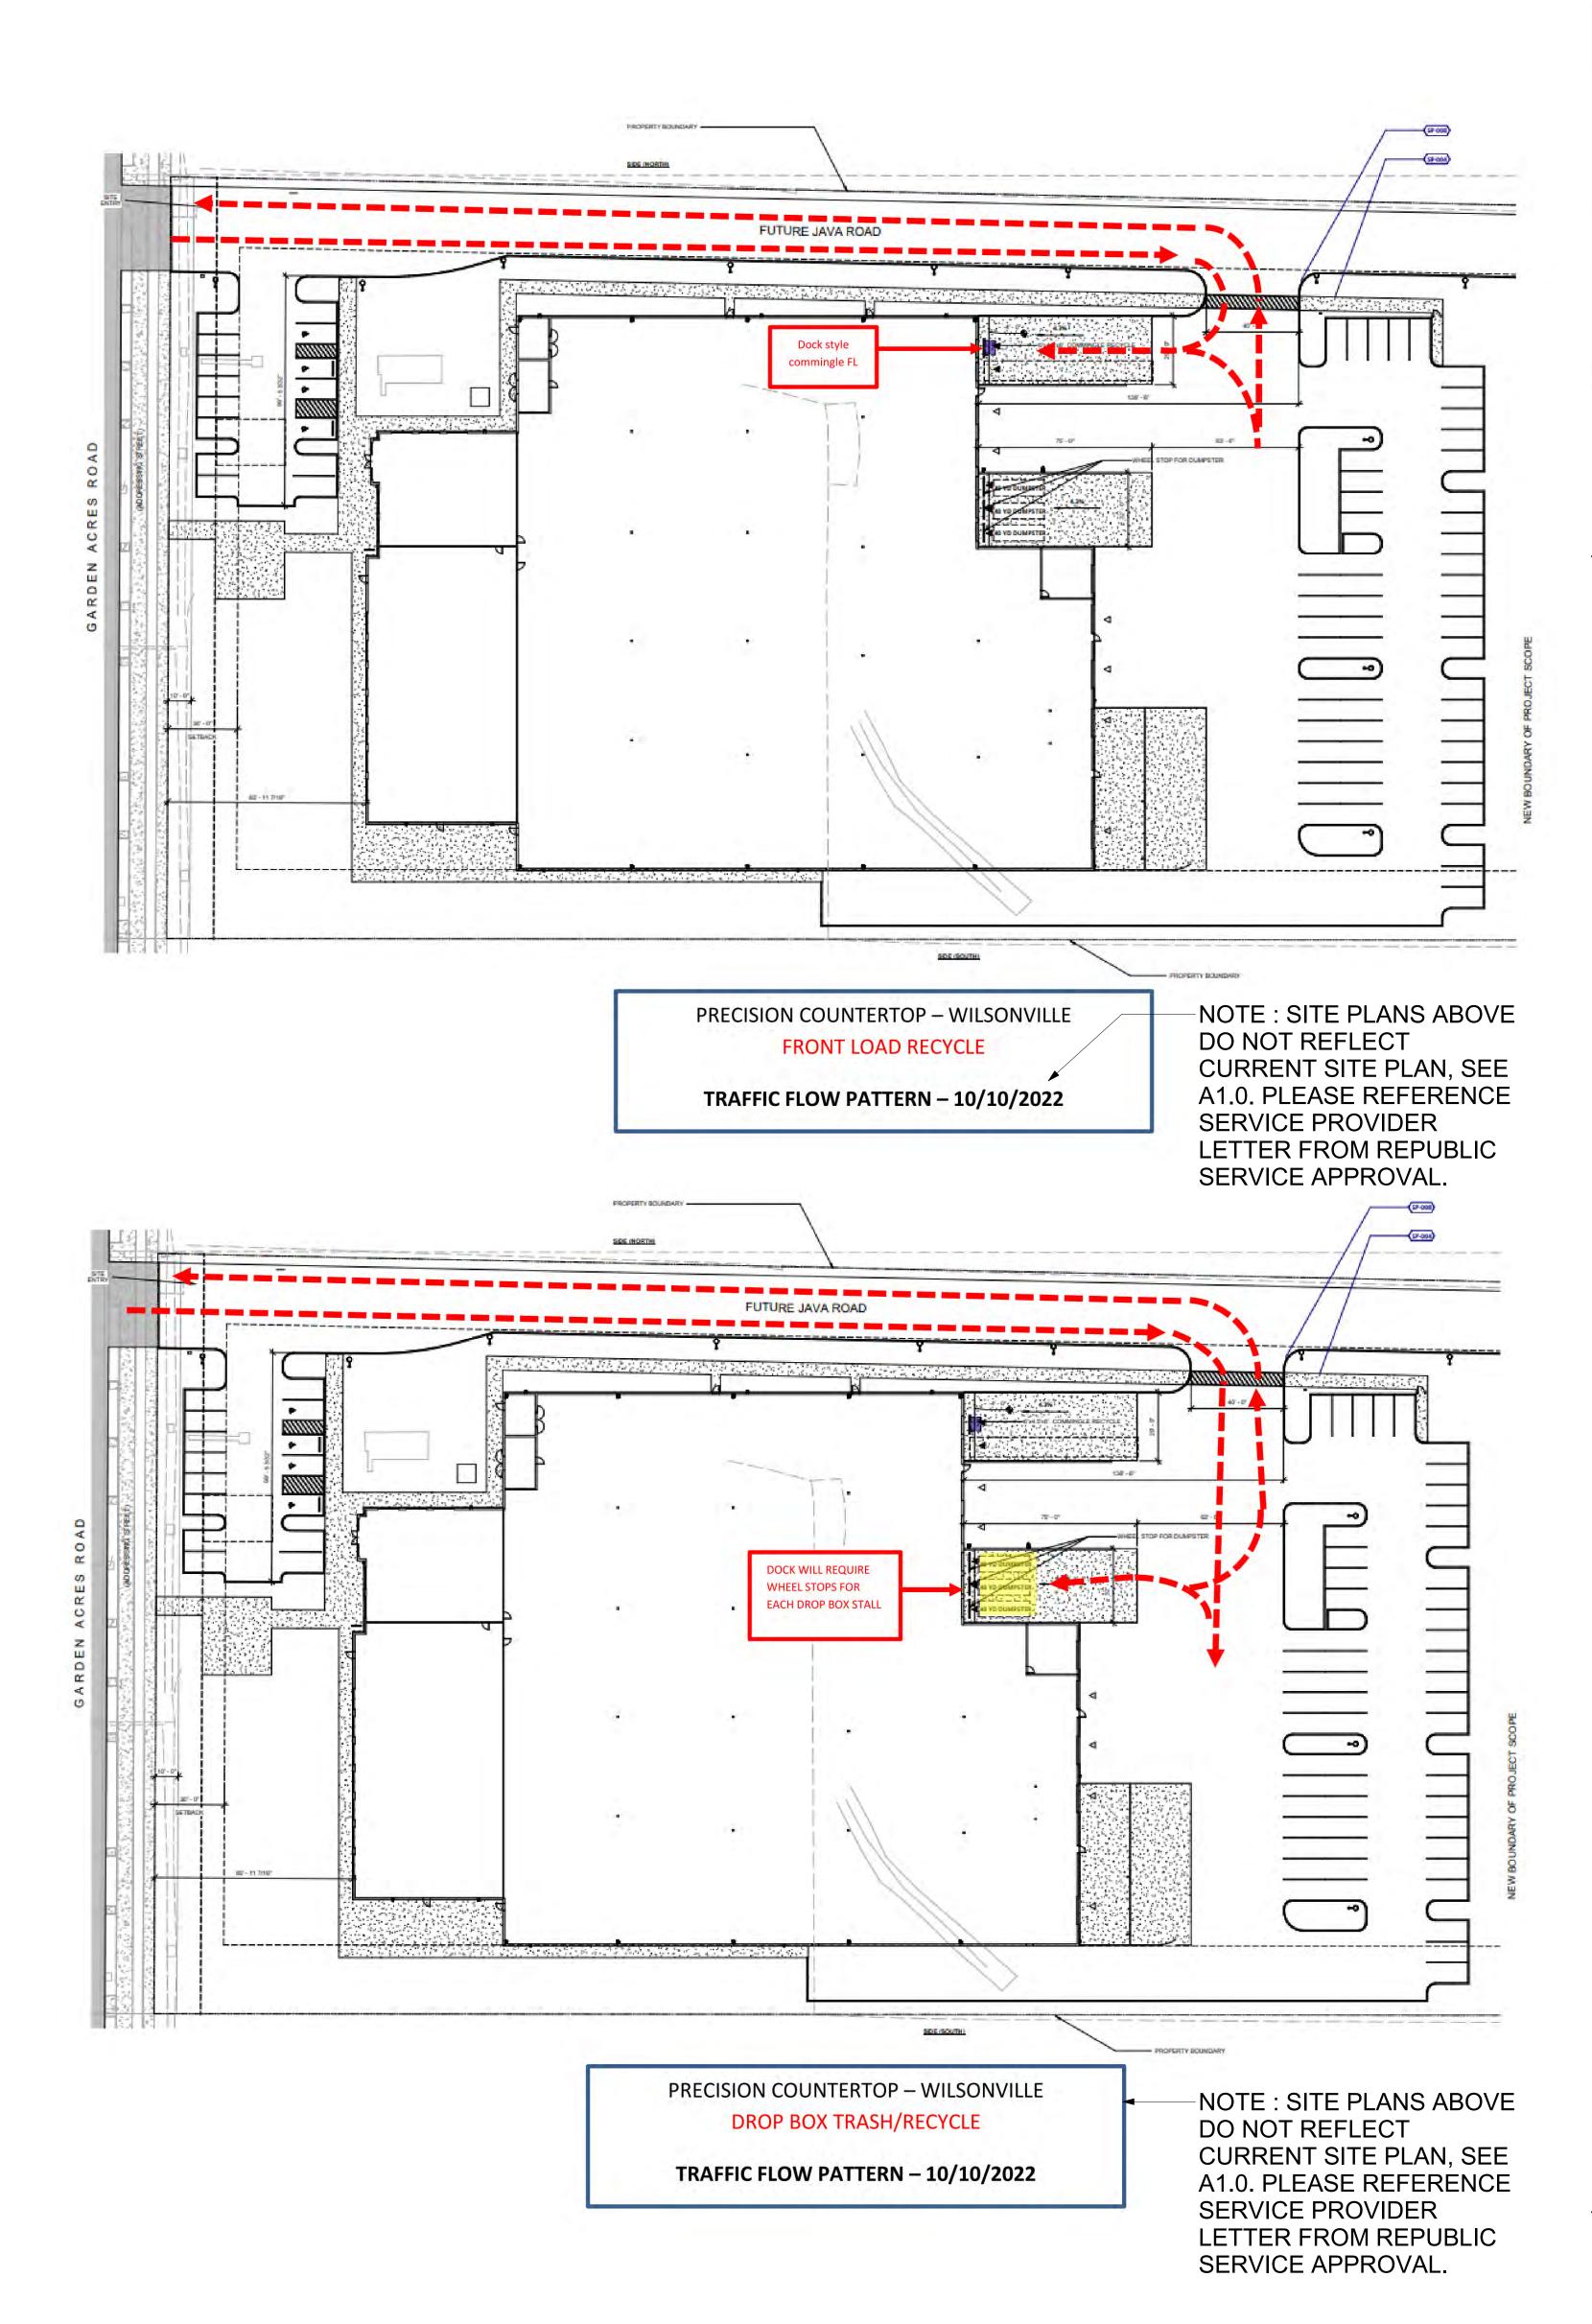

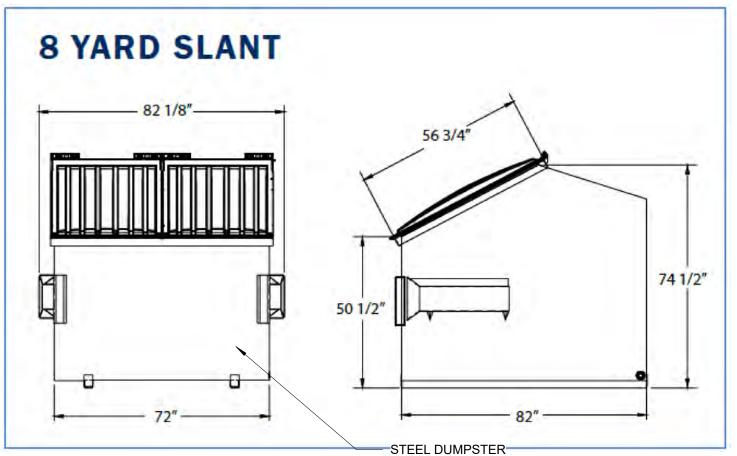


SPECIFICATION SHEET FOR COMINGLED RECYCLING CONTAINER OBTAINED FROM REPUBLIC SERVICES

FRONT LOAD RECYCLE

Wastequip Oregon Wastequip Style Drop Box Dimensions

Cubic	Box	Вох	Wall	OVERALL	WIDTH	WIDTH	₩all/ Floor	₩all/ Floor	Wall/ Floor
YDS	Length I.D. (A)	Length O.D. (B)	Height I.D. (C.)	Heigth O.D. (D)	I.D. (E)	0.D. (F)	all 12	12g/1 Og	all 1(g
10 yd	12 ft.	12 ft. 8in.	37"	53"	89"	95"			
15 yd	12 ft.	12 ft. 8in.	54"	70"	89"	95"			
20 yd	16 ft.	16 ft. 8 in.	55"	71"	89"	95"			
20 yd	20 ft.	20 ft. 8 in.	44"	60"	89"	95"			
20 yd	22 ft.	22 ft. 8 in.	40"	56"	89"	95"			
25 yd	18 ft.	18 ft. 8 in.	61"	77"	89"	95"			
30 yd	20 ft.	20 ft. 8 in.	66"	82"	89"	95"			
30 yd	22 ft.	22 ft. 8 in.	61"	77"	89"	95"			
40 yd	20 ft.	20 ft. 8 in.	88"	104"	89"	95"			
40 yd	22 ft.	22 ft. 8 in.	80"	96"	89"	95"			
50 yd	22 ft.	22 ft. 8 in.	98"	114"	89"	95"			



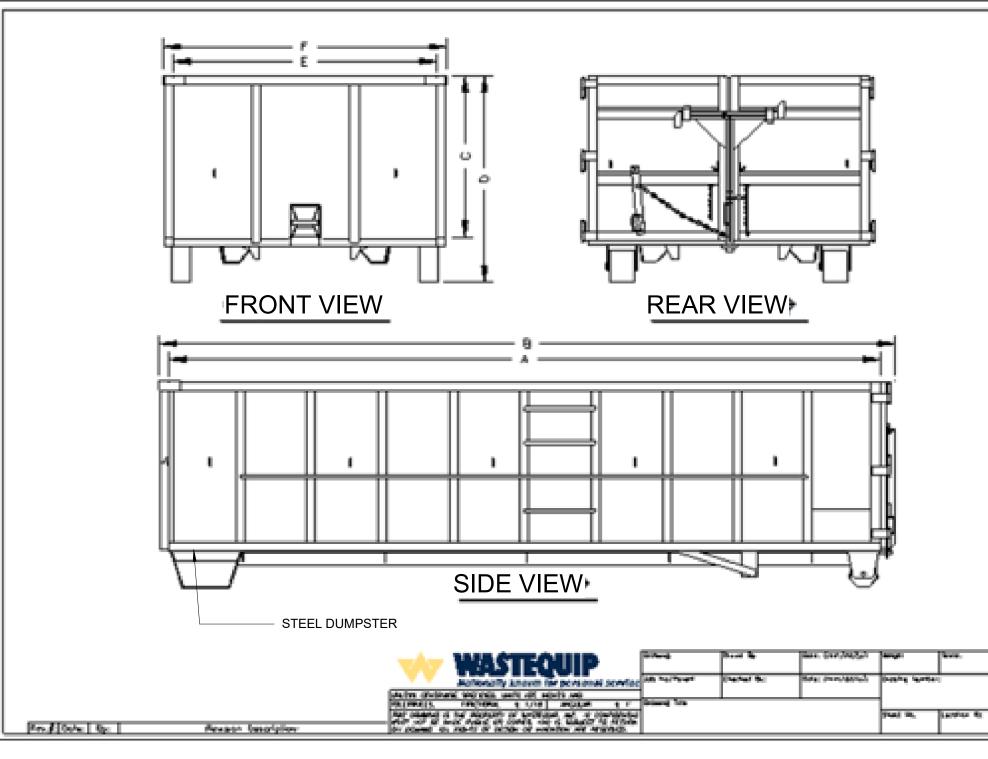

SPECIFICATION SHEET FOR 40 YARD DUMPSTER OBTAINED FROM REPUBLIC SERVICES

DROP BOX TRASH / RECYCLE

ayatem-superior nook u



January 31, 2023

Simone O'Halloran / MDG

Re: Precision Countertop 25540 SW Garden Acres Rd. Wilsonville, OR 97140

Dear Simone,

Thank you, for sending us the revised site design plans for this proposed development in Wilsonville.

My Company: Republic Services of Clackamas and Washington Counties has the franchise agreement to service this area with the City of Wilsonville. We will provide complete industrial and commercial waste removal and recycling services as needed on a weekly basis for this location

We have reviewed the revised site design that you sent us on January 26, 2023 and have determined that the design modifications will allow Republic Services to provide trash and recycle service at this location as previously approved on May 30, 2022.


Thanks Simone, for your help and concerns for our services prior to this project being developed.



Sincerel

Republic Services Inc.

SERVICE PROVIDER LETTER FROM REPUBLIC SERVICE OBTAINED FROM REPUBLIC SERVICES 1/31/2023

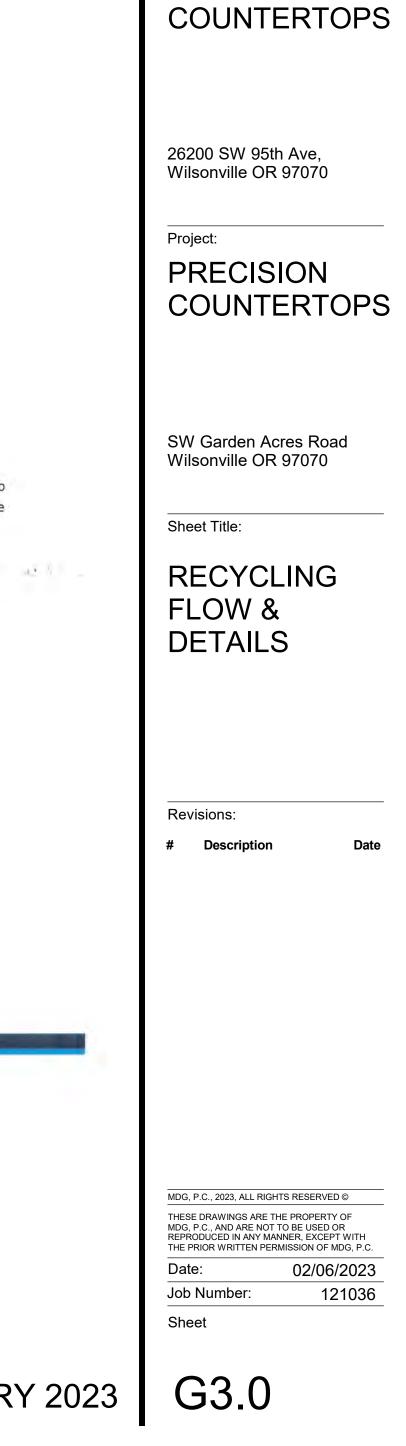

Client/ Owner:

PRECISION



GENERAL UTILITY NOTES

- 1. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE JURISDICTION.
- 2. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE CURRENT EDITION OF THE PLUMBING CODE, BUILDING CODE, AND THE FIRE CODE.
- 3. THE CONTRACTOR SHALL HAVE A FULL SET OF THE CURRENT APPROVED CONSTRUCTION DOCUMENTS INCLUDING ADDENDA ON THE PROJECT SITE AT ALL TIMES.
- 4. THE CONTRACTOR SHALL NOTIFY THE OREGON UTILITY NOTIFICATION CENTER (800 332 2344) THREE BUSINESS DAYS PRIOR TO ANY EXCAVATION.
- 5. EXISTING CONDITIONS BASED ON TOPOGRAPHIC, BOUNDARY, AND UTILITY SURVEY PREPARED BY PLS SURVEYING, PROVIDED AUGUST 2021 AND UPDATED MARCH 2022. EXISTING CONDITIONS ARE ALSO BASED ON GARDEN ACRES CONSTRUCTION PLANS PROVIDED BY PLS SURVEYING.
- 6. THE CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF PRIVATE UTILITIES SUCH AS GAS, TELEPHONE, POWER, CABLE TELEVISION, ETC. CONFIRM VAULT LOCATIONS WITH ARCHITECT.
- THE CONTRACTOR SHALL KEEP THE ARCHITECT AND JURISDICTION INFORMED OF CONSTRUCTION PROGRESS TO FACILITATE SITE OBSERVATIONS AT REQUIRED INTERVALS. 48-HOUR NOTICE IS REQUIRED.
- 8. THE CONTRACTOR SHALL VERIFY AND CONFIRM EXISTING CONDITIONS. EXISTING UTILITIES AND POINTS OF CONNECTION TO EXISTING UTILITIES AND LOCATIONS WHERE NEW UTILITIES WILL CROSS EXISTING UTILITIES SHALL BE VERIFIED BY THE CONTRACTOR BY POTHOLING PRIOR TO CONSTRUCTION OR ORDERING MATERIALS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO SCHEDULE POTHOLING SUCH THAT IF CONFLICTS ARE ENCOUNTERED, SUFFICIENT TIME EXISTS TO PREPARE MODIFIED DESIGNS AND HAVE THE MODIFICATIONS APPROVED BY THE JURISDICTION WITHOUT IMPACTING THE PROJECT SCHEDULE.
- 9. THIS PLAN IS GENERALLY DIAGRAMMATIC. IT DOES NOT SHOW EVERY JOINT, BEND, FITTING, OR ACCESSORY REQUIRED FOR CONSTRUCTION.
- 10. INSTALL CLEANOUTS AT 100' MAX. AND AT ALL LATERALS PER CODE. PROVIDE CLEANOUTS AS REQUIRED BY THE CURRENT OREGON PLUMBING SPECIALTY CODE. NOT ALL REQUIRED CLEANOUTS ARE SHOWN.
- 11. UTILITIES WITHIN TWO FEET OF A BUILDING SHALL BE CONSTRUCTED OF MATERIALS APPROVED FOR INTERIOR USE AS DESCRIBED IN THE CURRENT EDITION OF THE PLUMBING CODE.
- 12. CHANGES IN DIRECTION OF DRAINAGE AND SEWER PIPING SHALL BE MADE BY THE APPROPRIATE USE OF APPROVED FITTINGS AND SHALL BE OF THE ANGLES PRESENTED BY ONE-SIXTEENTH BEND, ONE-EIGHTH BEND, ONE-SIXTH BEND OR OTHER APPROVED FITTINGS OF EQUIVALENT SWEEP.
- 13. IF DEWATERING IS REQUIRED DURING CONSTRUCTION, THE CONTRACTOR SHALL PREPARE A DEWATERING PLAN CONSISTENT WITH CITY OF WILSONVILLE AND CLACKAMAS COUNTY REQUIREMENTS, AND OBTAIN APPROVAL OF THE PLAN FROM BOTH JURISDICTIONS PRIOR TO PROCEEDING WITH DEWATERING.
- 14. THE CONTRACTOR SHALL CLEAN ALL CATCH BASINS AND STORM LINES IMPACTED BY SITE DEVELOPMENT FOLLOWING COMPLETION OF CONSTRUCTION OR AS DIRECTED BY THE CITY OF WILSONVILLE AND CLACKAMAS COUNTY. NO SEDIMENT SHALL BE ALLOWED TO ENTER THE STORM SYSTEM.
- 15. COORDINATE WITH CITY OF WILSONVILLE FOR CONNECTION TO EXISTING PUBLIC WATER MAIN AT THE SW GARDEN ACRES ROAD SITE FRONTAGE. ALL CONNECTIONS TO EXISTING PUBLIC WATER MAIN TO BE BY CITY OF WILSONVILLE APPROVED CONTRACTORS, AS A SUBCONTRACTOR TO THE PROJECT GENERAL CONTRACTOR. CONTRACTOR TO INSTALL PUBLIC MAIN AND HYDRANTS ON SITE TO CITY OF WILSONVILLE PUBLIC WORKS STANDARDS, AVAILABLE FROM THE CITY. INSTALL DOMESTIC METER AND CITY OF WILSONVILLE APPROVED DOMESTIC BACKFLOW PREVENTER ADJACENT TO THE METER. EXTEND SERVICE PIPE TO BUILDING RISER ROOM. SIZE OF DOMESTIC SERVICE, CAPACITY OF METER, BUILDING DOMESTIC WATER DEMAND AND SIZE OF PIPING TO BUILDING IS ASSUMED AND TO BE DETERMINED BY BUILDING PLUMBING DESIGNER PRIOR TO CONSTRUCTION OR ORDERING MATERIAL. CONTRACTOR TO CONFIRM REQUIRED DOMESTIC BACKFLOW PREVENTER TYPE PRIOR TO CONSTRUCTION OR ORDERING MATERIALS; COORDINATE WITH BUILDING PLUMBING DESIGNER. IF REDUCED PRESSURE DOMESTIC BACKFLOW PREVENTER IS REQUIRED BY THE CITY, IT IS TO BE INSTALLED IN ABOVE GRADE HEATED AND INSULATED ENCLOSURE. PROVIDE POWER SOURCE FROM BUILDING FOR ENCLOSURE, COORDINATE WITH PROJECT ELECTRICAL DESIGNER FOR DEDICATED CIRCUIT FOR ENCLOSURE. CONTRACTOR TO DETERMINE IF REMOTE METER READER IS REQUIRED AND PROVIDE AS DIRECTED BY CITY OF WILSONVILLE. IRRIGATION METER SIZE IS BY THE GENERAL CONTRACTOR'S DESIGN-BUILD LANDSCAPE IRRIGATION SUBCONTRACTOR, BASED ON THEIR DEMAND CALCULATIONS. SEE LANDSCAPE PLANS FOR ADDITIONAL IRRIGATION SYSTEM INFORMATION. NO CONNECTIONS MAY OCCUR BETWEEN DOMESTIC METER AND BACKFLOW PREVENTER. PROVIDE MINIMUM 36" OF COVER OVER ALL DOMESTIC WATER PIPING.
- 16. FIRE DCDA TO SERVE BUILDING TO BE INSTALLED IN PUBLIC UTILITY EASEMENT WITH SIZE TO BE DETERMINED BY CONTRACTOR IN CONSULTATION WITH BUILDING FIRE SYSTEM DESIGNER. FIRE LINE PIPE SIZE, HYDRANT PIPE SIZE, AND DCDA SIZE IS ASSUMED AND TO BE DETERMINED BY BUILDING FIRE SYSTEM DESIGNER BASED ON THEIR FLOW TESTING. ALL PUBLIC WATER SYSTEM COMPONENTS TO BE FULLY MECHANICALLY RESTRAINED AND INSTALLATION AND MATERIAL TO BE IN CONFORMANCE WITH THE CURRENT CITY OF WILSONVILLE PUBLIC WORKS STANDARDS, AVAILABLE FROM THE CITY. SITE FIRE PIPING AND FDC PIPING TO BE FULLY MECHANICALLY RESTRAINED WITH PRODUCTS APPROVED BY THE CITY OF WILSONVILLE. PROVIDE A MINIMUM OF 36" OF COVER OVER ALL PUBLIC WATER SYSTEM PIPE AND FITTINGS AND OVER ALL PRIVATE SITE FIRE AND FDC PIPING. NOTE, ADDITIONAL RISERS MAY BE REQUIRED FOR DCDA VAULT TO ALLOW PIPE COVER TO BE ACHIEVED. CONTRACTOR TO PROVIDE SEPARATE DEDICATED ELECTRICAL CIRCUIT FOR VAULT SUMP PUMP, IF PUMP IS REQUIRED BY CITY.
- 17. INSTALL AUTOMATIC DRAIN VALVE IN VAULT AT LOW POINT OF FDC LINE. PROVIDE DRAINAGE FROM VAULT TO CITY OF WILSONVILLE APPROVED LOCATION. SIZE OF FDC PIPE IS ASSUMED AND TO BE DETERMINED BY BUILDING FIRE SYSTEM DESIGNER. FDC TO CONFORM TO REQUIREMENTS OF CITY OF WILSONVILLE FIRE DEPARTMENT. PROVIDE MINIMUM OF 36" OF COVER OVER FDC PIPING.
- 18. PUBLIC WATER AND FIRE LINE, FITTINGS, VALVES, HYDRANTS, AND COMPONENTS TO CONFORM TO THE REQUIREMENTS OF CITY OF WILSONVILLE AND BE FULLY MECHANICALLY RESTRAINED. FIRE PIPING TO BE PVC ASTM C 900, FITTINGS AND ACCESSORIES TO BE COMPLIANT. HYDRANTS TO ALSO CONFORM TO REQUIREMENTS OF CITY OF WILSONVILLE FIRE DEPARTMENT.
- 19. BUILDING SANITARY PIPE SIZE IS ASSUMED AND TO BE CONFIRMED BY BUILDING PLUMBING DESIGNER BASED ON THEIR CALCULATION OF DESIGN FIXTURE DISCHARGE. PIPE TO BE PVC ASTM 3034, SDR 35. SEE BUILDING PLUMBING PLANS FOR SANITARY CONTINUATION WITHIN BUILDING.
- 20. CONTRACTOR TO CONNECT THE ON-SITE SANITARY SEWER PIPE SYSTEM TO EXISTING PUBLIC SANITARY SEWER SERVICE LATERAL IN CONFORMANCE WITH CITY OF WILSONVILLE REQUIREMENTS. CONTRACTOR TO CONNECT SEPARATE SANITARY PIPE FOR FUTURE EASTERN LOT DEVELOPMENT WITH A SEPARATE CONNECTION TO THE PUBLIC SANITARY MAIN IN GARDEN ACRES ROAD. CONNECTION TO CONFORM TO CITY OF WILSONVILLE PUBLIC WORKS STANDARDS AND MAY REQUIRE A SEPARATE PERMIT. CONTRACTOR TO COORDINATE PERMIT ACQUISITION WITH CITY OF WILSONVILLE. CONTRACTOR TO CONFIRM SITE SERVICE LATERAL EXISTS AND DETERMINE DEPTH BY POTHOLING PRIOR TO CONSTRUCTION OF ANY PORTION OF THE ON-SITE SANITARY SYSTEM AND PRIOR TO ORDERING MATERIALS.
- 21. CONTRACTOR TO CONNECT ON-SITE STORM DISCHARGE FROM PLANTERS, RAIN GARDENS, AND STORM PIPE FROM FUTURE EASTERN LOT DEVELOPMENT TO EXISTING PUBLIC SITE SERVICE LATERAL IN CONFORMANCE WITH CITY OF WILSONVILLE REQUIREMENTS. DEPTH AND SIZE OF EXISTING PUBLIC LATERAL IS ASSUMED AND TO BE CONFIRMED BY THE CONTRACTOR BY POTHOLING PRIOR TO COMMENCING ANY STORM SYSTEM CONSTRUCTION OR ORDERING MATERIALS. COORDINATE WITH CITY OF WILSONVILLE STAFF PRIOR TO ANY WORK ON PUBLIC SYSTEM OR WITHIN PUBLIC RIGHT OF WAY.
- 22. PRIVATE STORM SYSTEM OUTSIDE OF BUILDING TO BE EITHER PVC ASTM 3034, SDR 35, POLYETHYLENE, ASTM F 405, OR HDPE AASHTO M 294. PIPE TO BE DUCTILE IRON, CLASS 52 WHEN COVER IS LESS THAN 18".

GENERAL GRADING NOTES

- 1. ALL WORK SHALL CONFORM TO THE REC GEOTECHNICAL INVESTIGATION.
- 2. THE CONTRACTOR SHALL HAVE A FULL SET OF THE CURRENT APPROVED CONSTRUCTION DOCUMENTS, INCLUDING ADDENDA ON THE PROJECT SITE AT ALL TIMES.
- 3. THE CONTRACTOR SHALL NOTIFY THE OREGON UTILITY NOTIFICATION CENTER (800 332 2344) THREE BUSINESS DAYS PRIOR TO ANY EXCAVATION.
- 4. THE CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF PRIVATE UTILITIES SUCH AS GAS, TELEPHONE, POWER, DATA, ETC. CONFIRM VAULT LOCATIONS WITH THE ARCHITECT.
- 5. THE CONTRACTOR SHALL KEEP THE ARCHITECT AND JURISDICTION INFORMED OF CONSTRUCTION PROGRESS TO FACILITATE SITE OBSERVATIONS AT REQUIRED INTERVALS. 48-HOUR NOTICE IS REQUIRED.
- 6. EXISTING CONDITIONS BASED ON TOPOGRAPHIC, BOUNDARY, AND UTILITY SURVEY PREPARED BY PLS SURVEYING, PROVIDED AUGUST 2021 AND UPDATED MARCH 2022. EXISTING CONDITIONS ARE ALSO BASED ON GARDEN ACRES CONSTRUCTION PLANS PROVIDED BY PLS SURVEYING.
- 7. FINISHED GRADES ARE TO BE BROUGHT TO WITHIN 0.08 FT. IN 10 FT. OF THE GRADES SHOWN AT SUBGRADE AND TO WITHIN 0.03 FT. IN 10 FT. AT FINISH GRADE. CONTRACTOR TO ALLOW FOR PLACEMENT OF REQUIRED TOPSOIL AND PLANTINGS IN ROUGH GRADING. DISTURBED AREAS NOT INDICATED FOR PLANTING ON THE LANDSCAPE DRAWINGS ARE TO BE SEEDED WITH FIELD GRASS, COORDINATE WITH ARCHITECT AND LANDSCAPE ARCHITECT FOR SPECIFIC INFORMATION.
- 8. GRADING ELEVATIONS AS SHOWN ON PLANS ARE FINISHED GRADE, WHICH INCLUDES PAVING, BASE ROCK, AND SUBGRADE SOIL. GENERAL CONTRACTOR IS RESPONSIBLE TO COORDINATE GRADING WITH BOTH EXCAVATOR AND PAVING CONTRACTOR.
- 9. SEE PROJECT GEOTECHNICAL ANALYSIS FOR ASPHALT AND CONCRETE PAVING AND BASE ROCK THICKNESS AND FOR EXCAVATION, FILL, AND COMPACTION REQUIREMENTS. STORM FACILITY ACCESS ROAD TO BE GRAVEL SURFACED. GRAVEL SECTION TO BE AS INDICATED IN SUPPLEMENT TO PROJECT GEOTECHNICAL ANALYSIS (8" OF 1.5"-0" COMPACTED CRUSHED AGGREGATE ON PROPEX GRIDPRO BXP 12 GEOGRID ON COMPACTED SUBGRADE) AND SATISFIES CRITERIA FOR AN ALL-WEATHER STORM TREATMENT/FLOW CONTROL FACILITY MAINTENANCE ACCESS CAPABLE OF SUPPORTING A 30 TON MAINTENANCE VEHICLE.
- 10. MODULAR BLOCK RETAINING WALLS TO BE CONTRACTOR DESIGN-BUILD, INCLUDING ANY FENCING/FENCE ATTACHMENTS, OR GUARD RAILS. RETAINING WALLS AT TREATMENT/FLOW CONTROL PLANTERS MAY BE EITHER CONTRACTOR DESIGN-BUILD MODULAR BLOCK OR CAST IN PLACE; CONTRACTOR TO COORDINATE WITH STRUCTURAL ENGINEER FOR DESIGN IF CAST IN PLACE. COORDINATE DESIGN AND LOCATION OF ANY REQUIRED FENCING OR GUARD RAILS WITH ARCHITECT. PROVIDE GATES IN FENCING TO ACCESS TO FACILITIES FOR MAINTENANCE/INSPECTION. SEE ARCHITECTURAL PLANS FOR INFORMATION ON FENCING AND GATES.
- 11. SEE LANDSCAPE PLANS FOR PLANTING IN RAIN GARDENS AND PLANTERS, PLANTING TO COMPLY WITH CITY OF WILSONVILLE STANDARDS FOR RAIN GARDENS AND PLANTERS.
- 12. IF DEWATERING IS REQUIRED DURING CONSTRUCTION, THE CONTRACTOR SHALL PREPARE A DEWATERING PLAN CONSISTENT WITH CITY OF WILSONVILLE AND CLACKAMAS COUNTY REQUIREMENTS, AND OBTAIN APPROVAL OF THE PLAN FROM BOTH JURISDICTIONS PRIOR TO PROCEEDING WITH DEWATERING.
- 13. THE CONTRACTOR SHALL CLEAN ALL CATCH BASINS AND STORM LINES IMPACTED BY SITE DEVELOPMENT FOLLOWING COMPLETION OF CONSTRUCTION OR AS DIRECTED BY THE CITY OF WILSONVILLE AND CLACKAMAS COUNTY. NO SEDIMENT SHALL BE ALLOWED TO ENTER NEW OR EXISTING INLETS OR OTHER STORM FACILITIES.

1. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE JURISDICTION AND THE PROJECT

CIVIL SHEET INDEX

- CO GENERAL NOTES & LEGEND
- C1 EXISTING CONDITIONS PLAN C1.1 EXISTING CONDITIONS PLAN
- C2 GRADING PLAN
- C2.1 GRADING PLAN
- C3 STORMWATER PLAN
- C3.1 STORMWATER PLAN C4 WATER & SANITARY
- C4 WATER & SANITARY SEWER PLAN C4.1 WATER & SANITARY SEWER PLAN
- C5 DETAILS
- C5.1 DETAILS
- C5.2 DETAILS

LEGEND

	PROPOSED	EXISTING
PROJECT BOUNDARY		
PROPERTY LINE		
EASEMENT LINE		
FENCE		— x — x —
CURB		
EDGE OF PAVEMENT		/// ///
CONCRETE		
1' CONTOUR	221	221
5' CONTOUR	220	<u> </u>
STORM SEWER LINE	SD	STM
WATER LINE	———— W ————	WAT
SANITARY SEWER LINE	SS	SAN
GAS LINE		GAS
OVERHEAD UTILITY WIRE		OHW
UNDERGROUND POWER LINE		
COMMUNICATION LINE		COM
EXISTING FEATURE OR CONDITION		(E)
CATCH BASIN	СВ	
TOP OF CURB	TC	
GUTTER	G	
ASPHALT CONCRETE	AC	
CONCRETE	CONC	
SIDEWALK	WALK	
BACKFLOW PREVENTER	BFP	
PERFORATED PIPE	PERF	
TOP OF STEP	TS	
BOTTOM OF STEP	BS	
TOP OF WALL	TW	
BOTTOM OF WALL AT FINISHED GRADE	BW	
FINISHED GRADE	FG	
FOOTING	FTG	
BACKFLOW PREVENTER	BFP	
WATER SURFACE ELEVATION	WSE	
GROWING MEDIUM	GM	
ВОТТОМ	BOT	
GENERAL GRADING NOTES	GGN	
GENERAL UTILITY NOTES	GUN	





CONSULTIN& ENGINEERS 7650 SW Beveland, Suite 100 Tigard, Oregon 97223 Phone: (503) 443-3900 Fax: (503) 443-3700

Client/ Owner

Project:

Precision Countertops

25540 SW Garden Acres Rd. Wilsonville OR

Sheet Title:

General Notes & Legend

Revisions: # Description


Date


MILDREN DESIGN GROUP, P.C ALL RIGHTS RESERVED © 202

THESE DRAWINGS ARE THE PROPERTY OF MILDREN DESIGN GROUP, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MILDREN DESIGN GROUP, P.C.			
Date:	2023-02-07		
Drawn by:	Checked by:		
AS	KJK		
TMR Job Number:	21279		
Sheet			

DESIGN REVIEW SET - FEBRUARY 2023

C0

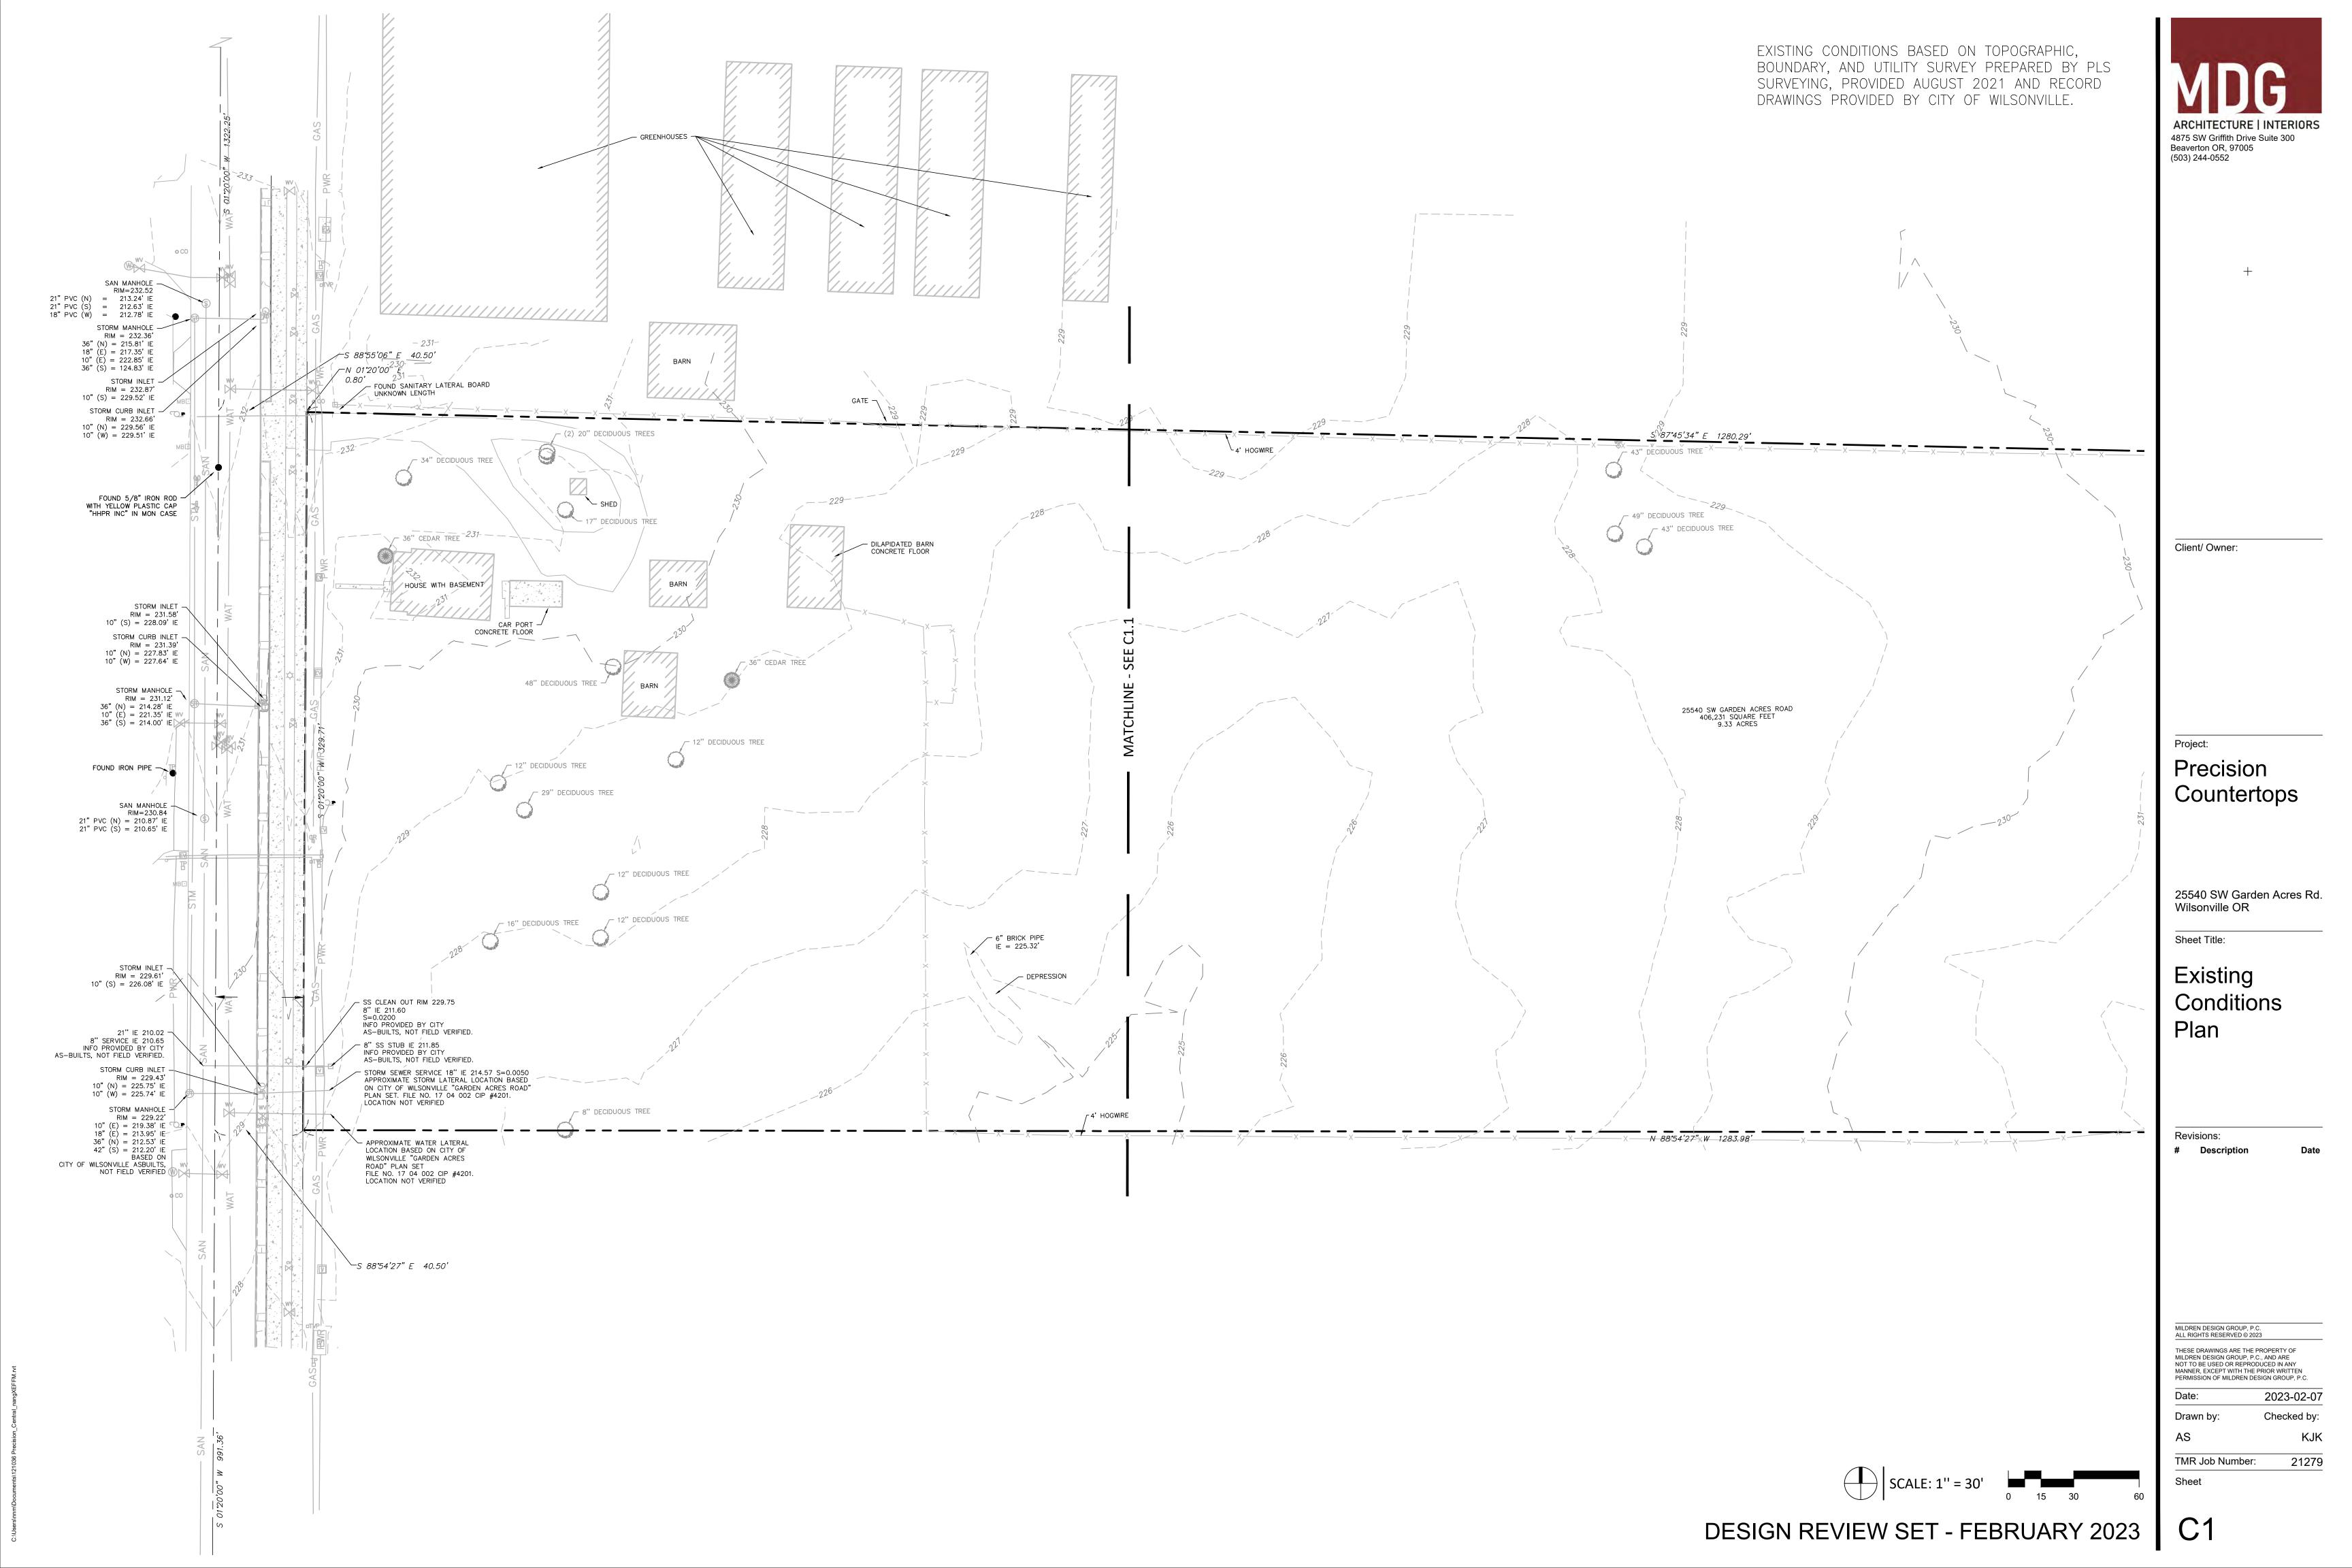

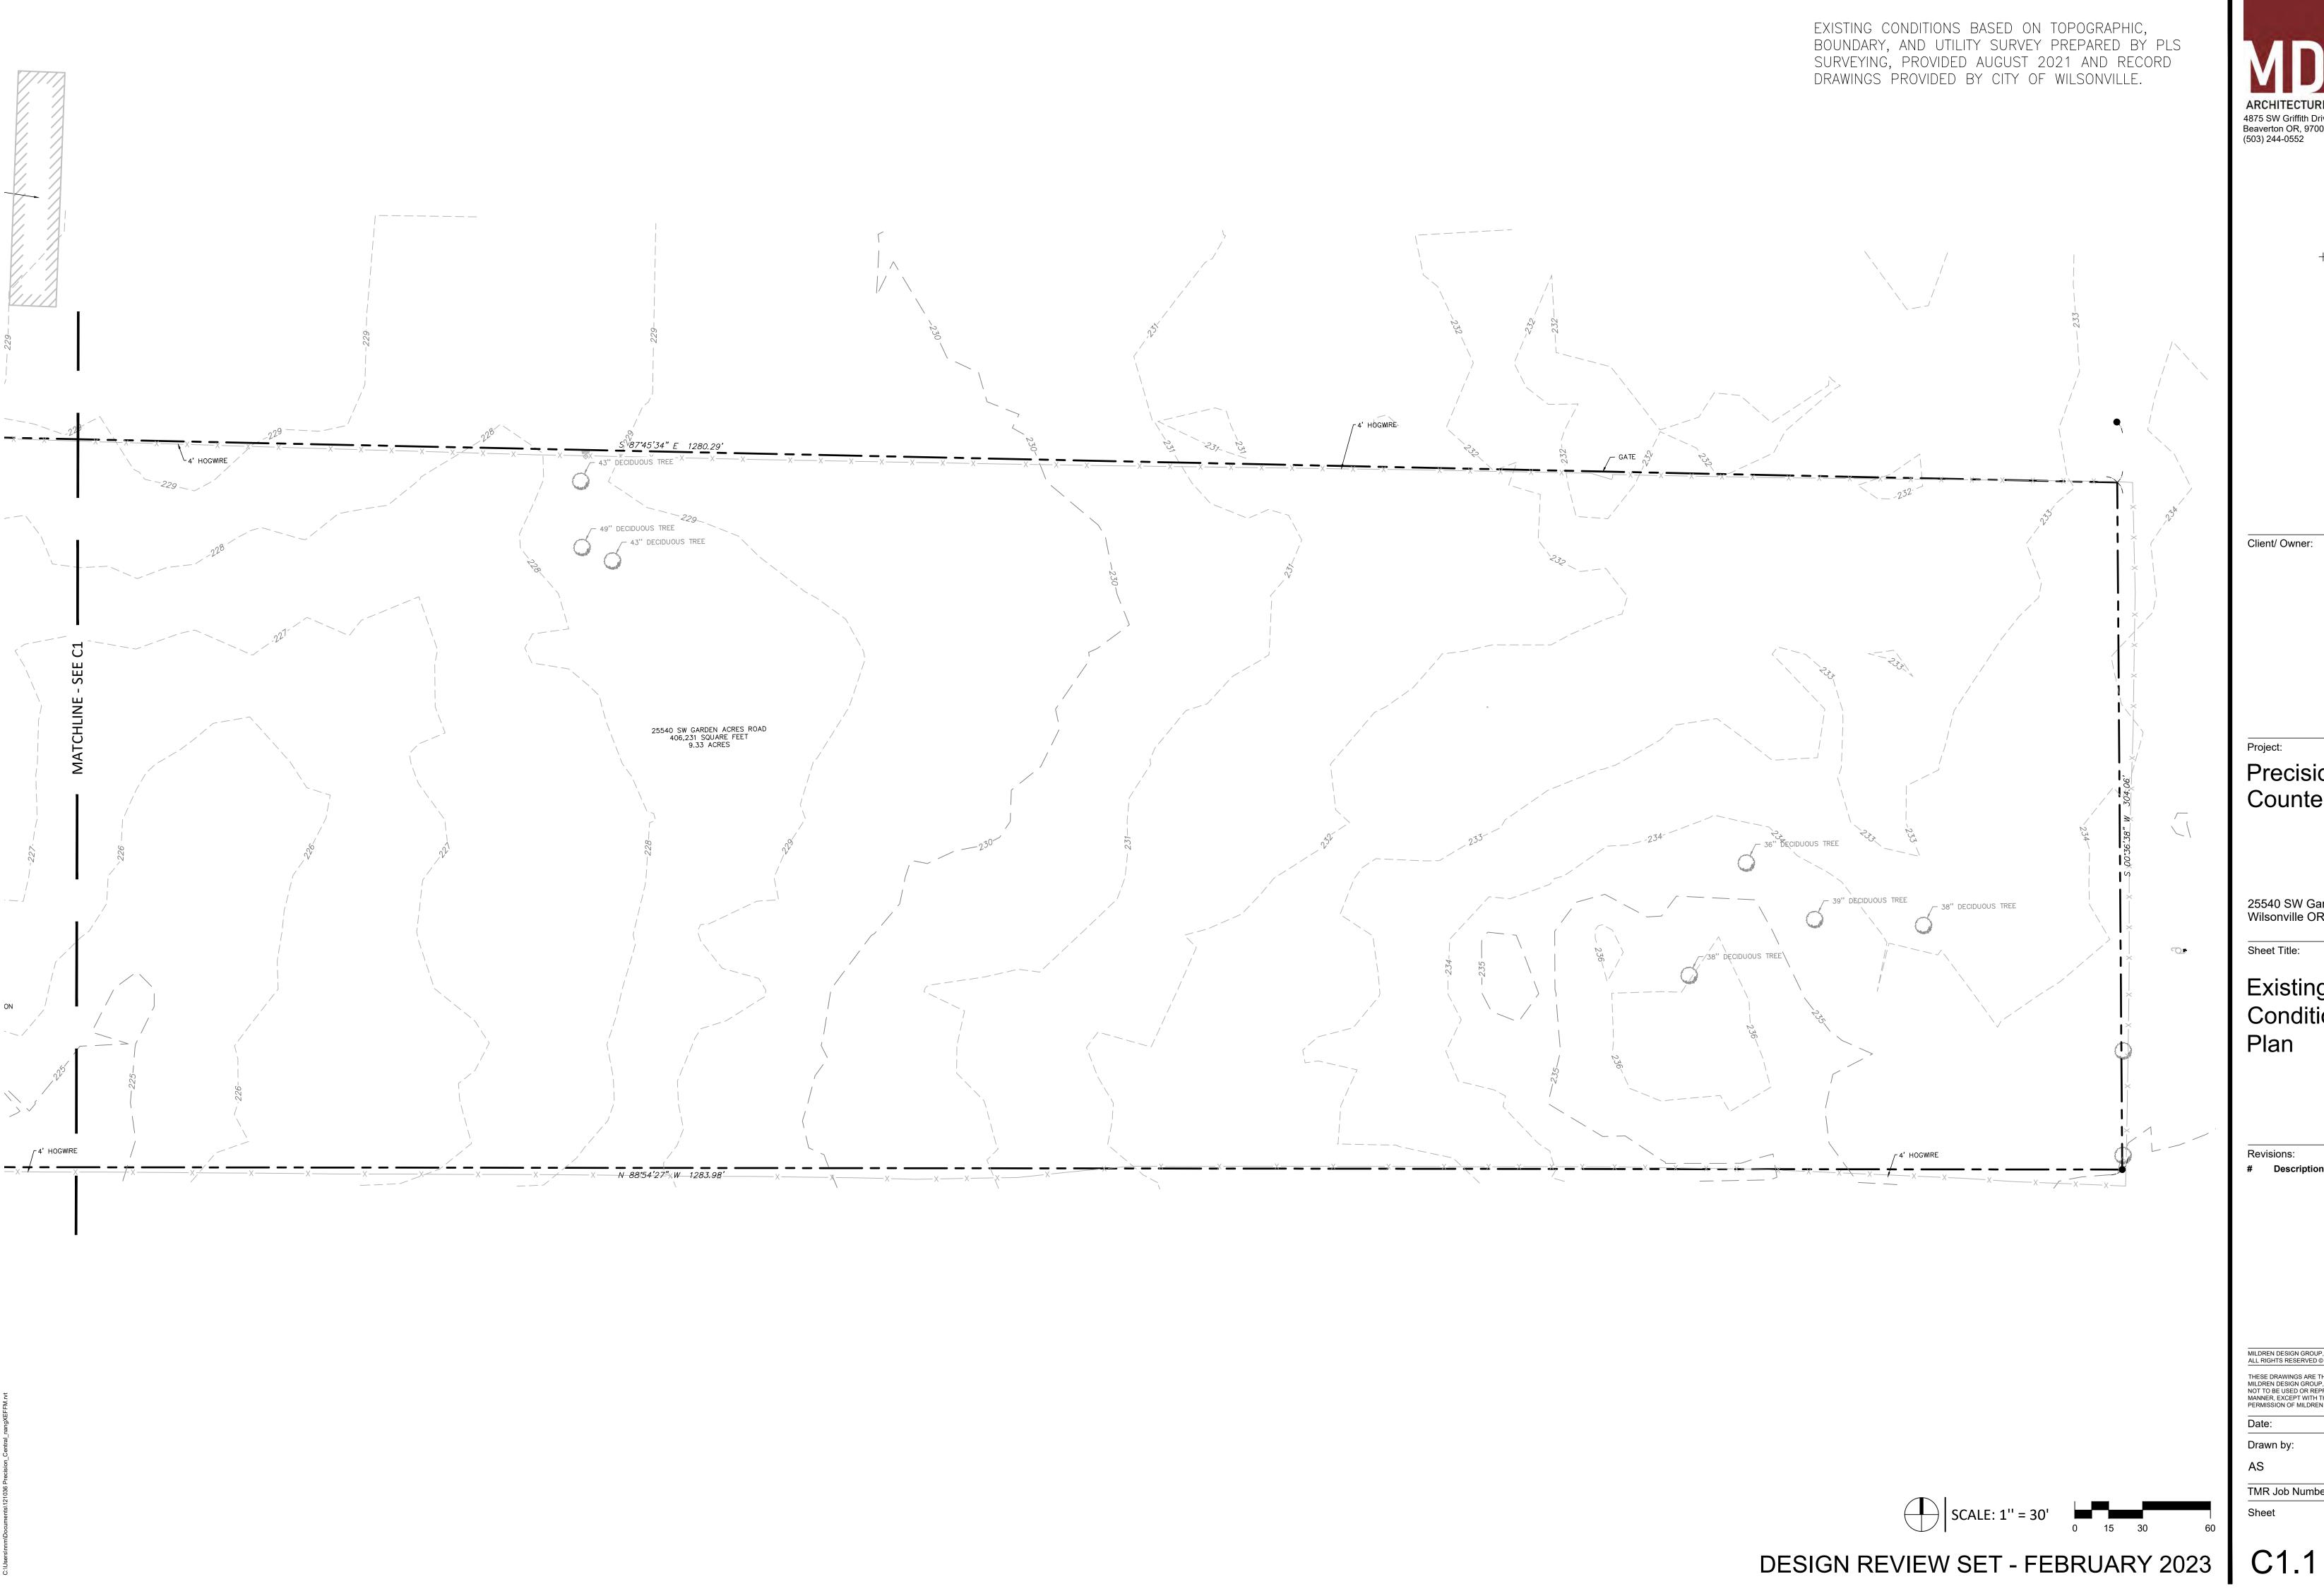

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552

Client/ Owner:

Project: Precision Countertops

25540 SW Garden Acres Rd. Wilsonville OR

Sheet Title:


Existing Conditions Plan


Revisions: # Description

Date

MILDREN DESIGN GROUP, P.C. ALL RIGHTS RESERVED © 2023

THESE DRAWINGS ARE THE PROPERTY OF MILDREN DESIGN GROUP, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MILDREN DESIGN GROUP, P.C.				
Date:	2023-02-07			
Drawn by:	Checked by:			
AS	KJK			
TMR Job Number:	21279			
Sheet				

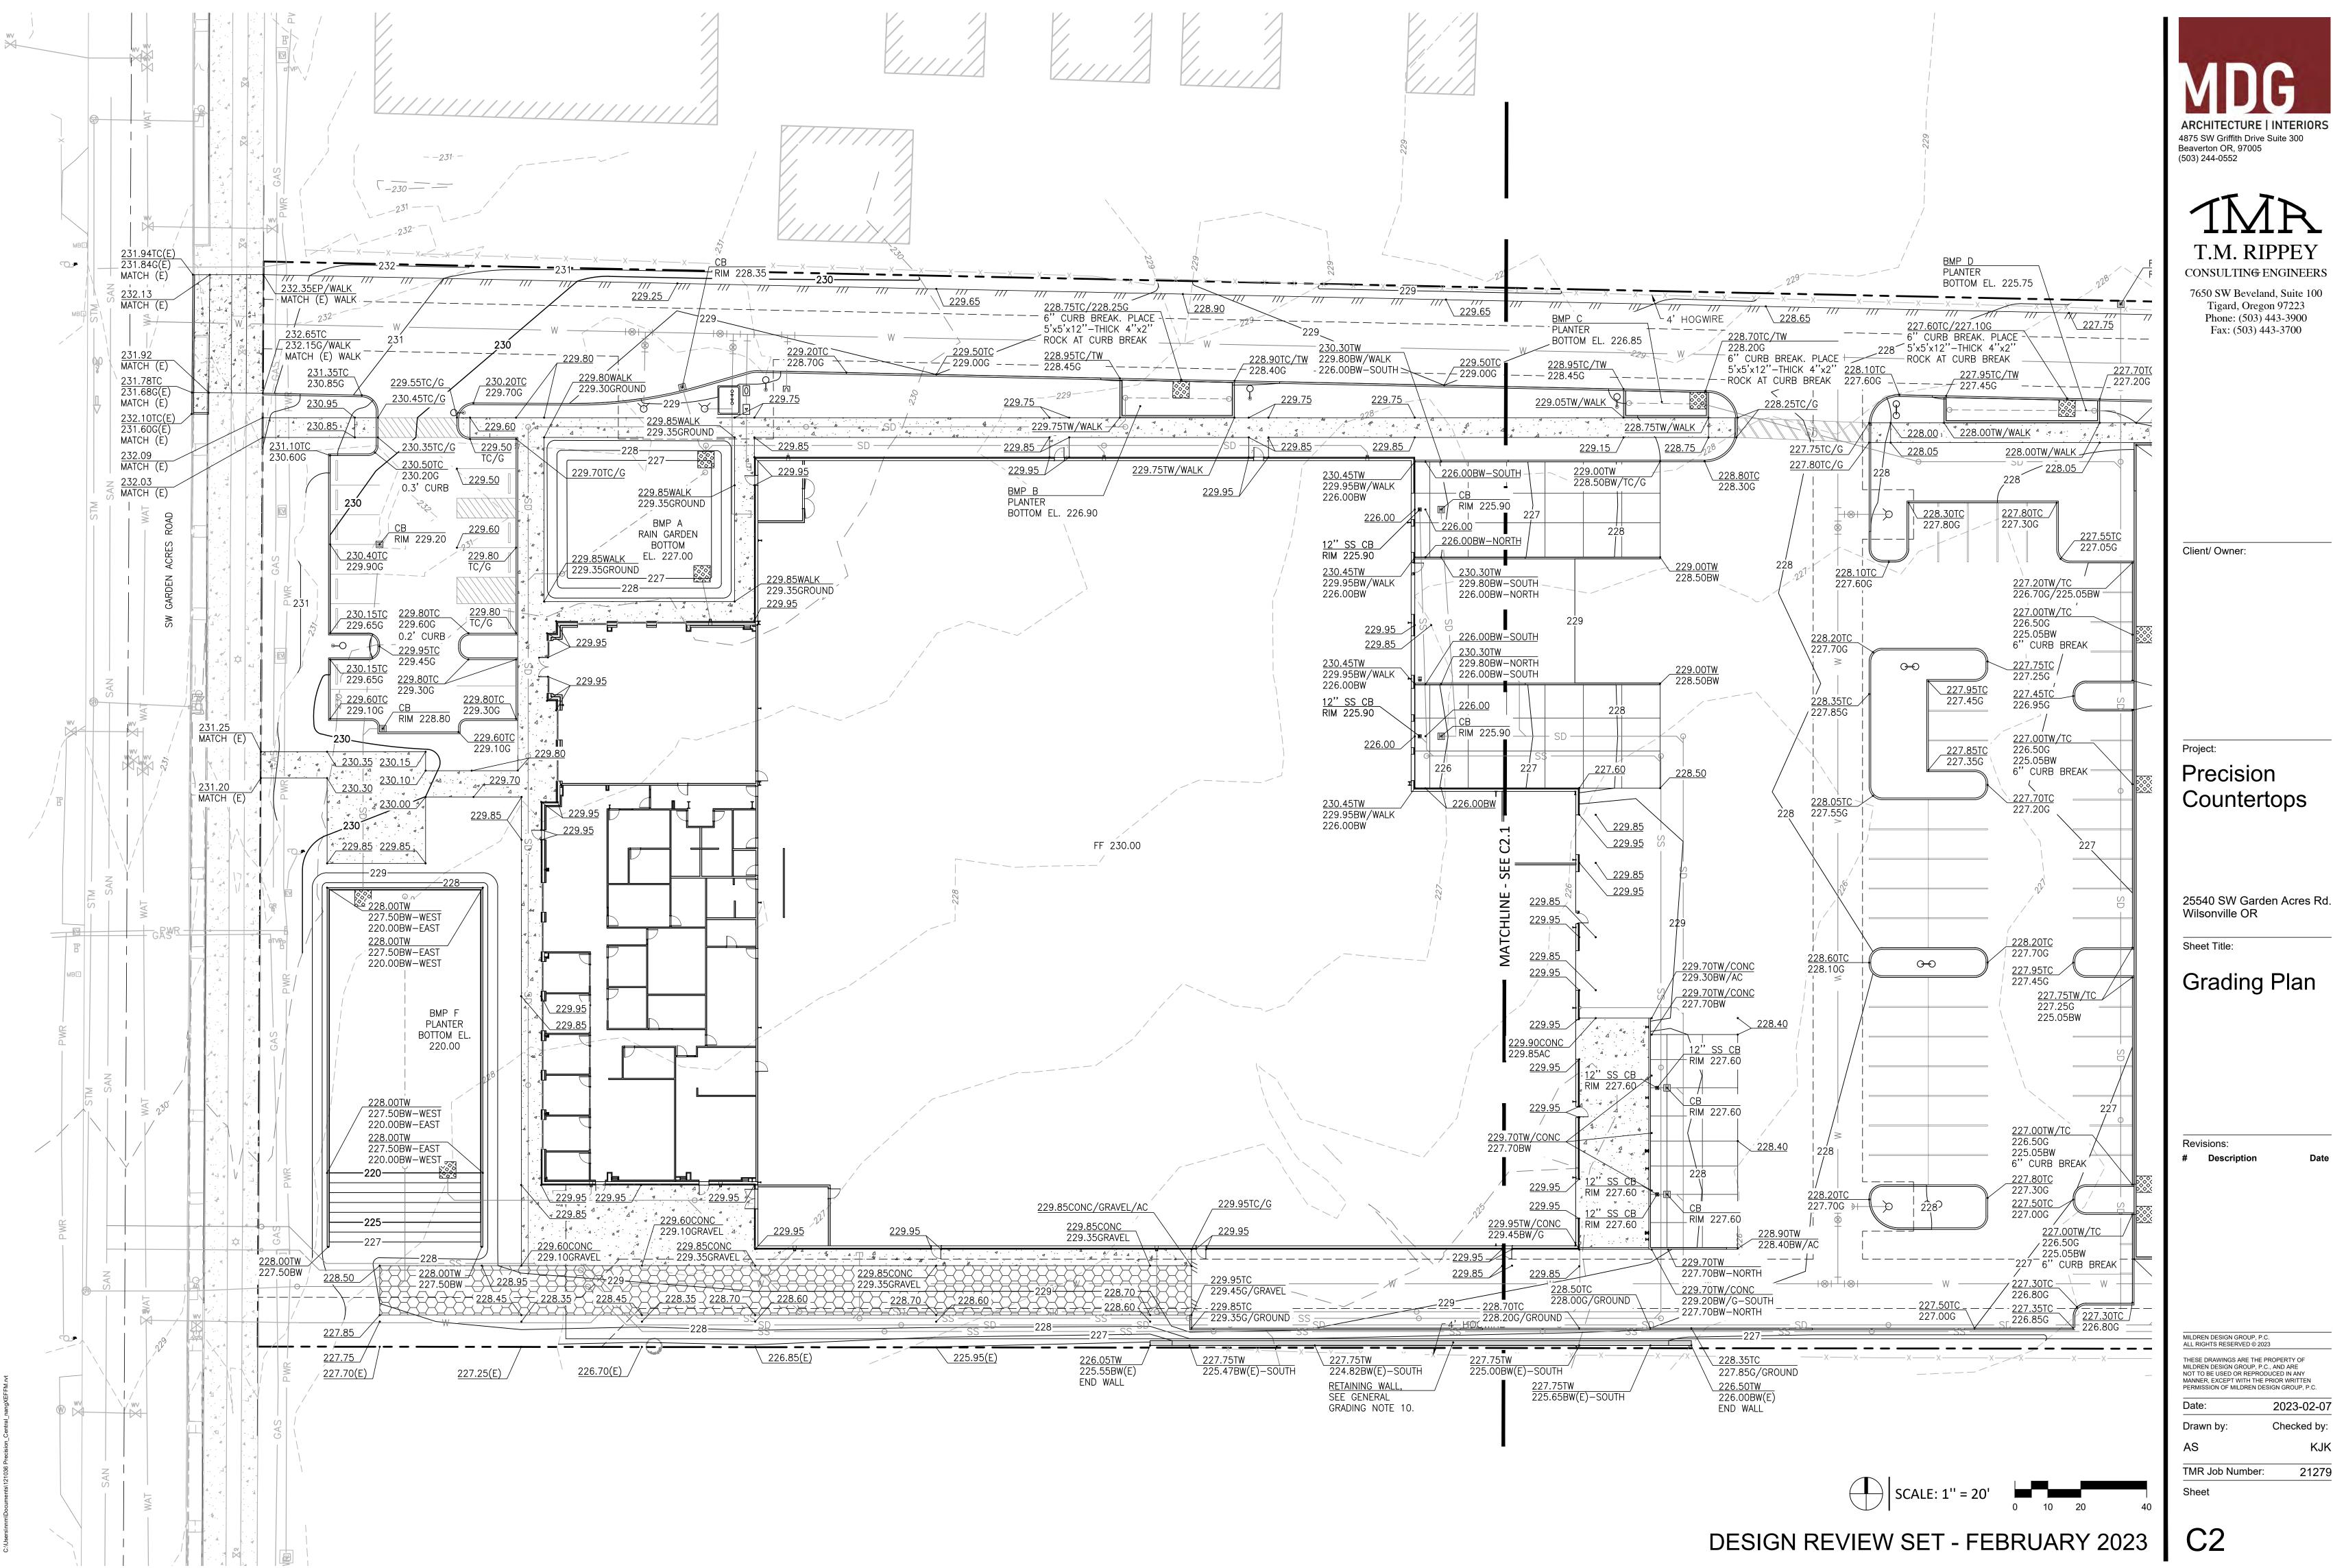

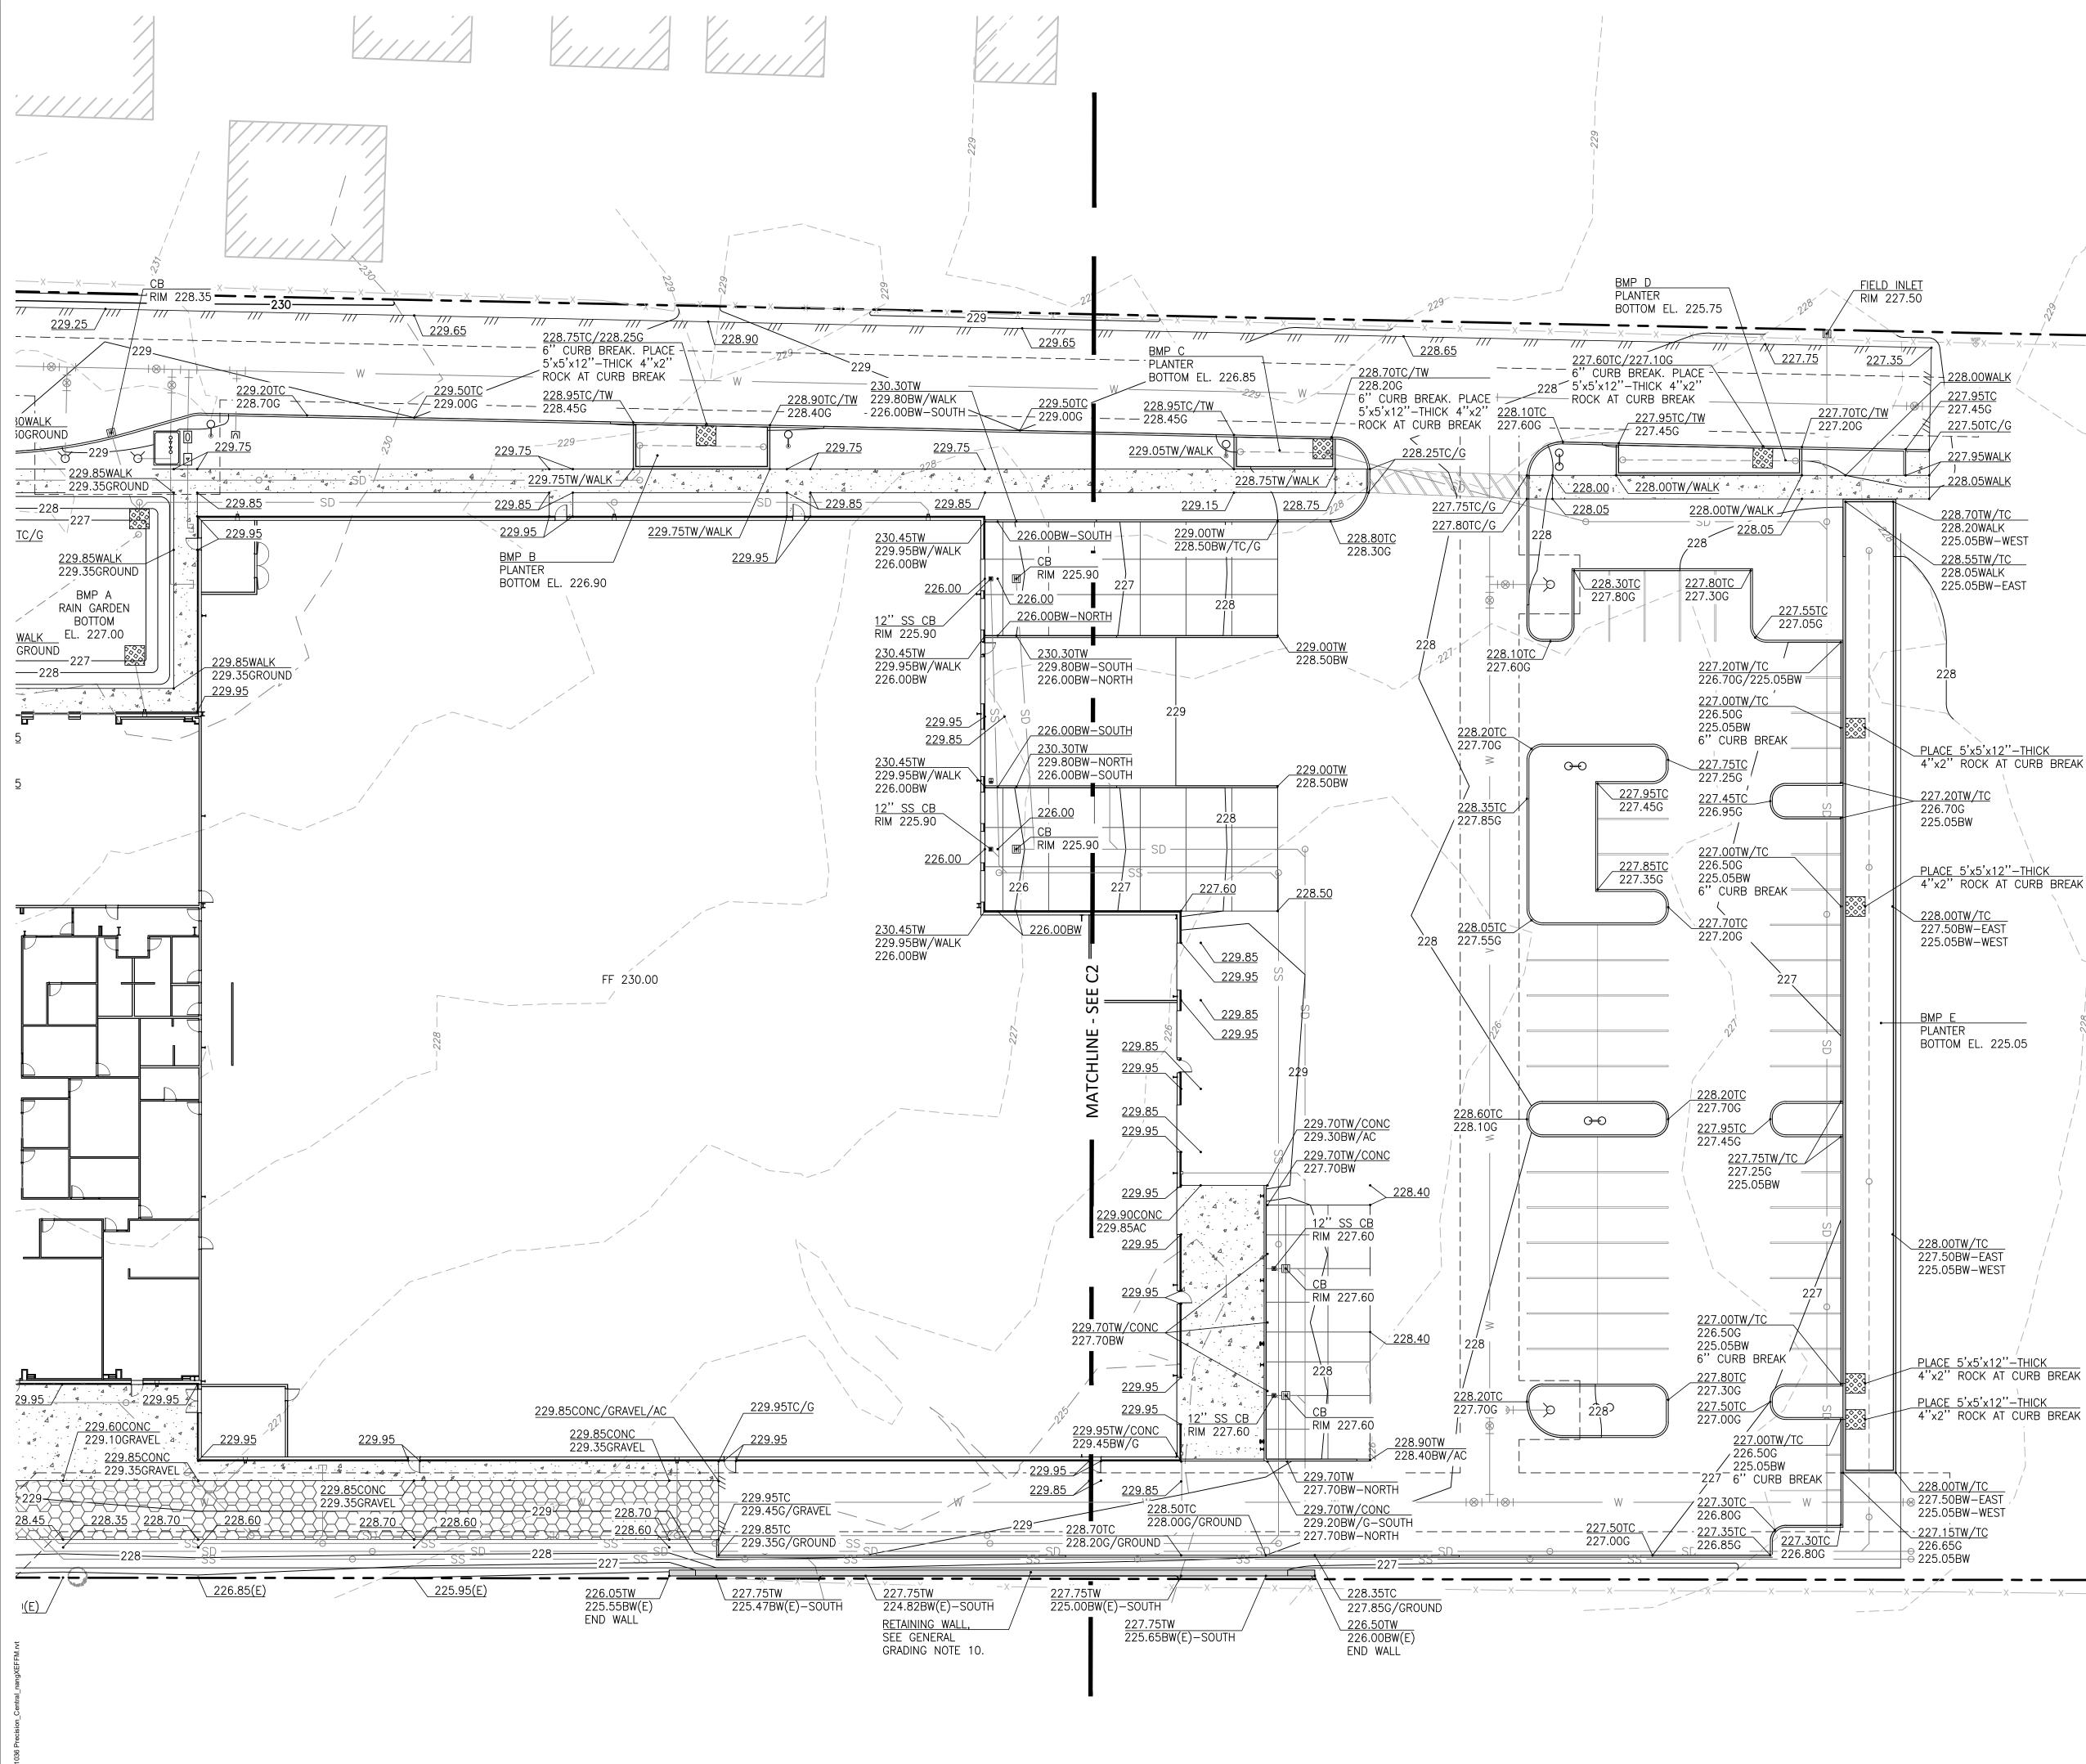

DESIGN REVIEW SET - FEBRUARY 2023

SCALE: 1'' = 20'

C2.1

ALL RIGHTS RESERVED © 2023				
THESE DRAWINGS ARE THE PROPERTY OF MILDREN DESIGN GROUP, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MILDREN DESIGN GROUP, P.C.				
Date:	2023-02-07			
Drawn by:	Checked by:			
AS	KJK			
TMR Job Number:	21279			
Sheet				

MILDREN DESIGN GROUP, P.C

Revisions: # Description

Grading Plan


Sheet Title:

25540 SW Garden Acres Rd. Wilsonville OR

Project: Precision Countertops

Client/ Owner

Tigard, Oregon 97223 Phone: (503) 443-3900 Fax: (503) 443-3700




CONSULTING ENGINEERS


7650 SW Beveland, Suite 100

- X _____ X _____ V _____ v

4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552

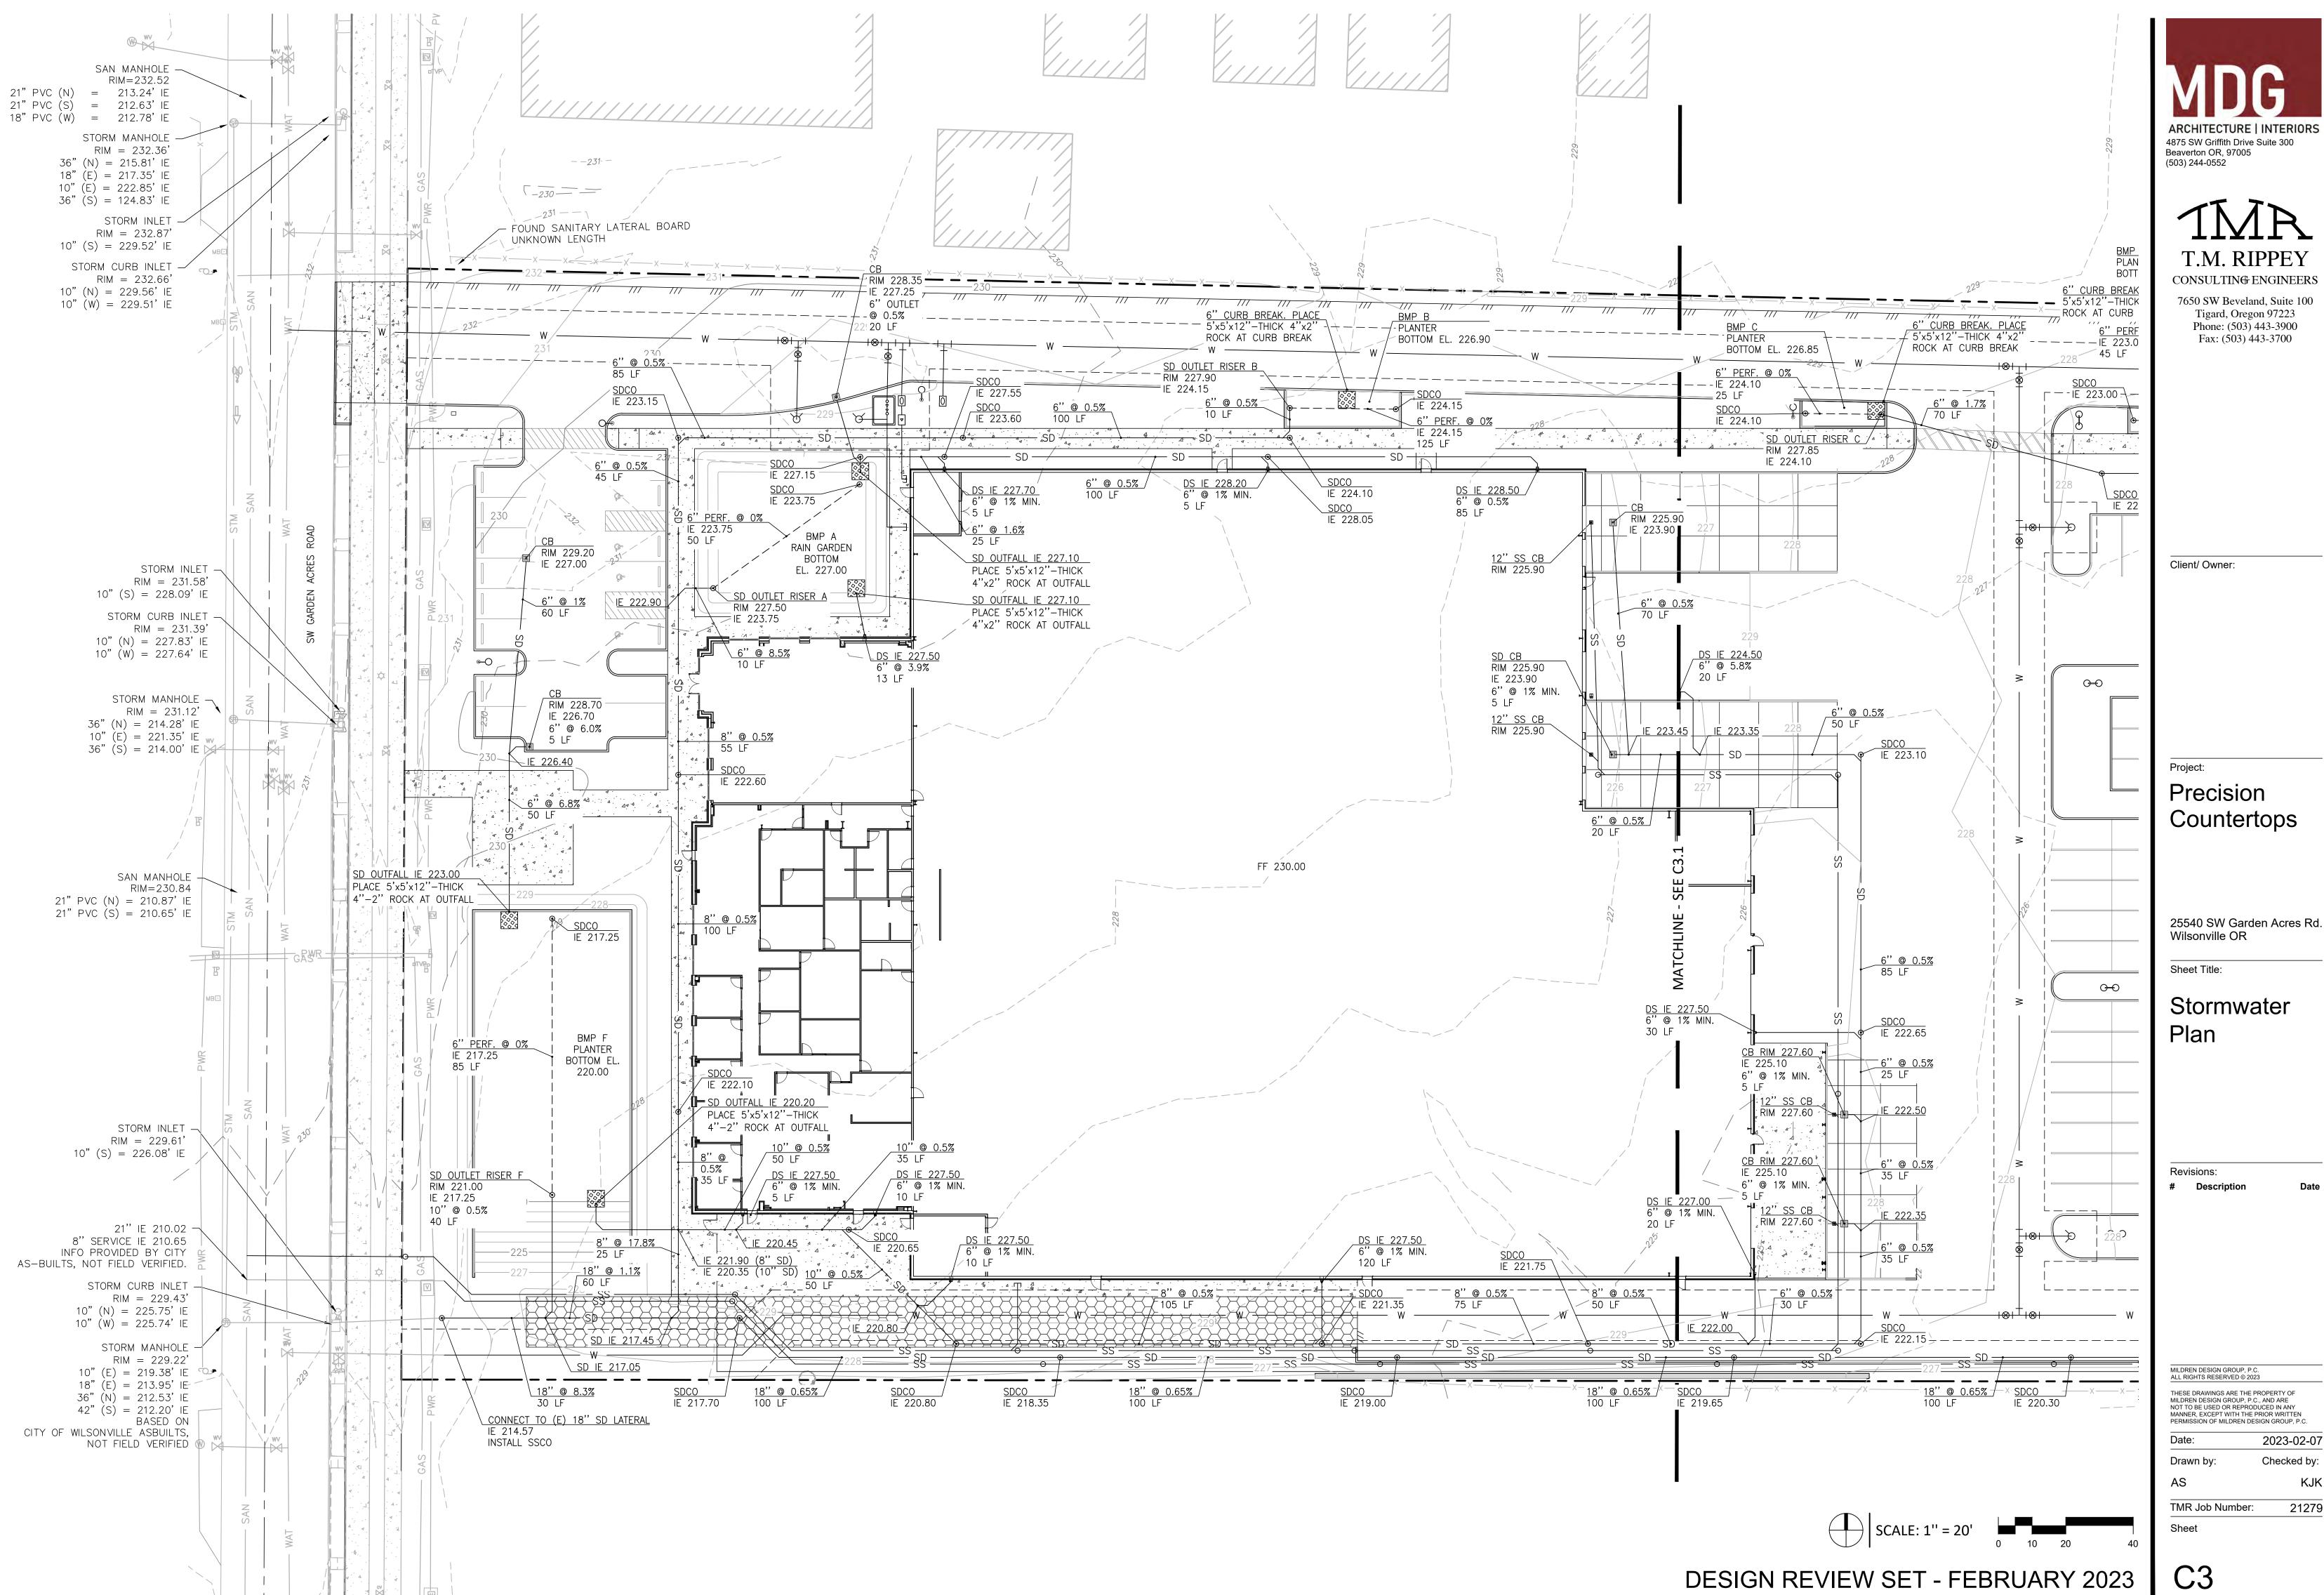


Date

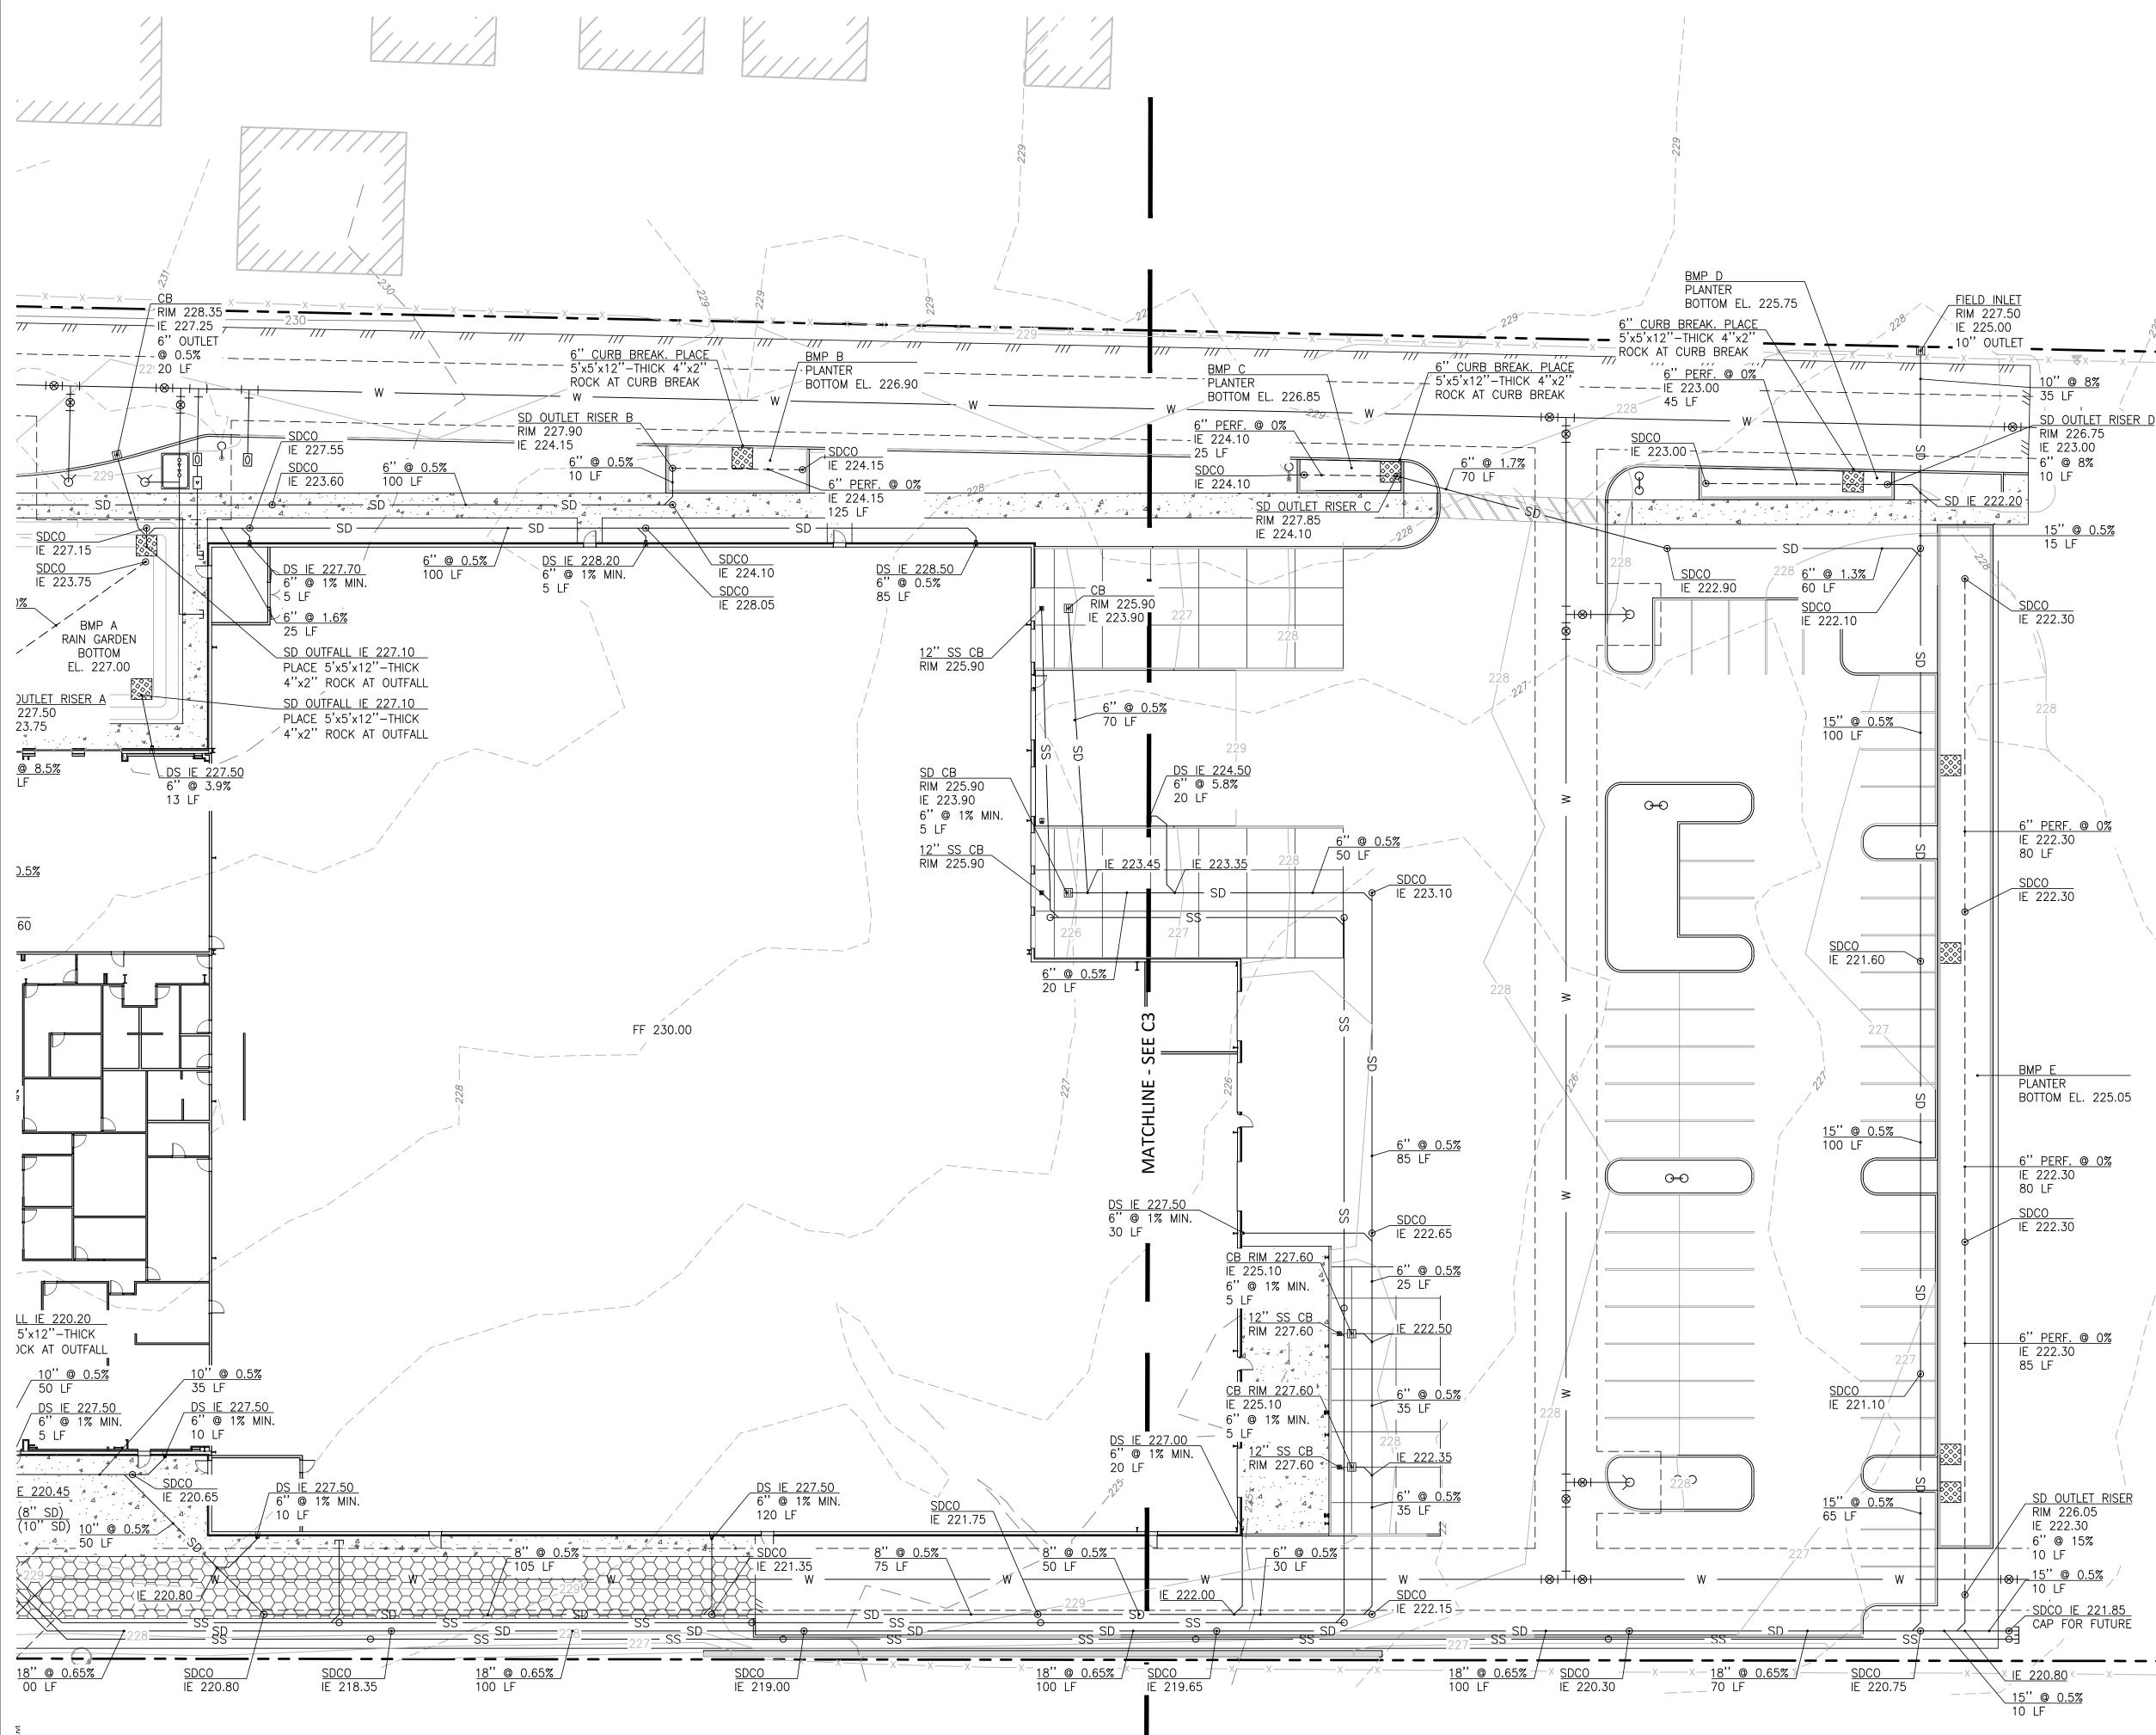

∋rs\nnm\Documents\121

DESIGN REVIEW SET - FEBRUARY 2023





MILDREN DESIGN GROUP, P.C. ALL RIGHTS RESERVED © 2023

C3.1

Revisions: # Description Date

Plan


Stormwater

Sheet Title:

25540 SW Garden Acres Rd. Wilsonville OR


Project: Precision Countertops

Client/ Owner:



I.M. KIPPE Y CONSULTIN& ENGINEERS 7650 SW Beveland, Suite 100 Tigard, Oregon 97223 Phone: (503) 443-3900 Fax: (503) 443-3700

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552

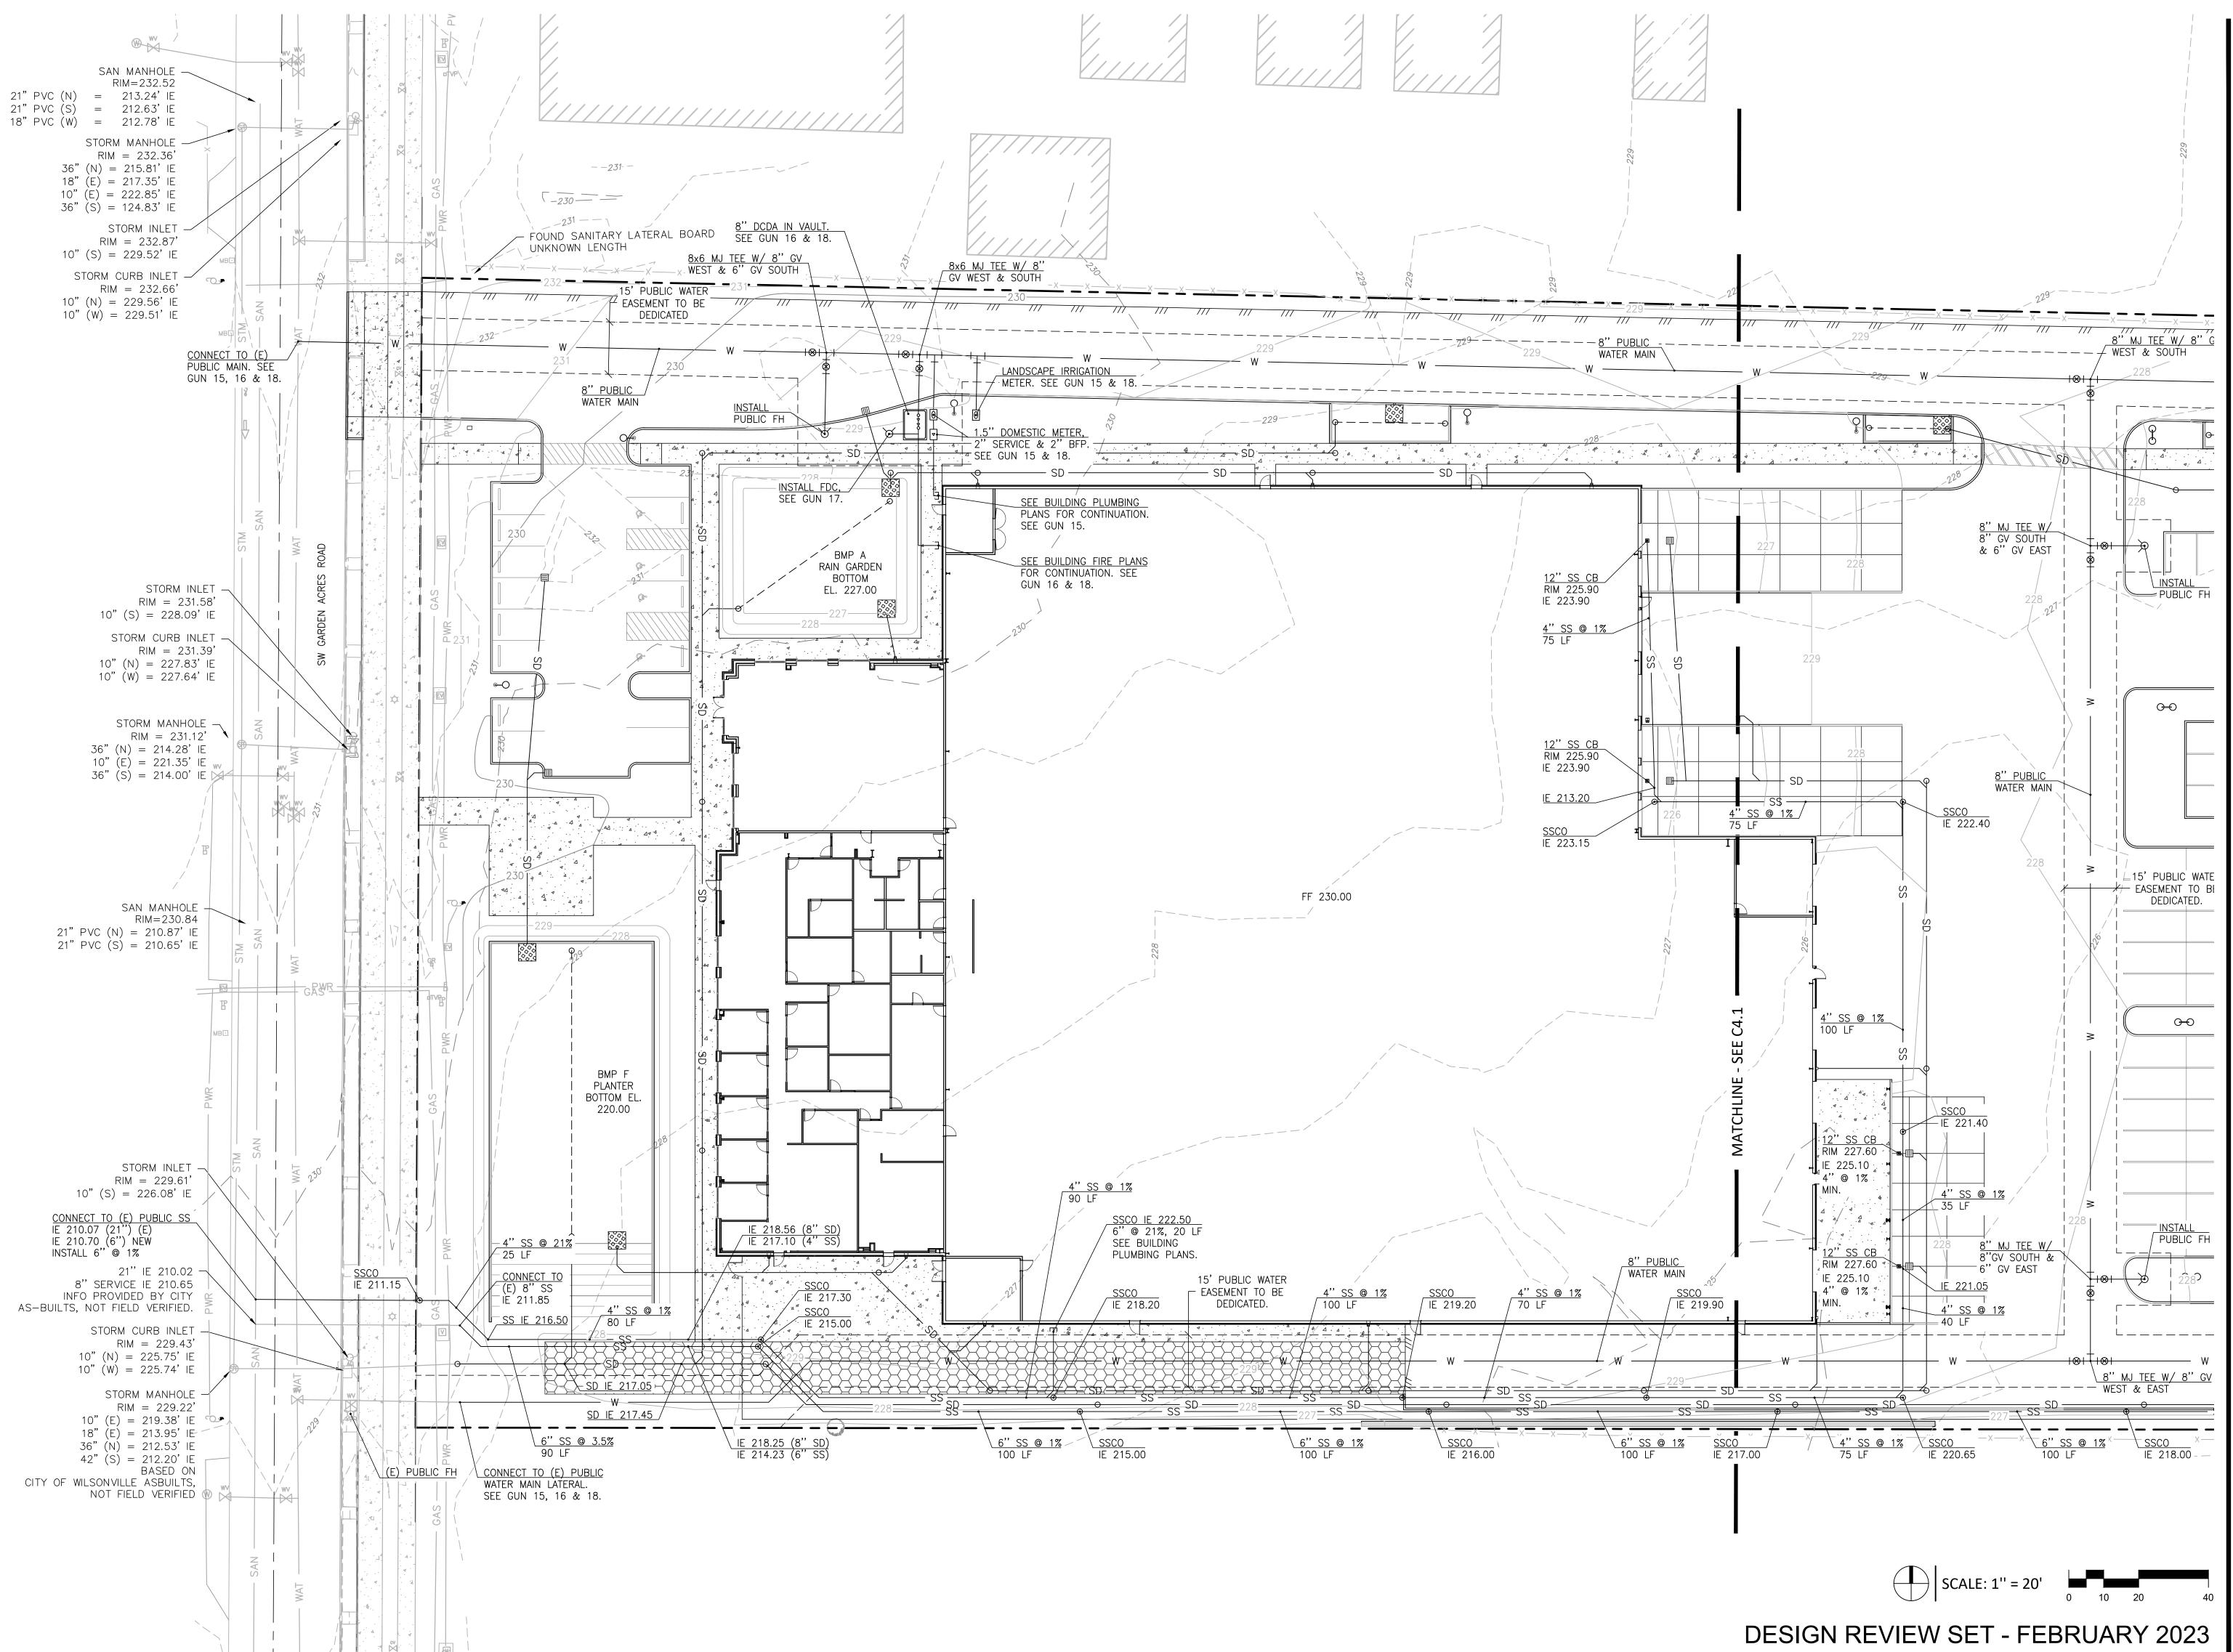



T.M. RIPPEY

CONSULTING ENGINEERS 7650 SW Beveland, Suite 100 Tigard, Oregon 97223 Phone: (503) 443-3900 Fax: (503) 443-3700

Client/ Owner:

Project: Precision Countertops

25540 SW Garden Acres Rd. Wilsonville OR

Sheet Title:

Water & Sanitary Sewer Plan


Revisions: # Description

Date

MILDREN DESIGN GROUP, P.C. ALL RIGHTS RESERVED © 2023


C4


THESE DRAWINGS ARE THE PROPERTY OF MILDREN DESIGN GROUP, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MILDREN DESIGN GROUP, P.C.				
Date:	2023-02-07			
Drawn by:	Checked by:			
AS	KJK			
TMR Job Number:	21279			
Sheet				

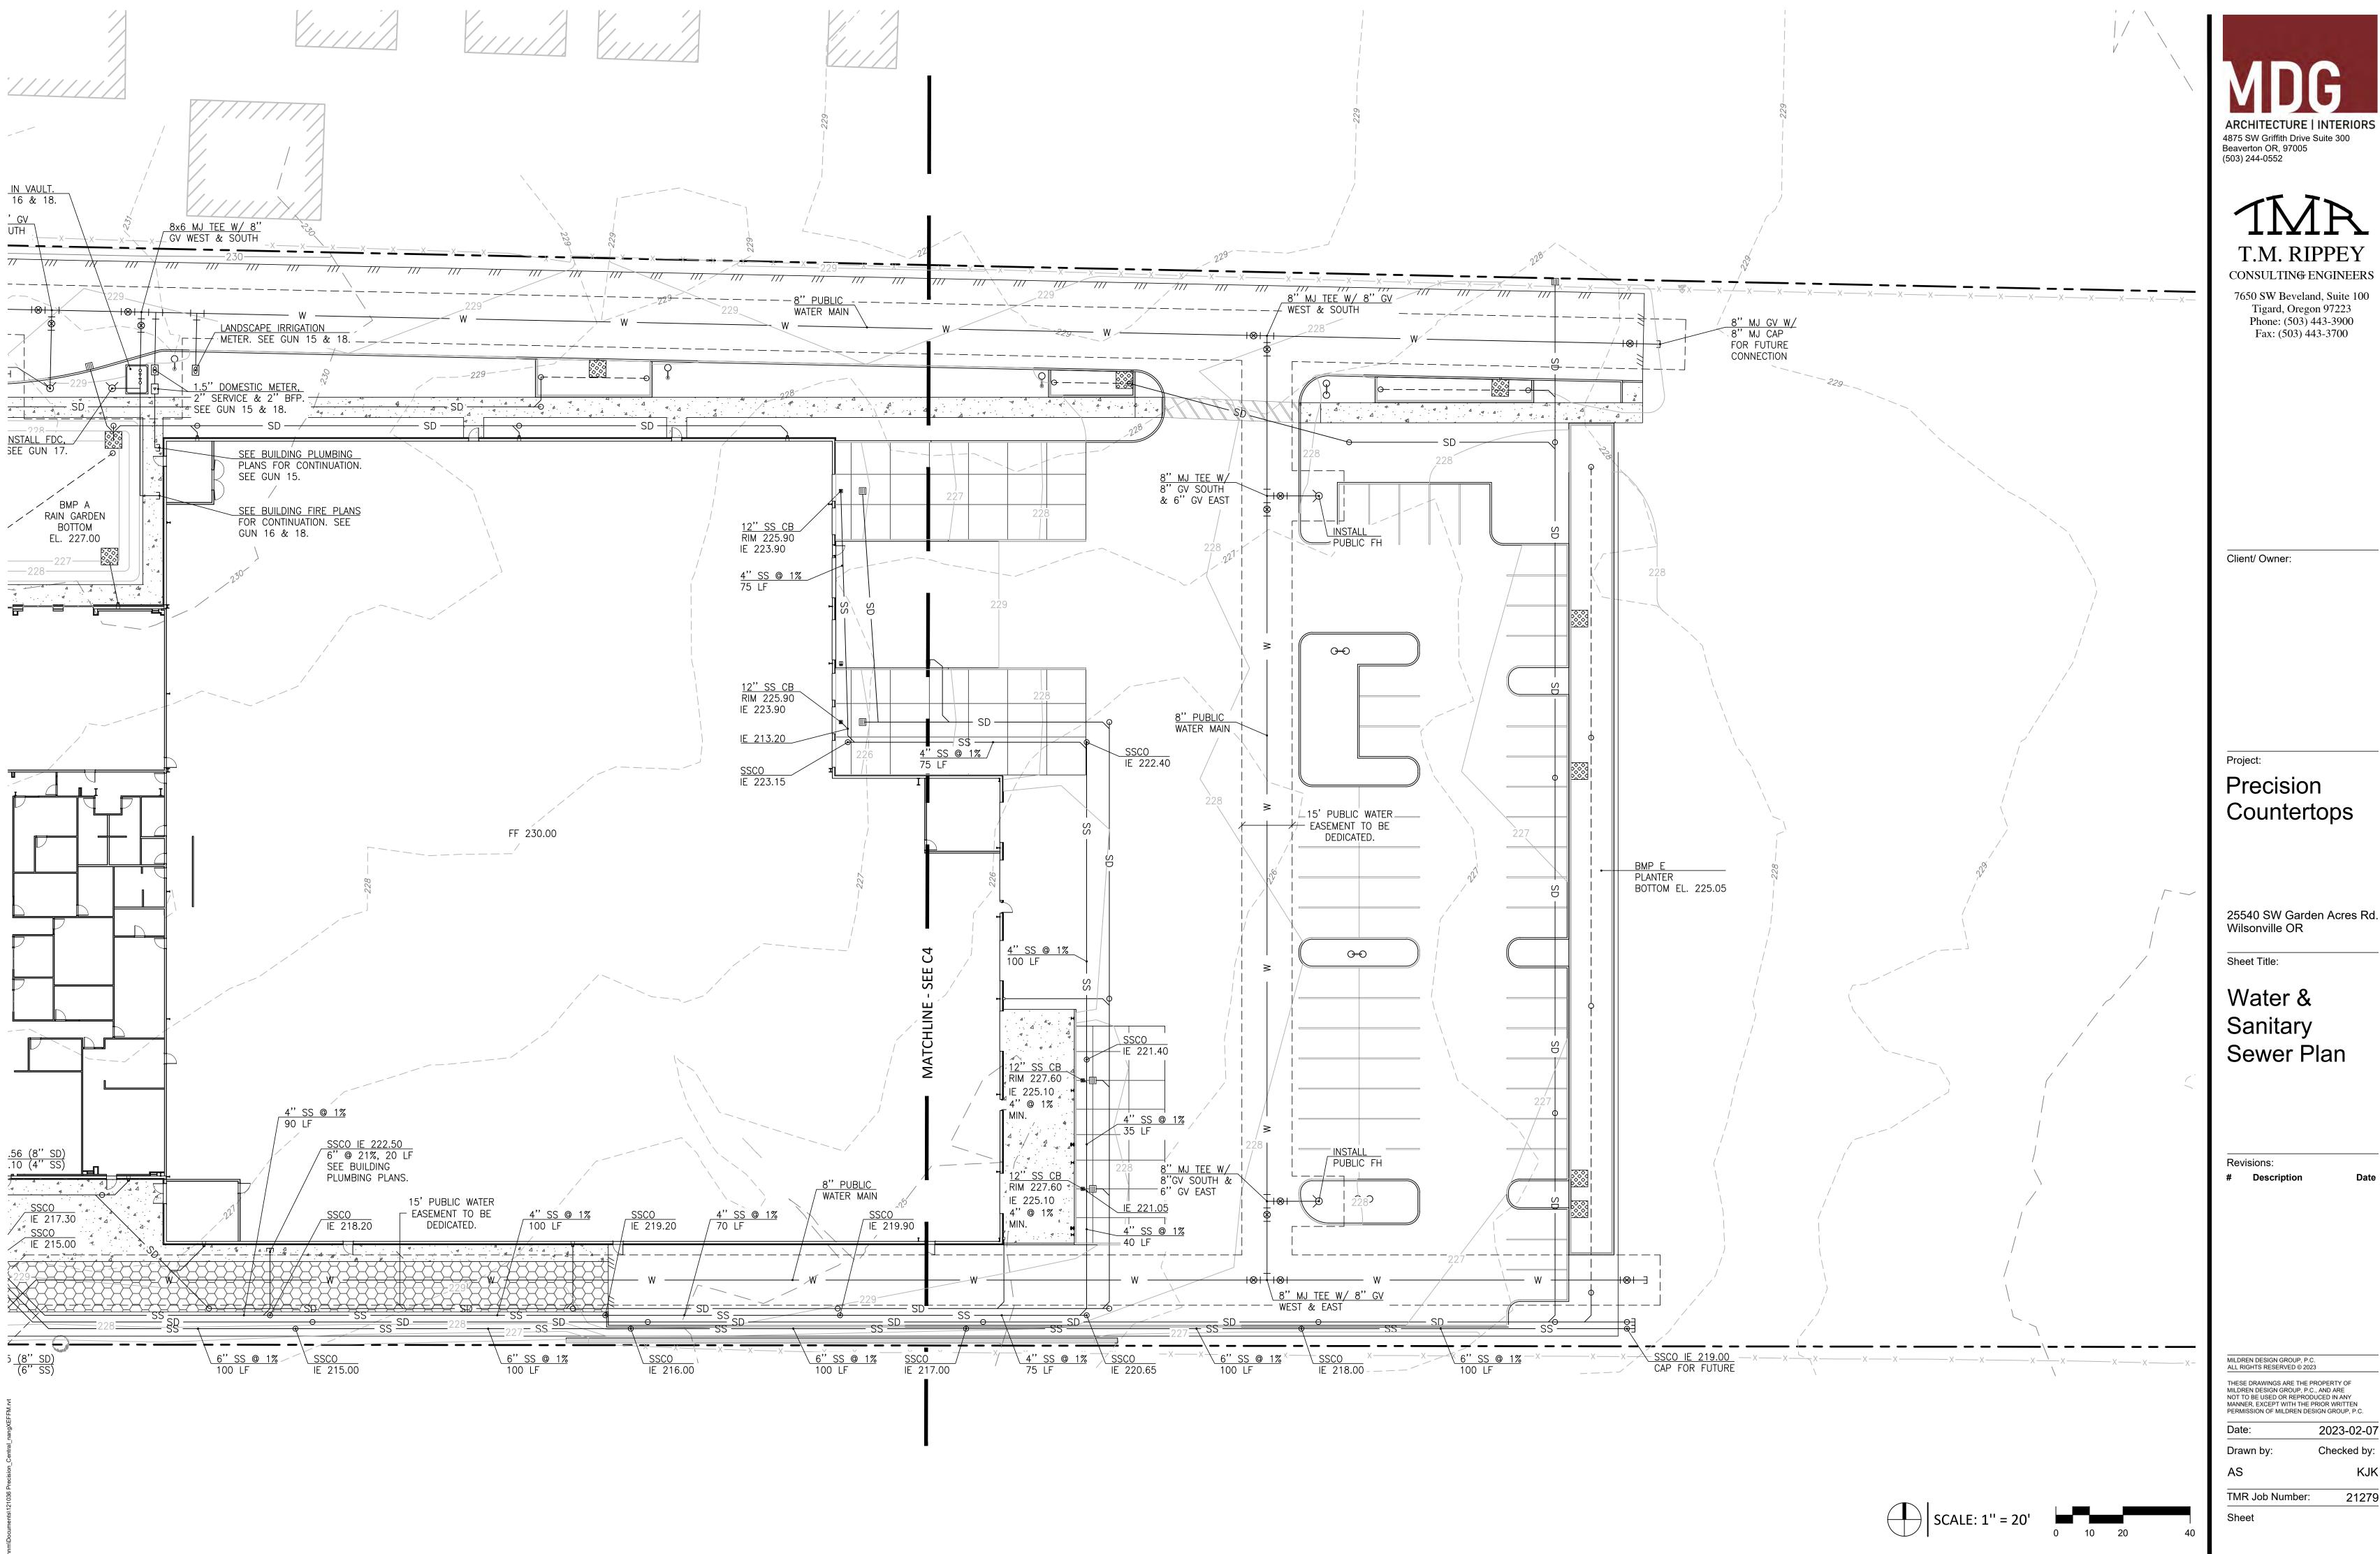


DESIGN REVIEW SET - FEBRUARY 2023


C4.1

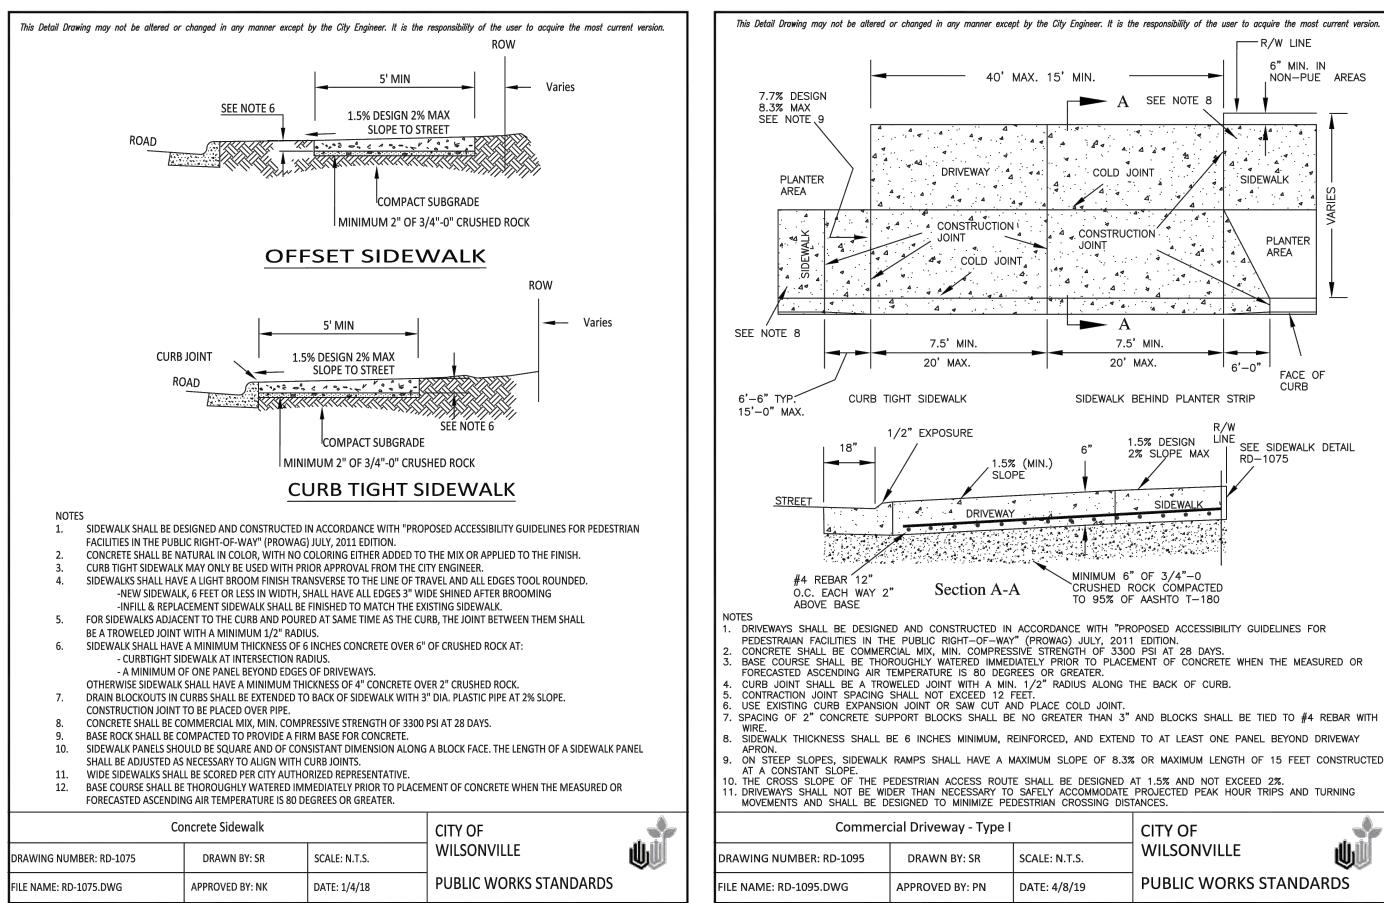

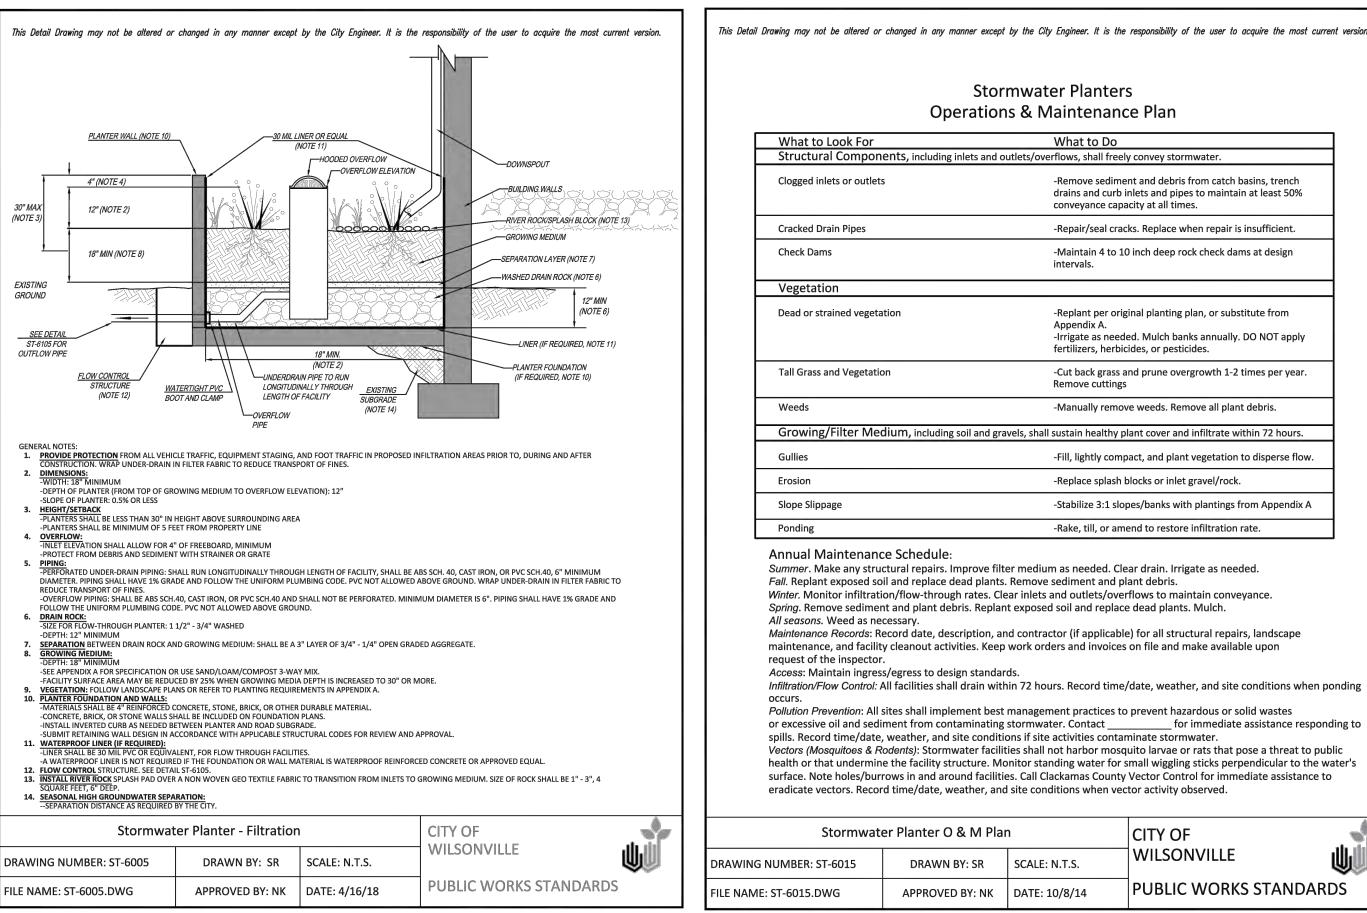

Driveway - Type I		CITY OF	
DRAWN BY: SR	SCALE: N.T.S.	WILSONVILLE	ĻU
PROVED BY: PN	DATE: 4/8/19	PUBLIC WORKS STANDARD	S

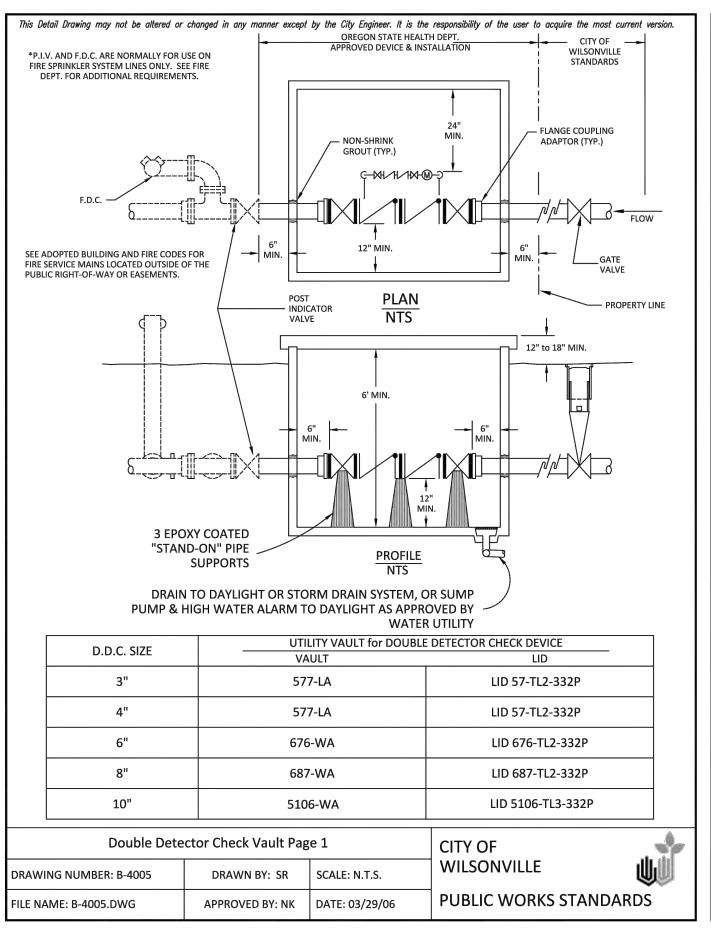

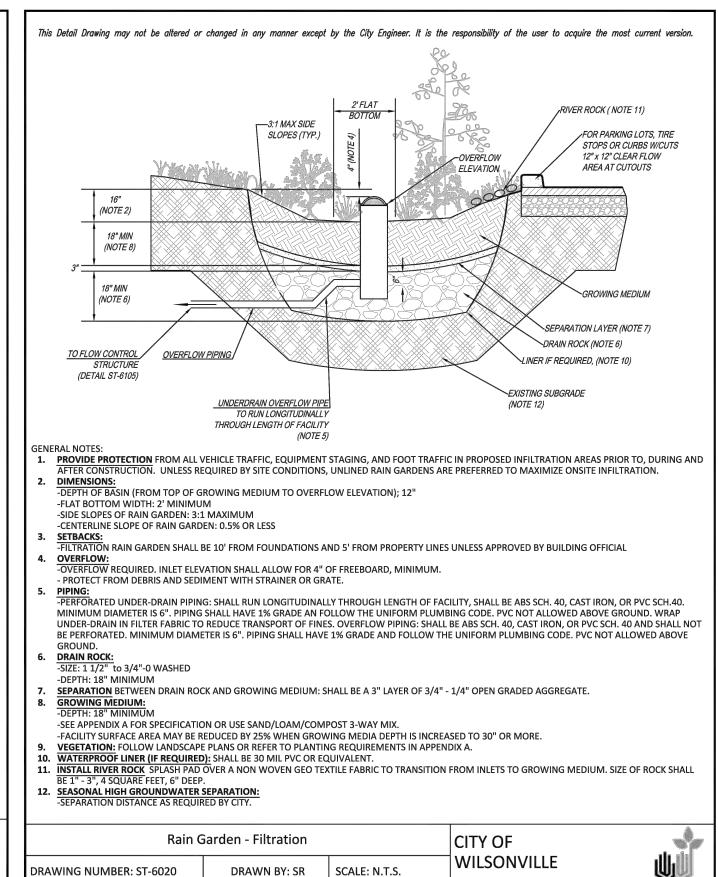

APPROVED BY: NK DATE: 4/16/18

PUBLIC WORKS STANDARDS

This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

Stormwater Planters **Operations & Maintenance Plan**

•	
	What to Do
S, including inlets and outlets/over S, including inlets and outlets/ S, including inlets and outlets/ S, including inlets and including inlets and including inlets and outlets/ S, including inlets and including including inlets and including inc	erflows, shall freely convey stormwater.
	-Remove sediment and debris from catch basins, trench drains and curb inlets and pipes to maintain at least 50% conveyance capacity at all times.
	-Repair/seal cracks. Replace when repair is insufficient.
	-Maintain 4 to 10 inch deep rock check dams at design intervals.
	-Replant per original planting plan, or substitute from Appendix A. -Irrigate as needed. Mulch banks annually. DO NOT apply fertilizers, herbicides, or pesticides.
	-Cut back grass and prune overgrowth 1-2 times per year. Remove cuttings
	-Manually remove weeds. Remove all plant debris.
n, including soil and gravels, shal	l sustain healthy plant cover and infiltrate within 72 hours.
	-Fill, lightly compact, and plant vegetation to disperse flow.
	-Replace splash blocks or inlet gravel/rock.
	-Stabilize 3:1 slopes/banks with plantings from Appendix A
	-Rake, till, or amend to restore infiltration rate.
nd replace dead plants. Remove flow-through rates. Clear inlets nd plant debris. Replant expose ary. rd date, description, and contra	im as needed. Clear drain. Irrigate as needed. e sediment and plant debris. and outlets/overflows to maintain conveyance. ed soil and replace dead plants. Mulch. actor (if applicable) for all structural repairs, landscape ders and invoices on file and make available upon

Pollution Prevention: All sites shall implement best management practices to prevent hazardous or solid wastes or excessive oil and sediment from contaminating stormwater. Contact ______ for immediate assistance responding to spills. Record time/date, weather, and site conditions if site activities contaminate stormwater. Vectors (Mosquitoes & Rodents): Stormwater facilities shall not harbor mosquito larvae or rats that pose a threat to public health or that undermine the facility structure. Monitor standing water for small wiggling sticks perpendicular to the water's surface. Note holes/burrows in and around facilities. Call Clackamas County Vector Control for immediate assistance to eradicate vectors. Record time/date, weather, and site conditions when vector activity observed.

Planter O & M Plai	ı	CITY OF	
DRAWN BY: SR	SCALE: N.T.S.	WILSONVILLE	ŴŰ
APPROVED BY: NK	DATE: 10/8/14	PUBLIC WORKS STANDARI	DS

FILE NAME: ST-6020.DWG

To ensure proper operation and accessibility of all backflow prevention device assemblies, the following requirements shall apply to installation of these devices, unless specifically approved by the City Engineer.

This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

1. No part of the backflow prevention device shall be submerged in water or installed in a location subject to flooding. If installed in a vault or chamber, adequate drainage shall be provided by either drainage to daylight or by sump pump with high water alarm system. Test cocks shall be plugged. The plugs shall not be of dissimilar metals.

2. The device assembly must be protected from freezing and other severe weather conditions.

3. Only devices approved for vertical installation may be installed vertically.

4. The device assembly shall be readily accessibly with adequate room for maintenance and testing. Devices 2 inches and smaller shall have at least a 12-inch clearance below and on both sides of the device assembly; and if located in a vault, the top of the device assembly shall be between 12 and 24 inches below grade.

All device assemblies larger than 2 inches shall have a 12-inch clearance on the backside, a 24-inch clearance on the test-cock side, and 12 inches below the device assemblies. Adequate clearance (3 inches minimum) must be maintained above operating stem and yoke, gate-valve stem. Headroom of 6'0" is required in vaults. Access to the device and to any vault or chamber shall remain clear at all times. An OR/OSHA approved chamber ladder that extends 3 ft above surface of vault shall be installed.

5. No post indicating valves are allowed on Double Check Device assemblies.

6. Only approved Double Check Detector Check Valve Assemblies are to be used for system containment on fire line services in the City of Wilsonville. The meter on bypass assembly shall read in cubic feet.

7. If a Fire Line Flow, or Tamper Switch is installed, it must be connected to a monitored Fire Alarm System approved by the Fire Marshal. No installation will modify the backflow device assembly or interfere with its operation or maintenance.

8. All backflow devices shall be installed at the service connection to the premises per Oregon Administrative Rules 333-61-070, Cross Connection Control Requirements, unless specifically approved by the Water Division Engineer. (service connection - a location where the public water facililities end at or near the property line)

9. All pipe between main and device shall be restrained. Use Mega-Lug retainer glands on mj fittings and Field-Lok gaskets on bell joints. Uni-Flange adapters may be used in vaults.

10. All check valve assemblies are required to be UL Tested or Factory Mutual Approved as well as State of Oregon Approved per NFPA 13 & 24.

Double Dete	ctor Check Vault Pag	CITY OF		
DRAWING NUMBER: B-4010	DRAWN BY: SR	WILSONVILLE	ŴŴ	
FILE NAME: B-4010.DWG	APPROVED BY: NK	DATE: 07/01/02	PUBLIC WORKS STANDA	RDS

4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552



CONSULTIN© ENGINEERS 7650 SW Beveland, Suite 100 Tigard, Oregon 97223 Phone: (503) 443-3900 Fax: (503) 443-3700

Client/ Owner:

Project:

Precisior Countertops

25540 SW Garden Acres Rd. Wilsonville OR

Sheet Title:

Details

Revisions:

Description

Date


AILDREN DESIGN GROUP, P.O. ALL RIGHTS RESERVED © 2023

C5

THESE DRAWINGS ARE THE F MILDREN DESIGN GROUP, P.C NOT TO BE USED OR REPROE MANNER, EXCEPT WITH THE F PERMISSION OF MILDREN DE	C., AND ARE DUCED IN ANY PRIOR WRITTEN
Date:	2023-02-07
Drawn by:	Checked by:
AS	KJK
TMR Job Number:	21279
Sheet	

DESIGN REVIEW SET - FEBRUARY 2023

		Rain Gardens		This Detail Drawing n	nay not be altered or changed in any manner except by the
What to Look For	Operatio	ns & Maintenan What to Do	ce Plan		
	nents, including inlets and o				
Clogged inlets or outlet	ts	drains and curb	ent and debris from catch basins, trench inlets and pipes to maintain at least 50% acity at all times.		
Cracked Drain Pipes		-Repair/seal cra	cks. Replace when repair is insufficient.		
Check Dams		-Maintain 4 to 1 intervals.	0 inch deep rock check dams at design		IVE GRATE NEENAH
Vegetation				APPROVED EQL	JAL, BOLT IN PLACE
Dead or strained veget	ation	Appendix A.	ginal planting plan, or substitute from ded. Mulch banks annually. DO NOT apply		
		fertilizers, herbi	cides, or pesticides.	GROWING MEDIUI	^M 12" MIN
Tall Grass and Vegetati	lon	-Cut back grass a Remove cutting	and prune overgrowth 1-2 times per year. s		
Weeds Growing/Filtor Mo	dium including soil and gr		ve weeds. Remove all plant debris.	<i>19</i> ^{<i>n</i>}	
Gullies	curum, including son and gr		pact, and plant vegetation to disperse flow.		- PVC GATE VALVE WITH ORIFICE (SEE
Erosion		-Replace splash	blocks or inlet gravel/rock.	DRAIN	
Slope Slippage			opes/banks with plantings from Appendix A	ROCK	0 0 0
Ponding		-Rake, till, or am	nend to restore infiltration rate.	PVC	
Annual Maintenance S				PIPE	22" ROUND
<i>Summer</i> . Make any structur <i>Fall.</i> Replant exposed soil an <i>Winter.</i> Monitor infiltration/f	id replace dead plants. Rei	move sediment and plant	debris.	DRAIN — ROCK	
Spring. Remove sediment ar All seasons. Weed as necess	nd plant debris. Replant ex ary.	posed soil and replace dea	ad plants. Mulch.		
Maintenance Records: Recor maintenance, and facility cle request of the inspector.	a date, description, and co eanout activities. Keep wo	ontractor (if applicable) fo rk orders and invoices on f	r all structural repairs, landscape file and make available upon	NOTE	2
Access: Maintain ingress/eg Infiltration/Flow Control: All fa		2 hours. Record time/date	e, weather, and site conditions when ponding		BEDDING -
occurs. Pollution Prevention: All sites or excessive oil and sedimer			vent hazardous or solid wastes for immediate assistance responding to	NOTES: 1. CONTRA	ACTOR TO WIDEN EXCAVATION AS REQUIF
spills. Record time/date, we	ather, and site conditions	if site activities contamina		2. 10 GA. S	CTION EQUIPMENT. ITEEL PLATE, BITUMINOUS COATED BASIN
surface. Note holes/burrows	s in and around facilities. C	Call Clackamas County Vec	l wiggling sticks perpendicular to the water's tor Control for immediate assistance to		/ED BY CITY REPRESENTATIVE. G SHALL BE 6" OF COMPACTED 3/4"-0 CR
eradicate vectors. Record tir		e conditions when vector a	activity observed.		Beehive Overflow Inlet
Rain G	iarden O & M Plan	1	CITY OF		
IG NUMBER: ST-6030	DRAWN BY: SR	SCALE: N.T.S.		FILE NAME: ST-61	20.dwg APPROVED BY: NK DA
3	or changed in any manner exce	ot by the City Engineer. It is th	e responsibility of the user to acquire the most current version	on.	SERVICE LATERAL F
3	or changed in any manner exception	ot by the City Engineer. It is th	e responsibility of the user to acquire the most current versio	on. 12" <u>Min.</u>	SERVICE LATERAL F SPECIFIED
	or changed in any manner exception	ot by the City Engineer. It is th			SPECIFIED
					USE PRE-FABRICATED TEE FITTINGS ON ALL NEW MAINS. FIELD TAP ALL EXISTING MAINS.
					SPECIFIED USE PRE-FABRICATED TEE FITTING ON ALL NEW MAINS. FIELD TAP AL EXISTING MAINS. PLAN
			CONCRETE PIPE		SPECIFIED USE PRE-FABRICATED TEE FITTING ON ALL NEW MAINS. FIELD TAP AL EXISTING MAINS. PLAN
	1. COMPLETE RUBBER SL	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE	12" <u>Min.</u>	SPECIFIED USE PRE-FABRICATED TEE FITTING ON ALL NEW MAINS. FIELD TAP AL EXISTING MAINS. PLAN
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BAN	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	12" Min.	TO BE CENTERED OVER E ALL LATERALS.
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BAN	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	12" Min.	TO BE CENTERED OVER E ALL LATERALS.
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB.	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	12" Min.	TO BE CENTERED OVER E ALL LATERALS.
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB.	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	12" Min.	TO BE CENTERED OVER E ALL LATERALS. SEE LOCATING SEE LOCATING SEE LOCATING
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB. 3. PVC HUB (ASTM C-303	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	12" Min.	TO BE CENTERED OVER ALL LATERALS. SEE LOCATING WIRE NOTE SEE LOCATING WIRE NOTE COM 00 000000000000000000000000000000000
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB. 3. PVC HUB (ASTM C-303	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	CAUTION TAPE AND 12" ABOVE	SPECIFIED USE PRE-FABRICATED TEE FITTING ON ALL NEW MAINS. FIELD TAP AL EXISTING MAINS. PLAN MAIN SIDEW TO BE CENTERED OVER E ALL LATERALS. SEE LOCATING WIRE NOTE OF 000000000000000000000000000000000000
	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB. 3. PVC HUB (ASTM C-303 HOLE.	EEVE (ASTM C-443) INCLUDI	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE. ES UPPER HALF OF RUBBER SLEEVE TO THE PVC	CAUTION TAPE AND 12" ABOVE	TO BE CENTERED OVER ALL NEW MAINS. FIELD TAP AL EXISTING MAINS. PLAN MAIN SIDEW TO BE CENTERED OVER ALL LATERALS. SIDEW SUPPORT TEE WITH BEDDING MINIMUM 2' WIDE SUPPORT TEE WITH BEDDING MINIMUM 2' WIDE SUPPORT TEE WITH BEDDING MINIMUM 2' WIDE
NOTE: 1. INSERTA TEES S EXISTING THICK PLASTIC. 2. ALL INSERTA-T	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB. 3. PVC HUB (ASTM C-303 HOLE. 6HALL NOT BE USED O K WALL PIPE MATERIA	EEVE (ASTM C-443) INCLUDE D (9/16" SERIES 316) SECURE 44 SDR 35) DRIVE INTO CENT ON NEW CONSTRUCT AL, SUCH AS CONCRE MACHINE DRILLED AN	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.	CAUTION TAPE AND 12" ABOVE	TO BE CENTERED OVER EXISTING MAINS. FIELD TAP AN EXISTING MAINS. PLAN MAIN SIDEV MAIN SIDEV SUPPORT TEE WITH BEDDING MINIMUM 2' WIDE SUPPORT TEE WITH BEDDING MINIMUM 2' WIDE SUPPORT TEE WITH BEDDING MINIMUM 2' WIDE SIZE SHALL BE 6" FOR STORM LATERALS ANI VC TO 4" D.I. FERNCO OR CAULDER COUPLIN WIRE SHALL BE 12 GAUGE, HMW-PE CONTIN LI BE PLACED ALONG THE SPRING-LINE OF D
NOTE: 1. INSERTA TEES S EXISTING THICK PLASTIC. 2. ALL INSERTA-T	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB. 3. PVC HUB (ASTM C-303 HOLE. 6HALL NOT BE USED (C WALL PIPE MATERI. EE HOLES SHALL BE N	EEVE (ASTM C-443) INCLUDE D (9/16" SERIES 316) SECURE 44 SDR 35) DRIVE INTO CENT ON NEW CONSTRUCT AL, SUCH AS CONCRE MACHINE DRILLED AN	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE. ES UPPER HALF OF RUBBER SLEEVE TO THE PVC ER OF RUBBER SLEEVE AFTER SLEEVE IS PLACED IN TION AND ARE ONLY ALLOWED ON ETE, DUCTILE IRON, AND RIB ND CORED AND LOCATED A	CAUTION TAPE AND 12" ABOVE	TO BE CENTERED OVER ALL LATERALS.
NOTE: 1. INSERTA TEES S EXISTING THICK PLASTIC. 2. ALL INSERTA-T	1. COMPLETE RUBBER SL 2. STAINLESS STEEL BANK HUB. 3. PVC HUB (ASTM C-303 HOLE. 6HALL NOT BE USED (CWALL PIPE MATERIA EE HOLES SHALL BE M CLEAR DISTANCE FR(EEVE (ASTM C-443) INCLUDE D (9/16" SERIES 316) SECURE 44 SDR 35) DRIVE INTO CENT ON NEW CONSTRUCT AL, SUCH AS CONCRE MACHINE DRILLED AN	CONCRETE PIPE ES A MOLDED SEGMENT THAT HOLDS IT IN PLACE. ES UPPER HALF OF RUBBER SLEEVE TO THE PVC ER OF RUBBER SLEEVE AFTER SLEEVE IS PLACED IN	CAUTION TAPE AND 12" ABOVE	TO BE CENTERED OVER ALL NEW MAINS. FIELD TAP AN EXISTING MAINS. PLAN MAIN SIDEN MAIN SIDEN SIDEN SIDEN SIDEN MAIN SIDEN SI

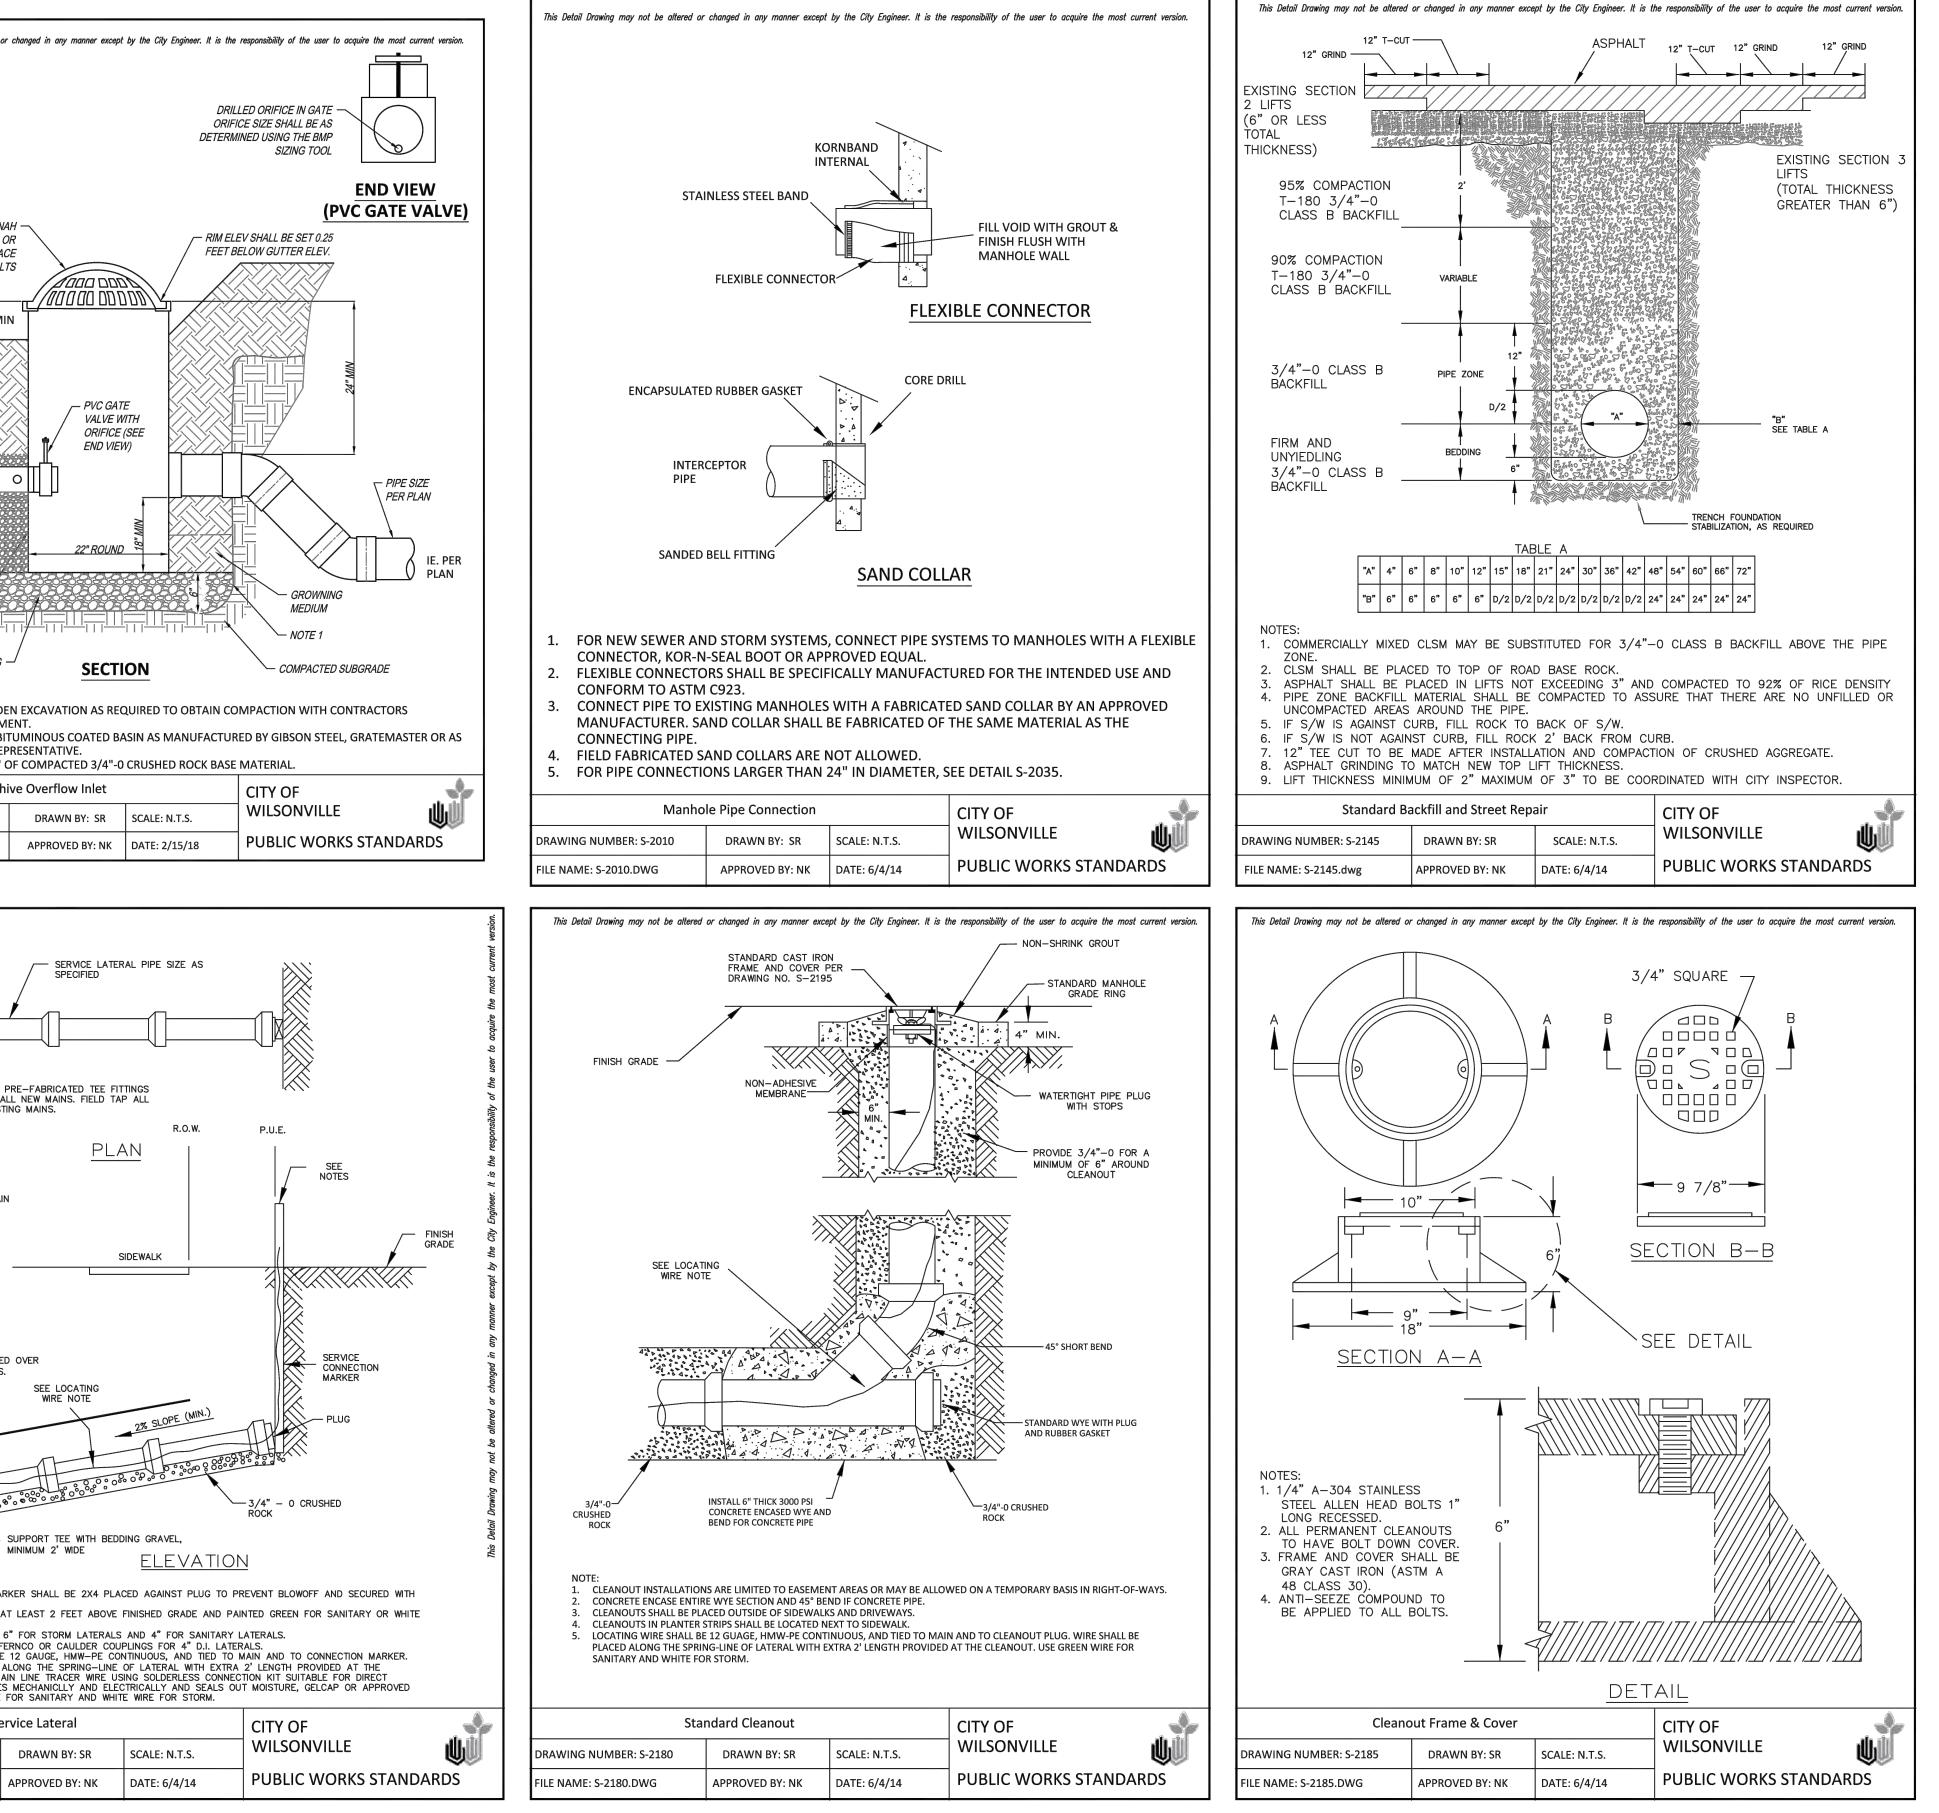

THESE DRAWINGS ARE THE PROPERTY OF MILDREN DESIGN GROUP, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MILDREN DESIGN GROUP, P.C 2023-02-07 Date Checked by: Drawn by: AS KJK 21279 TMR Job Number: Sheet

DESIGN REVIEW SET - FEBRUARY 2023

Project: Precision Countertops

25540 SW Garden Acres Rd.

Wilsonville OR

Sheet Title:

Revisions:

Description

AILDREN DESIGN GROUP, P.C ALL RIGHTS RESERVED © 2023

C5.1

Date

Details

Client/ Owner:

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005

T.M. RIPPEY

CONSULTING ENGINEERS

7650 SW Beveland, Suite 100

Tigard, Oregon 97223


Phone: (503) 443-3900


Fax: (503) 443-3700

(503) 244-0552

JCM 452 ALL STAINLESS STEEL TAPPING SLEEVE OR APPROVED EQUAL **TOP VIEW**

NOT 1. 2. 3. 4. 5. 6. 7. 8. 9. 10. 11.	ES: ALL BOLTS, WASHEI WATER MAIN SHALL SLEEVE AND VALVE PRESSURE TEST AND PROPER TAPPING M SADDLE BOLTS TO E CONTRACTOR SHAL THRUST BLOCKING THAN THE REQUIRE TAP SHALL BE MAD BEGINNING OF THE SLEEVE AND VALVE THRUST BLOCK AND 3/4"-0 CRUSHED AG DETERMINED BY AA	L BE CLEA SHALL BE D TAP SHA IACHINE S E TORQU L FLUSH V REQUIRE MENTS A E NO CLO BELL FLA SHALL BE D BACKFIL GREGATI
	Sta	ndard W
DRAWING	UMBER: WT-3025	DRAW
FILE NAME:	WT-3025.DWG	APPROV

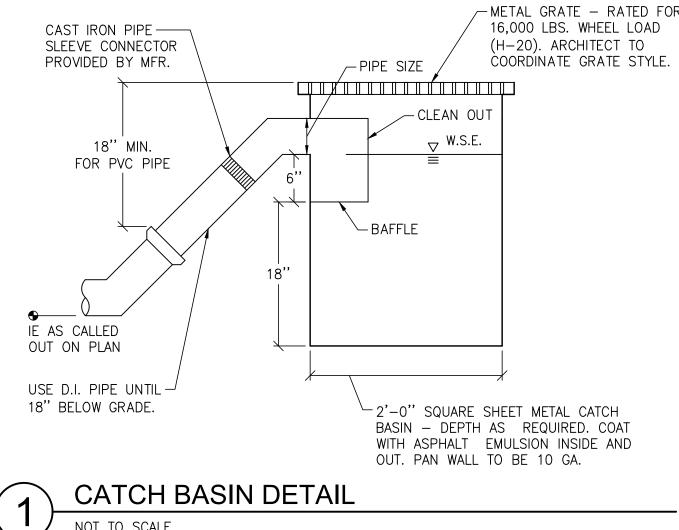

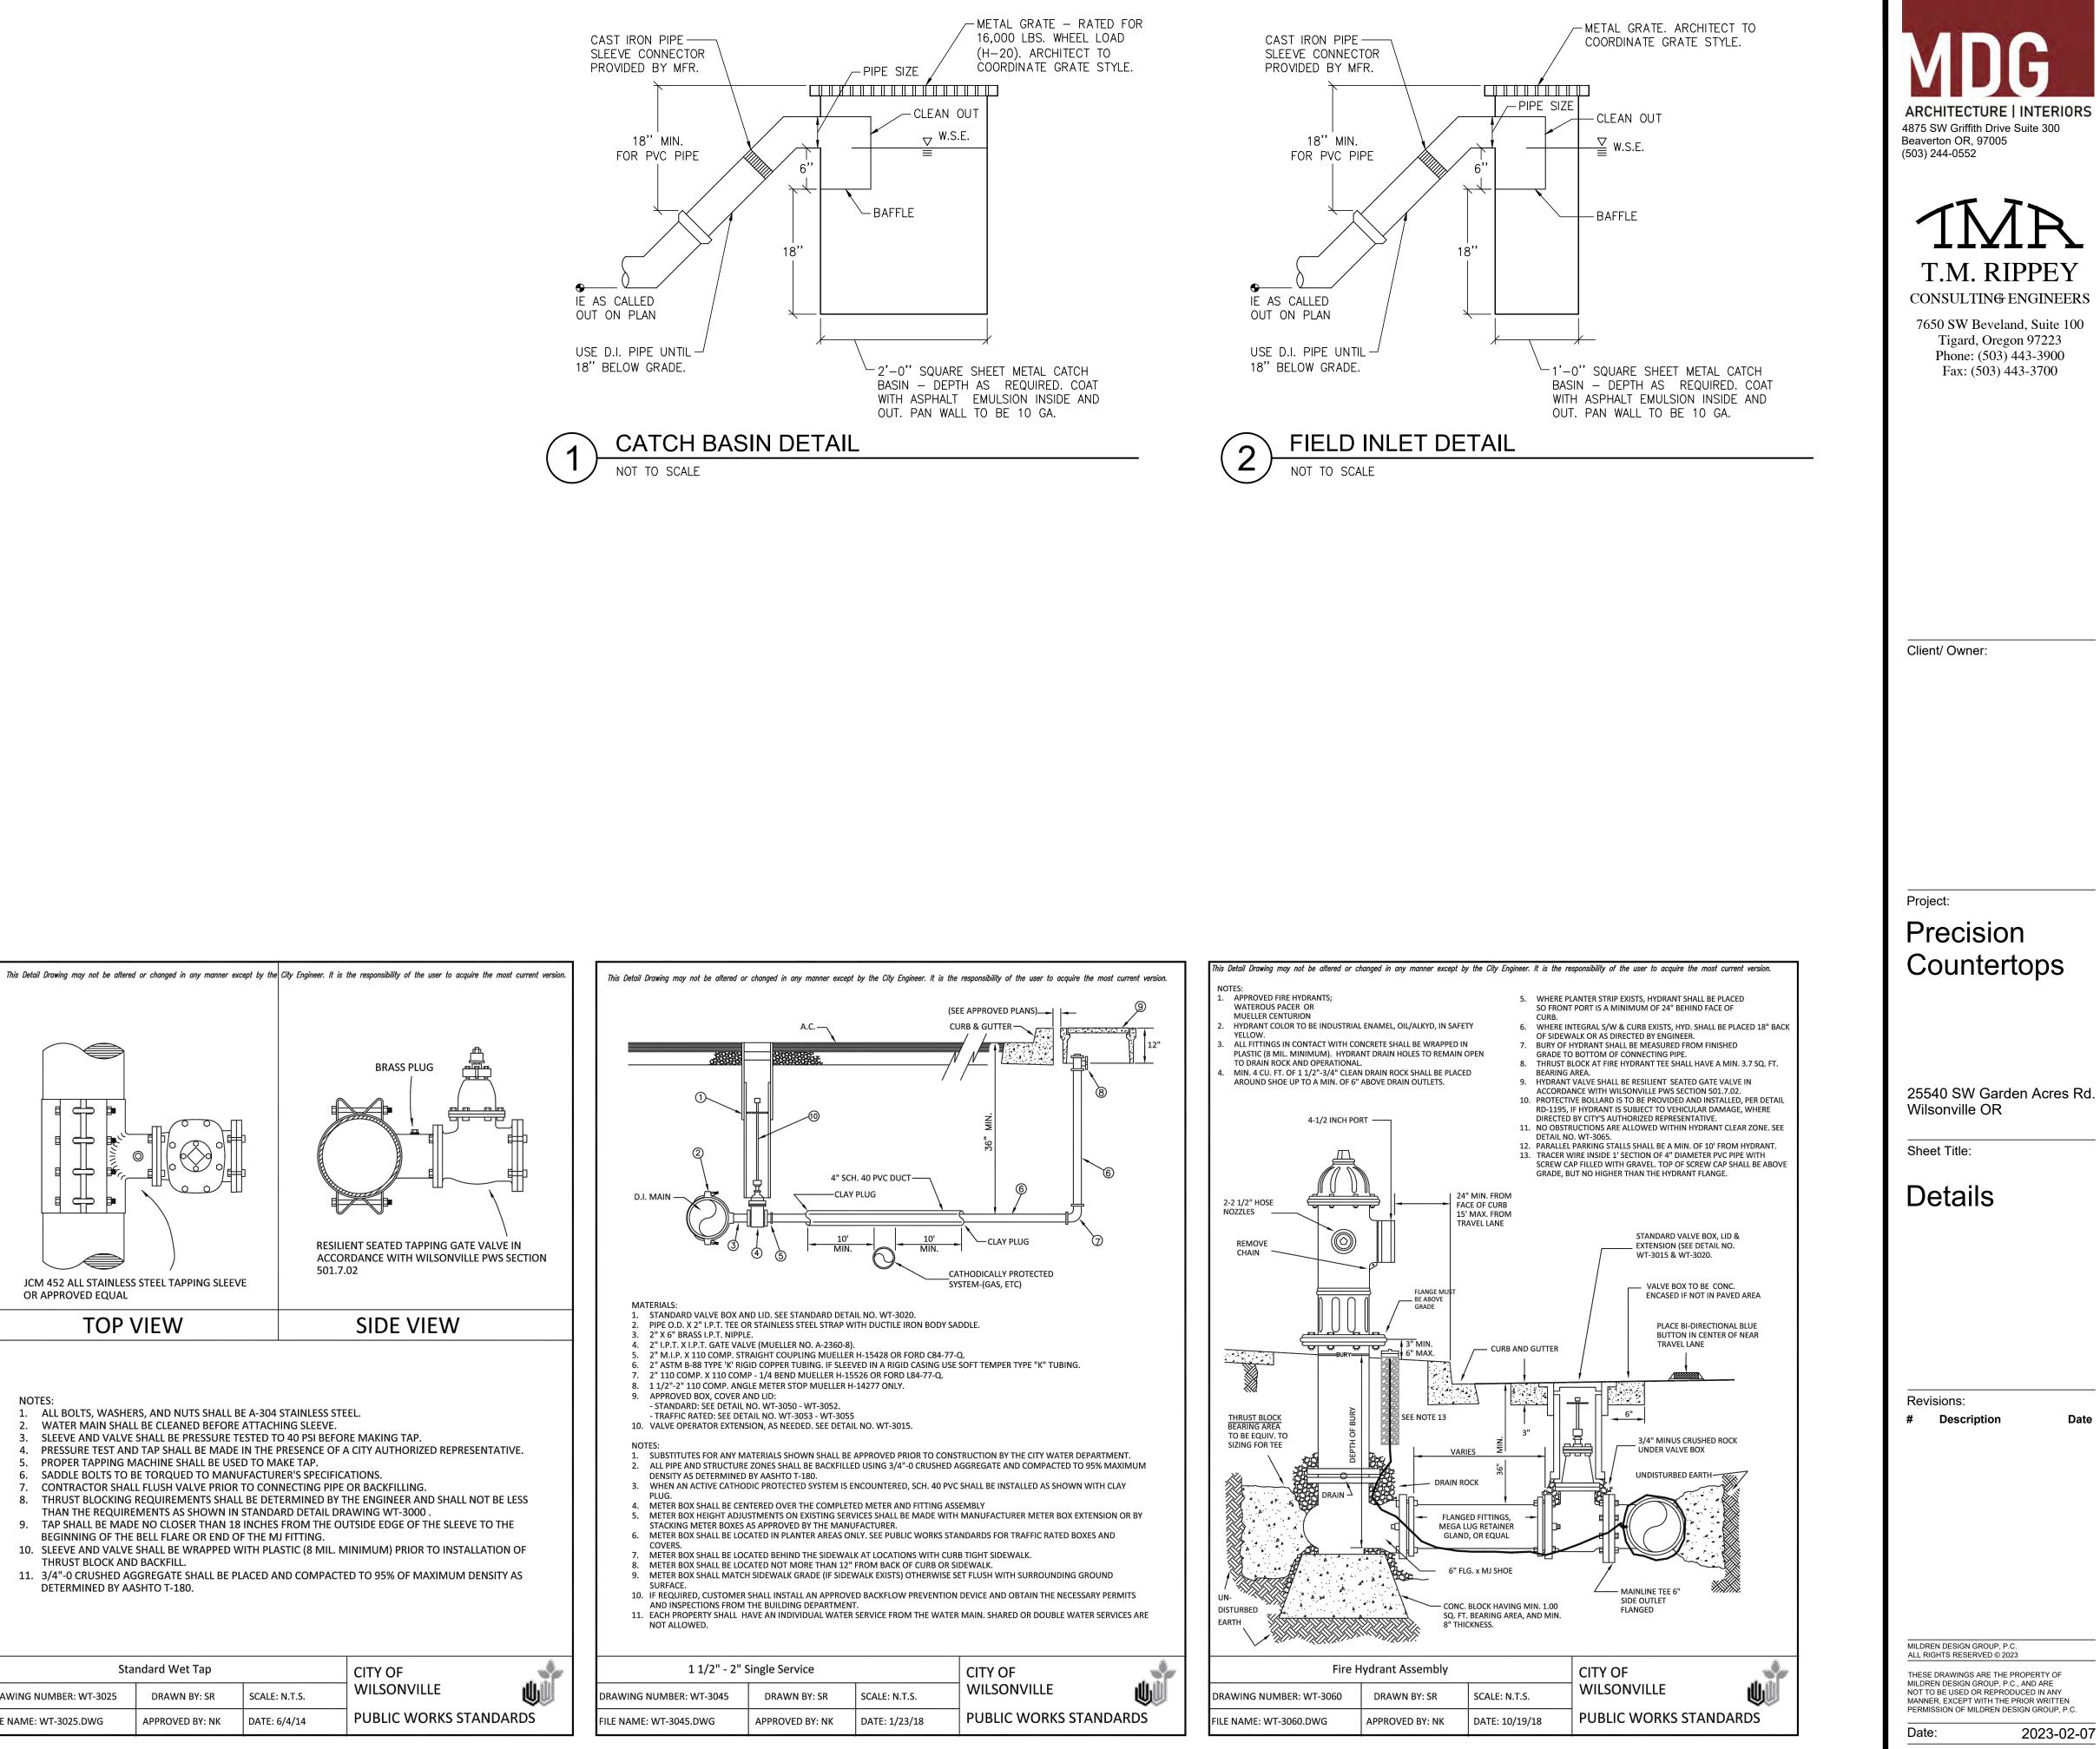

DESIGN REVIEW SET - FEBRUARY 2023 C5.2

TMR Job Number:

Drawn by:


AS


Sheet

Checked by:

KJK

21279

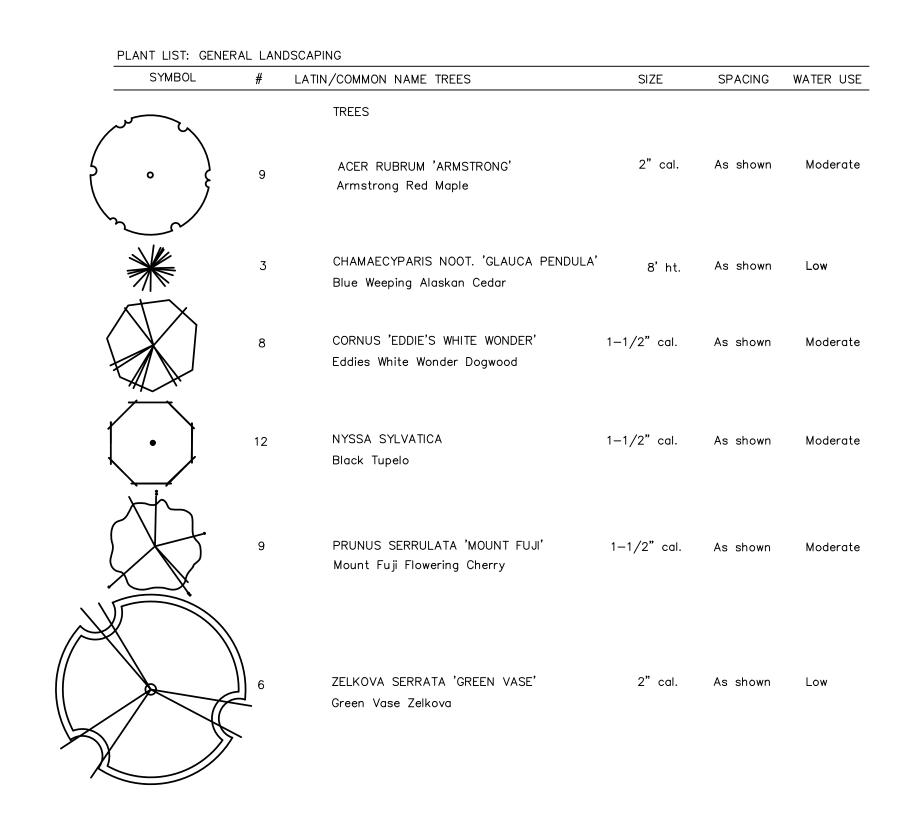

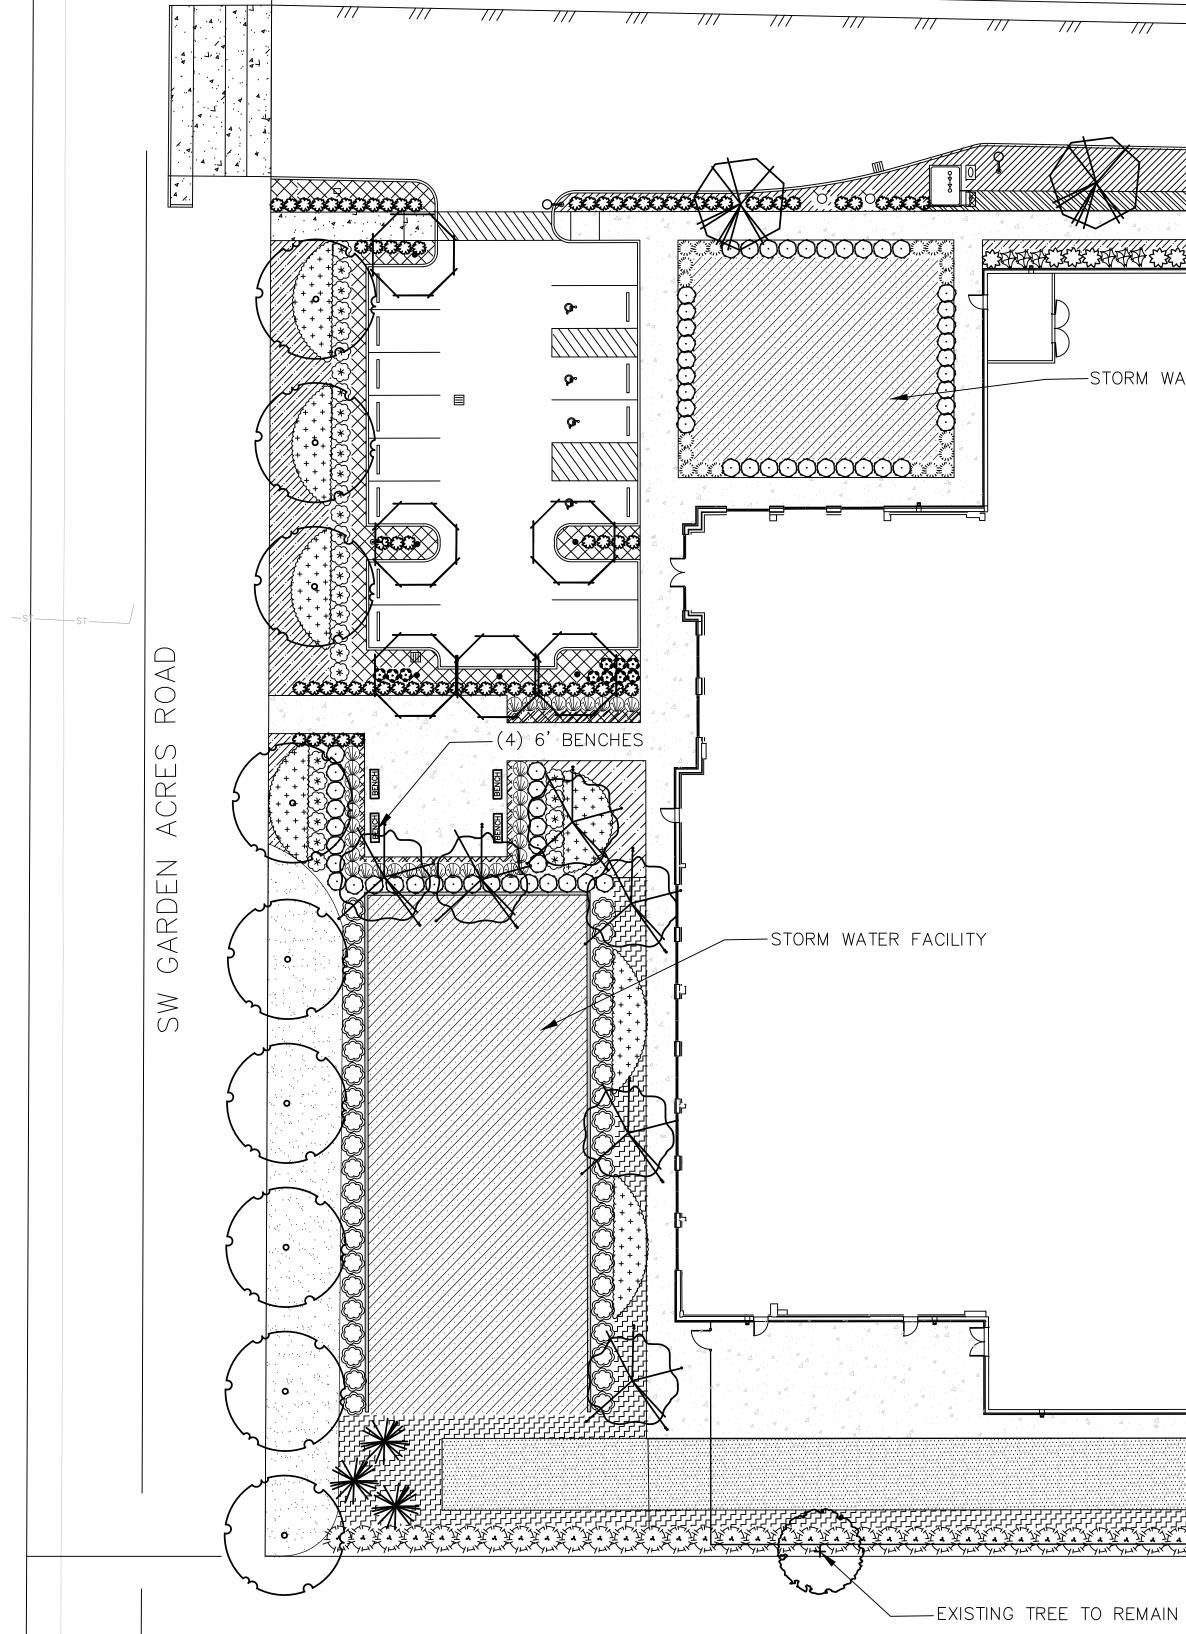

<u>GENERAL NOTES:</u> 1. Contractor is to verify all plant quantities. 2. Adjust plantings in the field as necessary.

3. Project is to be irrigated by an automatic, underground system, which will provide full coverage for all plant material. System is to be design/ build by Landscape Contractor. Guarantee system for a minimum one year. Show drip

systems as alternate bid only.

4. All plants are to be fully foliaged, well branched and true to form. 5. Contractor is to notify Landscape Architect or Owner's Representative of any site changes or unforeseen conditions that may be detrimental to plant health, or cause future problems to any structural elements of the project.


MBOL	#	LATIN/COMMON NAME TREES	SIZE	SPACING	WATER USE	SYMBOL	#	LATIN/COMMON NAME TREES	SIZE	SPACING	WATER USE
		SHRUBS (WITH MIN. 10"-12" SPREAD)						GROUNDCOVER			
\bigcirc	28	ABELIA 'LUCKY LOTS' Twist of Lime Abelia	5 gal.	4' o.c.	Low		561	ARCTOSTAPHYLOS UVA-URSI "MASS." Massachusetts Kinnikinnick	1 gal.	3' o.c.	Low
\bigcirc	44	CISTUS LADANIFER Crimson Spot Rockrose	5 gal.	5'o.c.	Low						
Y HY	125	MYRICA CALIFORNICA Pacific Wax Myrtle	5 gal.	5' o.c.	Low		320	LIRIOPE MUSCARI Big Blue Lily Turf	1 gal.	2'o.c.	Moderate
0	74	NANDINA DOMESTICA "GULF STREAM" Gulf Stream Nandina	2 gal.	3' o.c.	Low		160	LONICERA PILEATA Box Honeysuckle	1 gal.	4'o.c.	Low
5	71	PIERIS JAPONICA 'CABERNET' Enchanted Forest Pieris	5 gal.	4' o.c.	Low		263	MAHONIA REPENS	1 gal.	30"o.c.	Low
Ø	42	SPIRAEA X BUM. "GOLDMOUND" Goldmound Spirea	2 gal.	3' o.c.	Low			Creeping Oregon Grape	5		
Φ	24	TAXUS BACCATA 'STRICTA' Irish Yew	5 gal.	4'o.c.	Low	$\begin{array}{cccccccccccccccccccccccccccccccccccc$	119	ROSA 'FLOWER CARPET AMBER' Flower Carpet Amber Rose	2 gal.	3' o.c.	Moderate
C	64	VIBURNUM DAVIDII David Viburnum	2 gal.	3' o.c.	Moderate			OTHER			
*	75	VIBURNUM TINUS 'SPRING BOUQUET' Spring Bouquet Viburnum	5 gal.	4'o.c.	Moderate			FINE LAWN SEED MIX See Specifications			Moderate
		GRASSES						STORMWATER FACILITY PLANTING			Moderate
	37	CALAMAGROSTIS 'KARL FOERSTER' Feather Reed Grass	1 gal.	2'o.c.	Low			Per City of Wilsonville Standards			
21-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-	20	MISCANTHUS SINENSIS 'YAKUSHIMA' Dwarf Maiden Grass	2 gal.	3' o.c.	Low						


FUTURE JAVA ROAD	M WATER FACIL	.ITIES
A A A A A A A A A A A A A A A A A A A		Marine Mari Marine Marine Mari
STORM WATER FACILITY		
		_
┍┍┲╤┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲┲	<u></u>	~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~


LANDSCAPE PLAN



PROPOSED BENCHES MANUFACTURER: FORMS + SURFACES MODEL: 6' HUDSON BENCH, SURFACE MOUNT

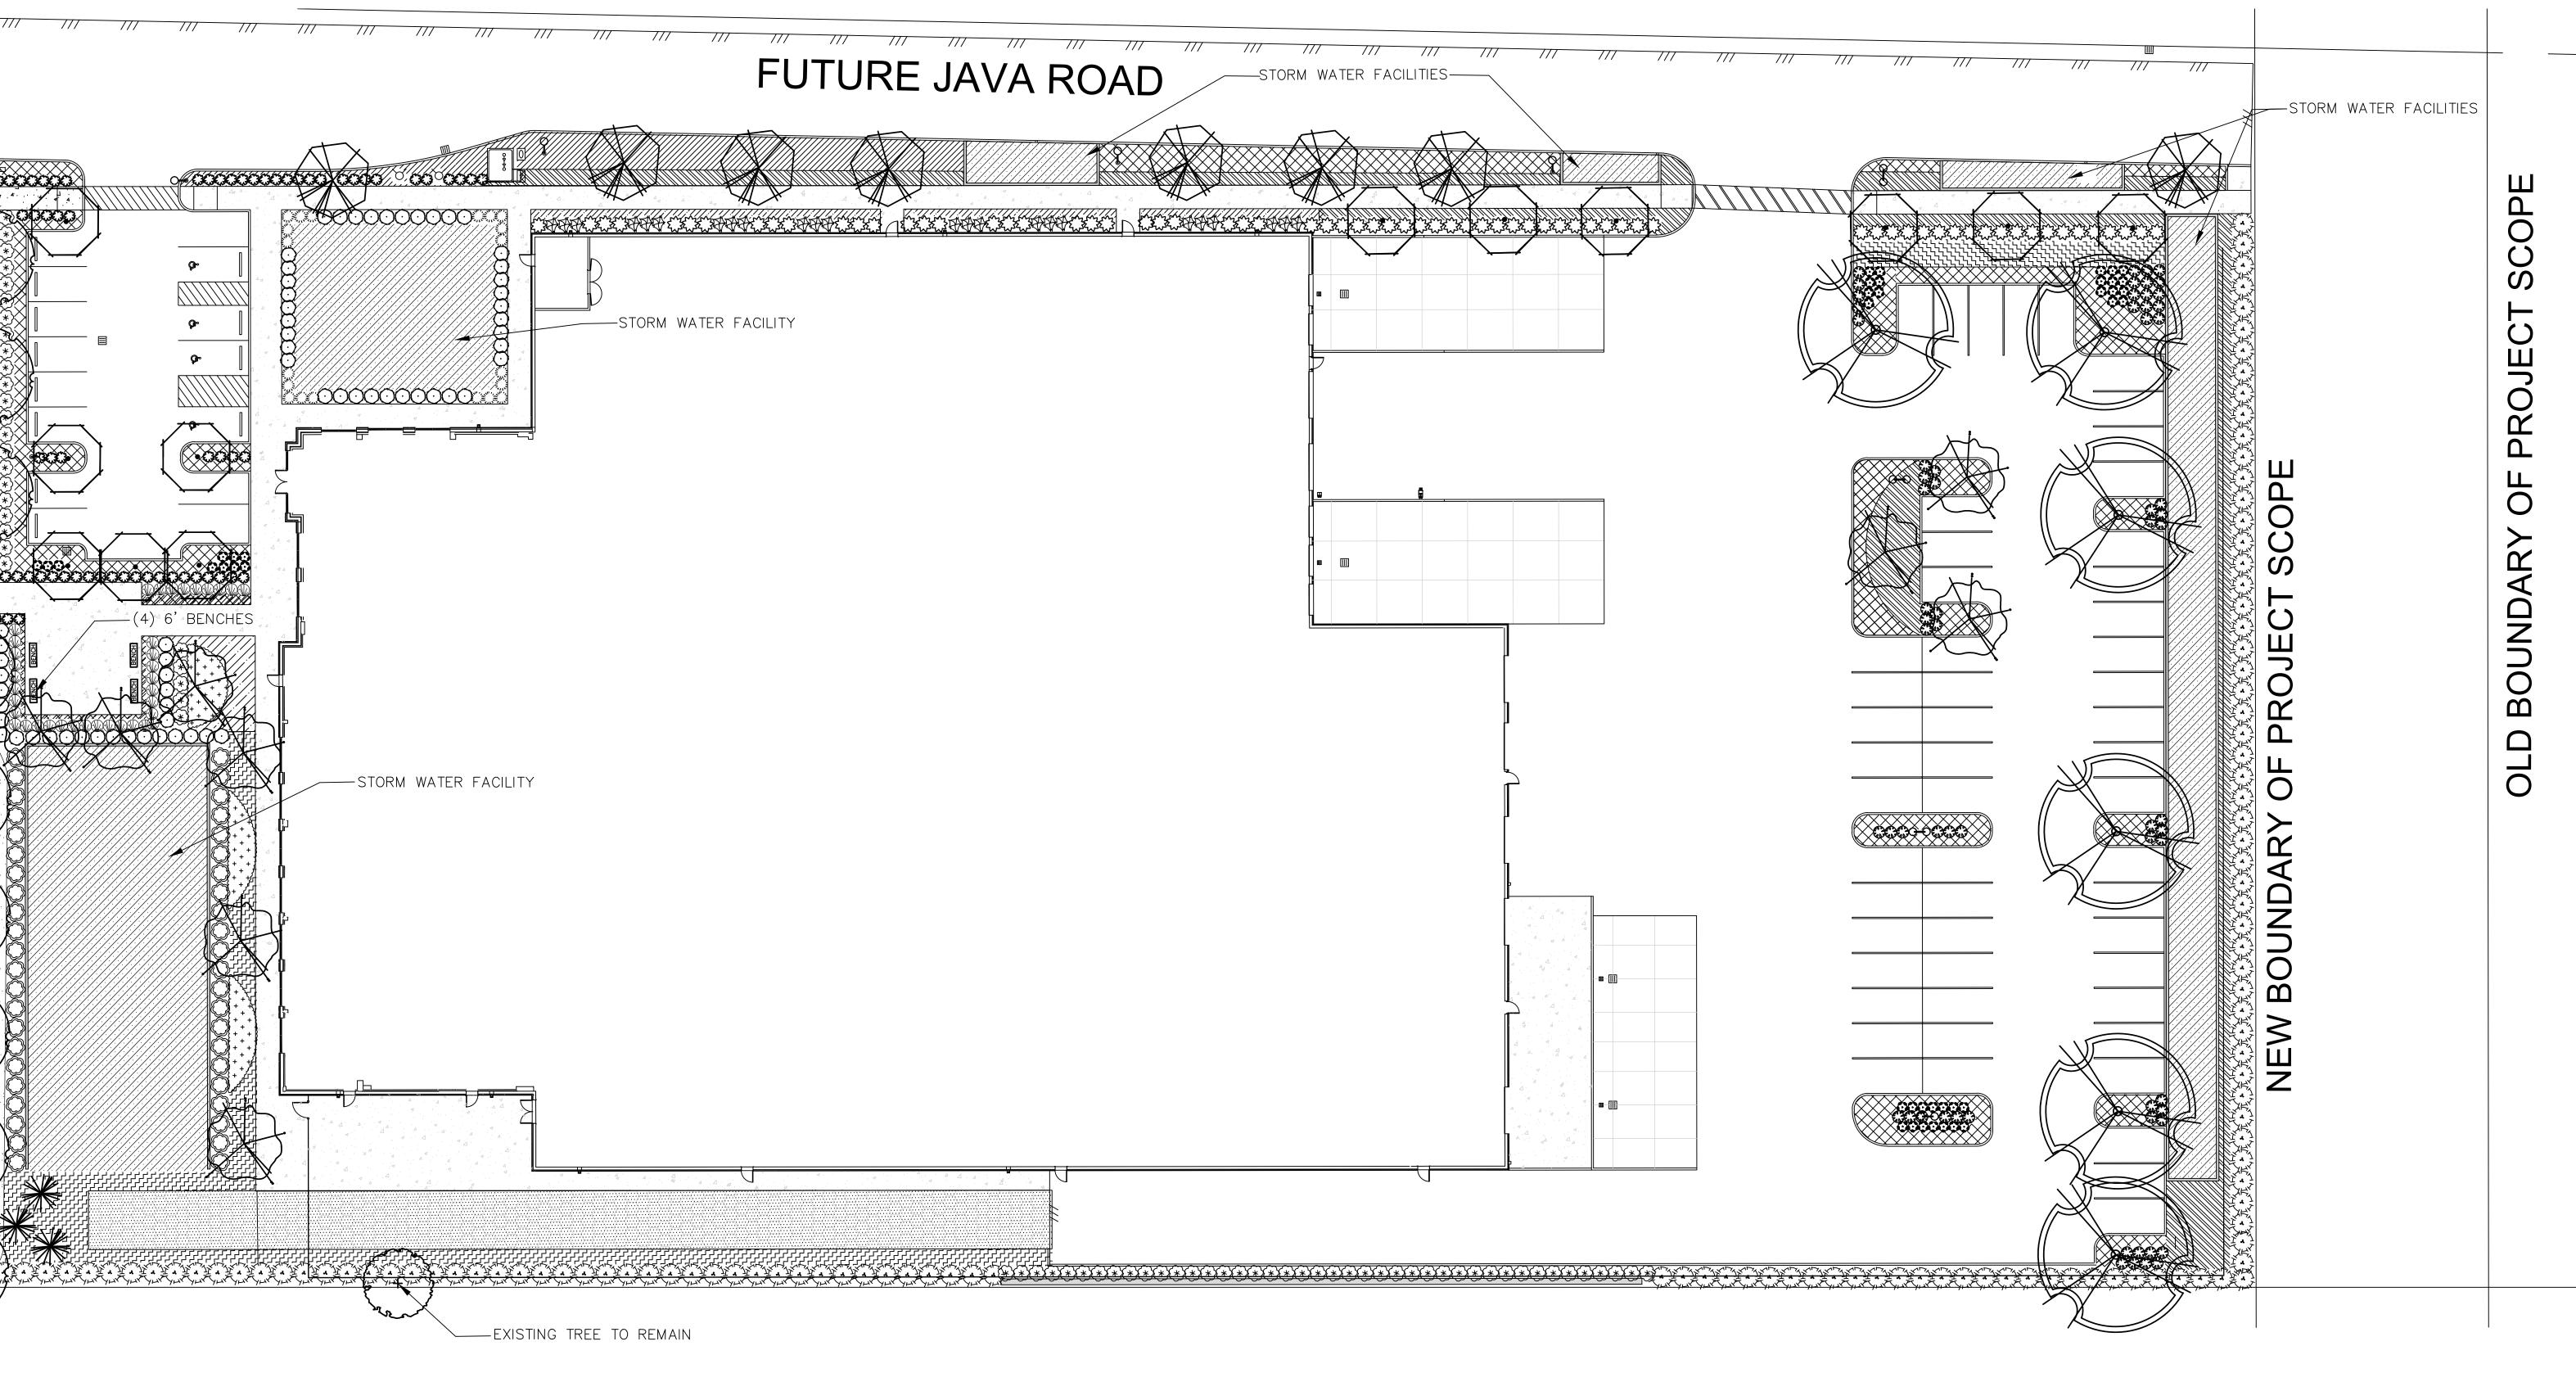




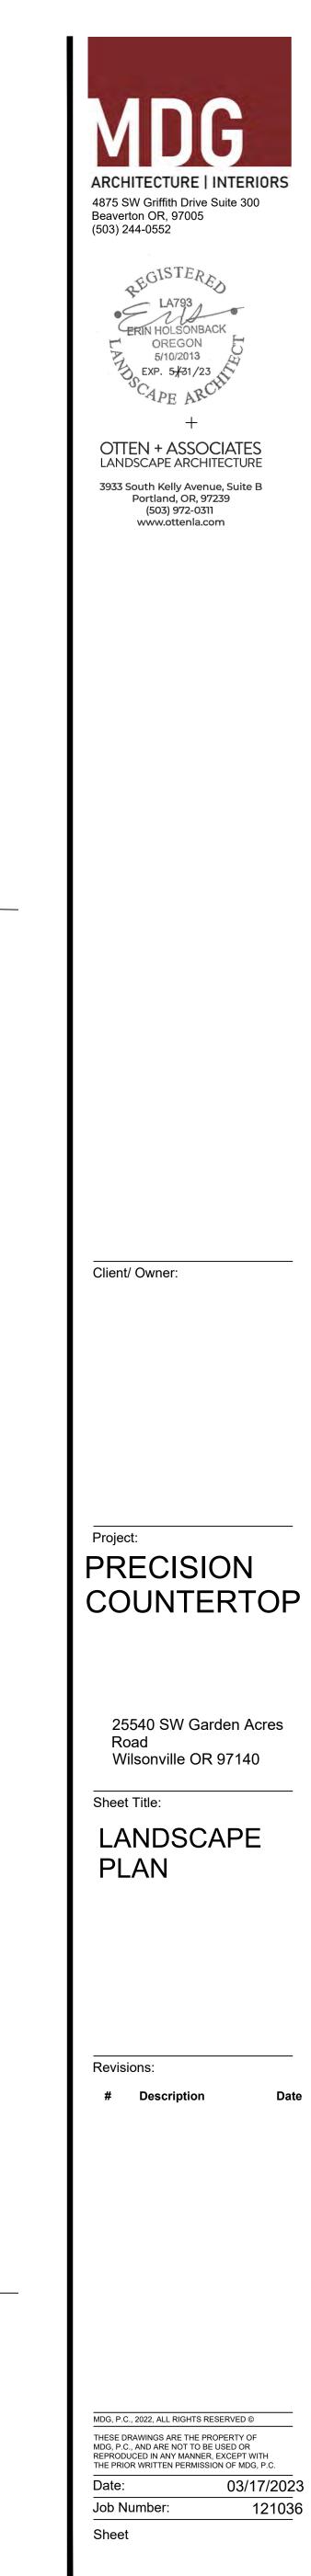



L1.0

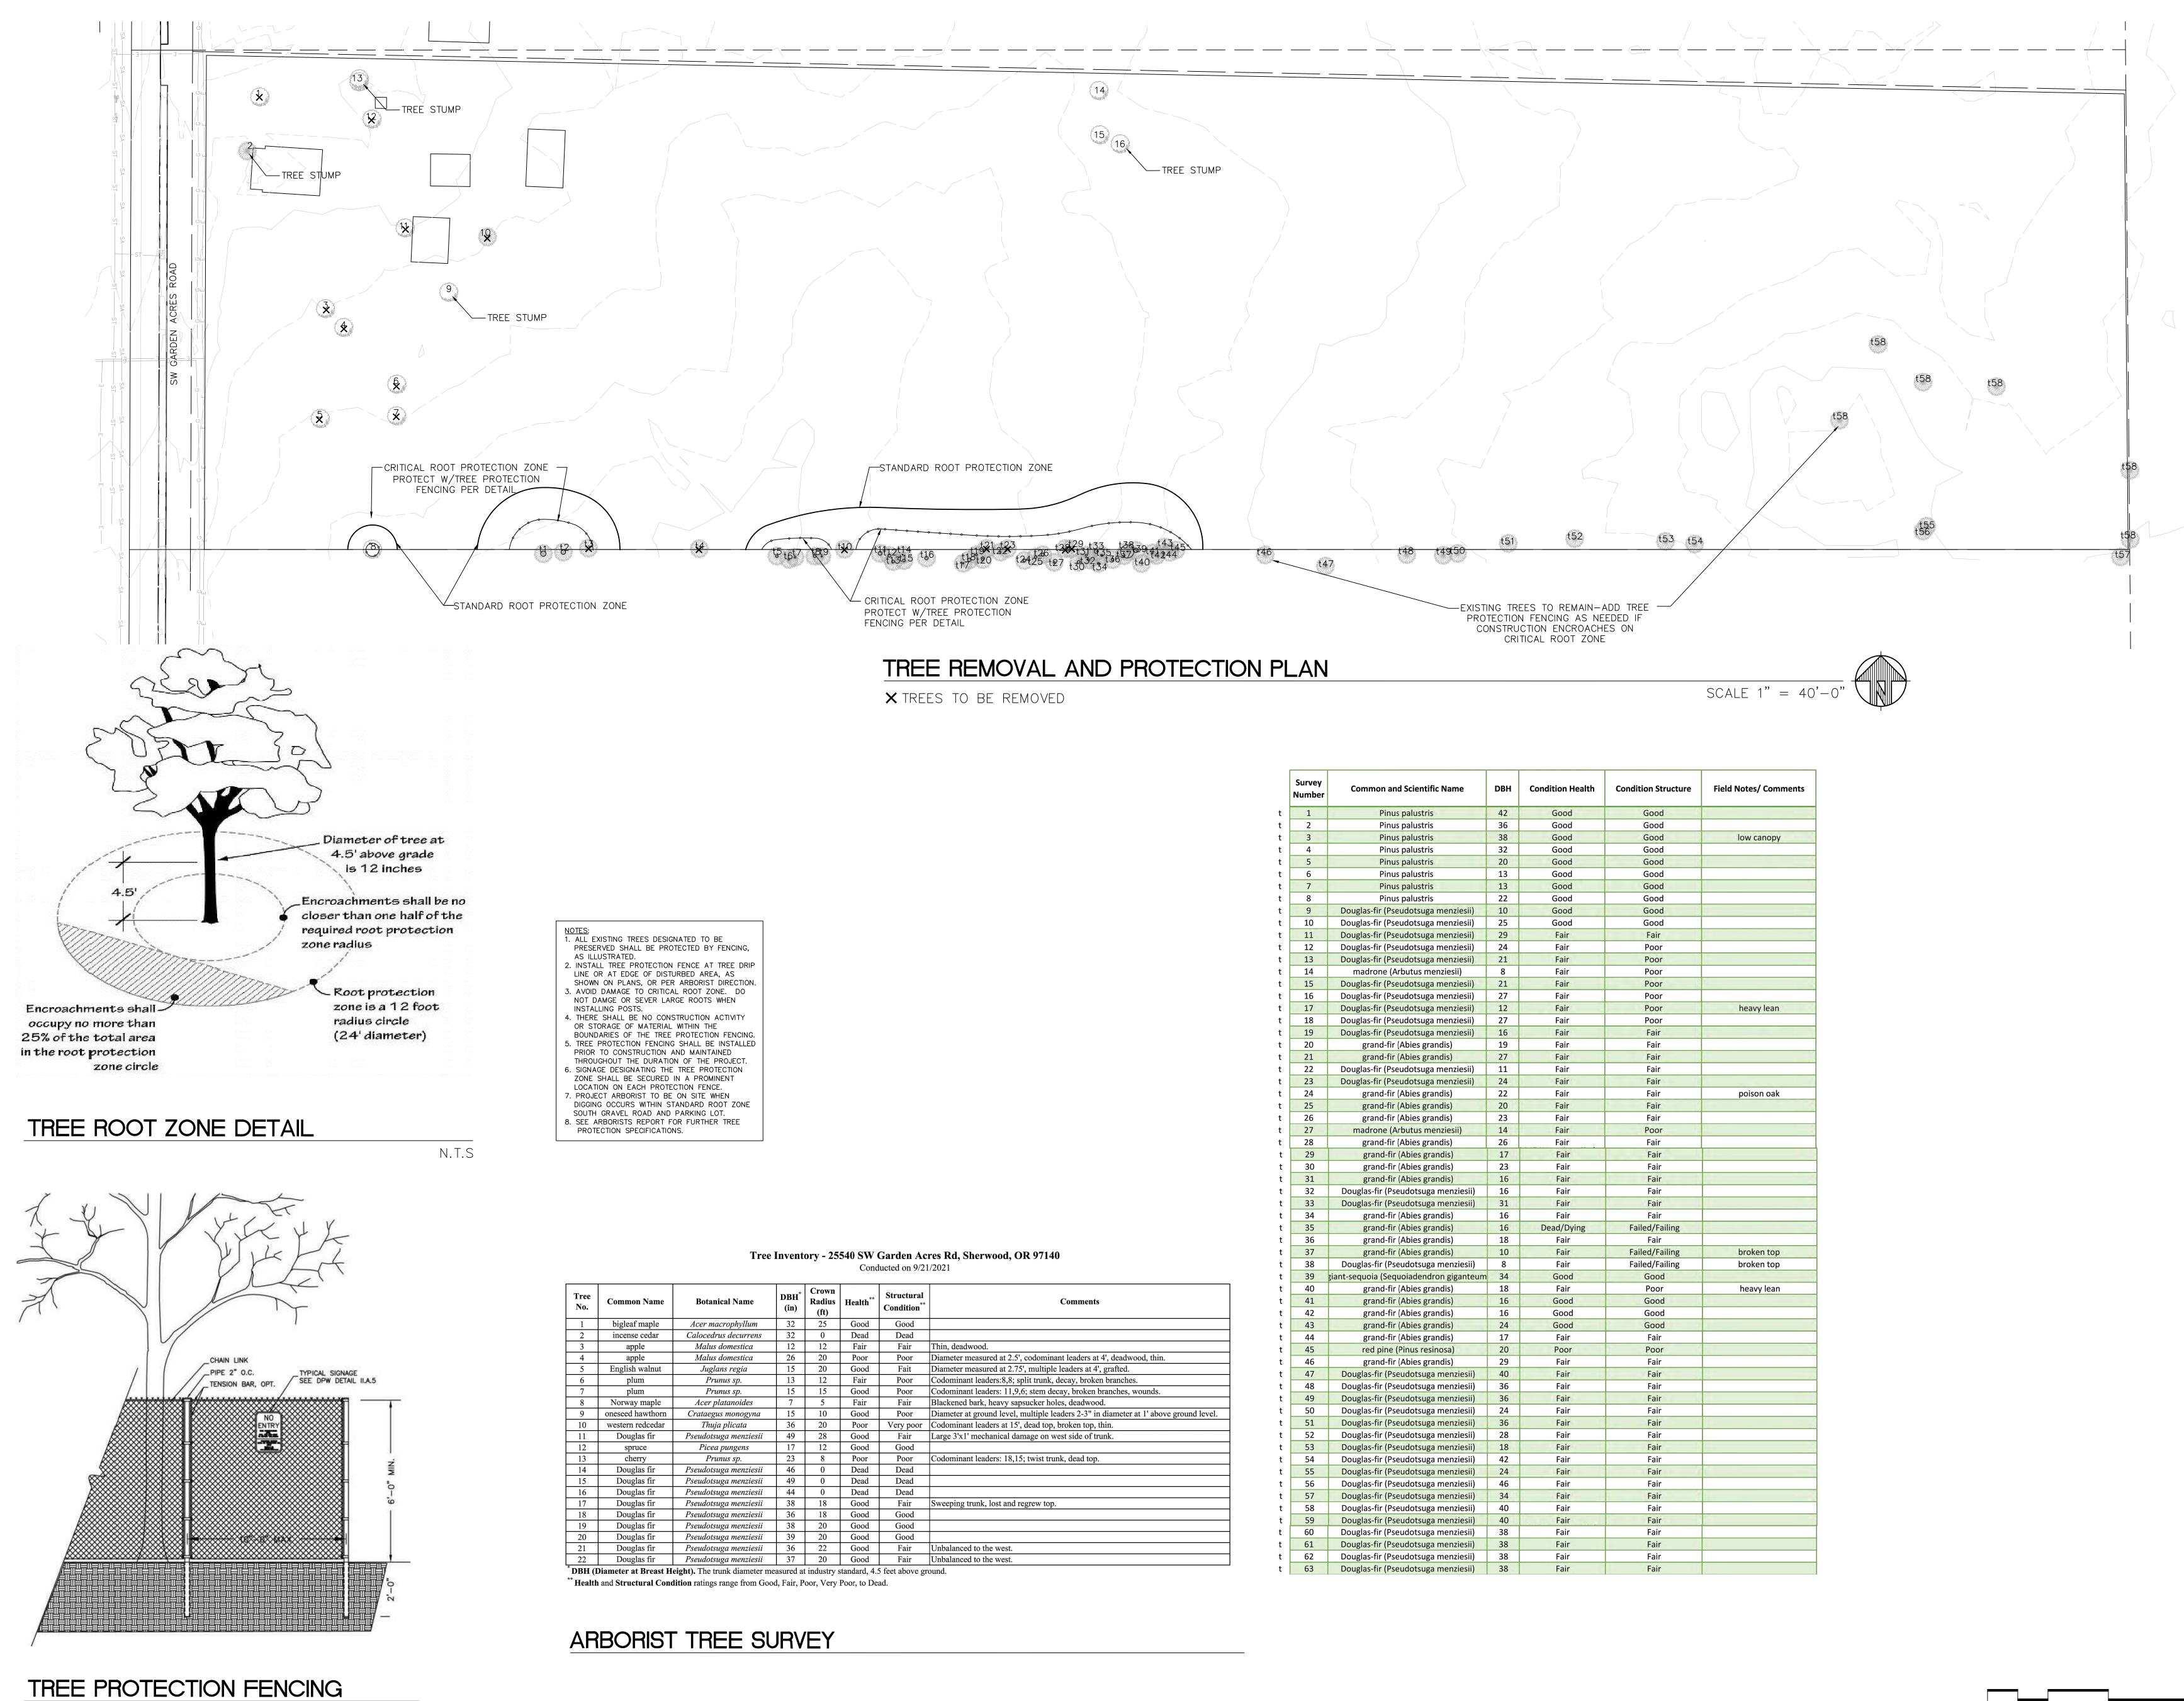

N.T.S

Survey Number	Common and Scier
1	Pinus palus
2	Pinus palus
3	Pinus palus
4	Pinus palus
5	Pinus palus
7	Pinus palus Pinus palus
8	Pinus palus Pinus palus
9	Douglas-fir (Pseudots
10	Douglas-fir (Pseudots
11	Douglas-fir (Pseudots
12	Douglas-fir (Pseudots
13	Douglas-fir (Pseudots
14	madrone (Arbutus
15	Douglas-fir (Pseudots
16	Douglas-fir (Pseudots)
17 18	Douglas-fir (Pseudots Douglas-fir (Pseudots
18	Douglas-fir (Pseudots
20	grand-fir (Abies
21	grand-fir (Abies
22	Douglas-fir (Pseudots
23	Douglas-fir (Pseudots
24	grand-fir (Abies
25	grand-fir (Abies
26	grand-fir (Abies
27	madrone (Arbutus
28	grand-fir (Abies
29 30	grand-fir (Abies grand-fir (Abies
31	grand-fir (Abies
32	Douglas-fir (Pseudots
33	Douglas-fir (Pseudots
34	grand-fir (Abies
35	grand-fir (Abies
36	grand-fir (Abies
37	grand-fir (Abies
38	Douglas-fir (Pseudots
39 40	giant-sequoia (Sequoiade
40	grand-fir (Abies grand-fir (Abies
41	grand-fir (Abies
43	grand-fir (Abies
44	grand-fir (Abies
45	red pine (Pinus i
46	grand-fir (Abies
47	Douglas-fir (Pseudots
48	Douglas-fir (Pseudots
49	Douglas-fir (Pseudots
50 51	Douglas-fir (Pseudots Douglas-fir (Pseudots
51	Douglas-fir (Pseudots Douglas-fir (Pseudots
53	Douglas-fir (Pseudots
54	Douglas-fir (Pseudots
55	Douglas-fir (Pseudots
56	Douglas-fir (Pseudots
57	Douglas-fir (Pseudots
58	Douglas-fir (Pseudots
59	Douglas-fir (Pseudots
60	Douglas-fir (Pseudots
61	Douglas-fir (Pseudots
62 63	Douglas-fir (Pseudots Douglas-fir (Pseudots
	the combine this (Descondate)

r runus sp.	15	12	гап	FOOL	Codominant leaders.8,8, spint trunk, decay, broken branches.
Prunus sp.	15	15	Good	Poor	Codominant leaders: 11,9,6; stem decay, broken branches, wounds.
Acer platanoides	7	5	Fair	Fair	Blackened bark, heavy sapsucker holes, deadwood.
Crataegus monogyna	15	10	Good	Poor	Diameter at ground level, multiple leaders 2-3" in diameter at 1' above ground
Thuja plicata	36	20	Poor	Very poor	Codominant leaders at 15', dead top, broken top, thin.
Pseudotsuga menziesii	49	28	Good	Fair	Large 3'x1' mechanical damage on west side of trunk.
Picea pungens	17	12	Good	Good	
Prunus sp.	23	8	Poor	Poor	Codominant leaders: 18,15; twist trunk, dead top.
Pseudotsuga menziesii	46	0	Dead	Dead	
Pseudotsuga menziesii	49	0	Dead	Dead	
Pseudotsuga menziesii	44	0	Dead	Dead	
Pseudotsuga menziesii	38	18	Good	Fair	Sweeping trunk, lost and regrew top.
Pseudotsuga menziesii	36	18	Good	Good	
Pseudotsuga menziesii	38	20	Good	Good	
Pseudotsuga menziesii	39	20	Good	Good	
Pseudotsuga menziesii	36	22	Good	Fair	Unbalanced to the west.
Pseudotsuga menziesii	37	20	Good	Fair	Unbalanced to the west.
ght). The trunk diameter mea	asured at	t industry s	standard, 4.5	5 feet above gr	ound.

Name	DBH	Condition Health	Condition Structure	Field Notes/ Comments
	42	Good	Good	
	36	Good	Good	
	38	Good	Good	low canopy
	32	Good	Good	
	20	Good	Good	
	13	Good	Good	
	13	Good	Good	
a main all	22	Good	Good	
enziesii)	10	Good Good	Good Good	
enziesii) enziesii)	25	Fair	Fair	
enziesii)	29 24	Fair	Poor	
enziesii)	24	Fair	Poor	
iesii)	8	Fair	Poor	
enziesii)	21	Fair	Poor	
enziesii)	27	Fair	Poor	
enziesii)	12	Fair	Poor	heavy lean
enziesii)	27	Fair	Poor	neavy lean
enziesii)	16	Fair	Fair	
is)	10	Fair	Fair	
is)	27	Fair	Fair	
enziesii)	11	Fair	Fair	
enziesii)	24	Fair	Fair	
is)	22	Fair	Fair	poison oak
is)	20	Fair	Fair	poison oak
is)	23	Fair	Fair	
iesii)	14	Fair	Poor	
is)	26	Fair	Fair	
is)	17	Fair	Fair	
is)	23	Fair	Fair	
is)	16	Fair	Fair	
enziesii)	16	Fair	Fair	
enziesii)	31	Fair	Fair	
is)	16	Fair	Fair	
is)	16	Dead/Dying	Failed/Failing	
is)	18	Fair	Fair	
is)	10	Fair	Failed/Failing	broken top
enziesii)	8	Fair	Failed/Failing	broken top
giganteum	34	Good	Good	ыокентор
is)	18	Fair	Poor	heavy lean
is)	16	Good	Good	
is)	16	Good	Good	
is)	24	Good	Good	
is)	17	Fair	Fair	
sa)	20	Poor	Poor	
is)	29	Fair	Fair	
enziesii)	40	Fair	Fair	
enziesii)	36	Fair	Fair	
enziesii)	36	Fair	Fair	
enziesii)	24	Fair	Fair	
enziesii)	36	Fair	Fair	
enziesii)	28	Fair	Fair	
enziesii)	18	Fair	Fair	
enziesii)	42	Fair	Fair	
enziesii)	24	Fair	Fair	
enziesii)	46	Fair	Fair	
enziesii)	34	Fair	Fair	
enziesii)	40	Fair	Fair	
enziesii)	40	Fair	Fair	
enziesii)	38	Fair	Fair	
enziesii)	38	Fair	Fair	
enziesii)	38	Fair	Fair	
enziesii)	38	Fair	Fair	

0 20' 40' 80' DESIGN REVIEW SET 03/20/2023

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 LA793 OREGON 5/10/2013 ∑ EXP. 5∦31/23 OTTEN + ASSOCIATES LANDSCAPE ARCHITECTURE 3933 South Kelly Avenue, Suite B Portland, OR, 97239 (503) 972-0311 www.ottenla.com Client/ Owner: Project: PRECISION COUNTERTOP 25540 SW Garden Acres Road Wilsonville OR 97140 Sheet Title: TREE REMOVAL AND PROTECTION PLAN Revisions: # Description MDG, P.C., 2022, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 03/20/2023 Date: 121036 Job Number: Sheet

L1.1

OUTLINE SPECIFICATIONS PLANTING AND SEEDING:

GENERAL: All plants shall conform to all applicable standards of the latest edition of the "American Association of Nurserymen Standards", A.N.S.I. Z60.1 – 1973. Meet or exceed the regulations and laws of Federal, State, and County regulations, regarding the inspection of plant materials, certified as free from hazardous insects, disease, and noxious weeds, and certified fit for sale in Oregon.

The apparent silence of the Specifications and Plans as to any detail, or the apparent omission from them of a detailed description concerning any point, shall be regarded as meaning that only the best general practice is to prevail and that only material and workmanship of first quality are to be used. All interpretations of these Specifications shall be made upon the basis above stated.

Landscape contractor shall perform a site visit prior to bidding to view existing conditions.

PERFORMANCE QUALITY ASSURANCE: Use adequate numbers of skilled workmen who are thoroughly trained and experienced in the necessary horticultural practices and who are completely familiar with the specified requirements and methods needed for the proper performance of the work of this section.

NOTIFICATION: Give Landscape Architect minimum of 2 days advance notice of times for inspections. Inspections at growing site does not preclude Landscape Architect's right of rejection of deficient materials at project site. Each plant failing to meet the above mentioned "Standards" or otherwise failing to meet the specified requirements as set forth shall be rejected and removed immediately from the premises by the Contractor and at his expense, and replaced with satisfactory plants or trees conforming to the specified requirements.

SUBSTITUTIONS: Only as approved by the Landscape Architect or the Owner's Representative.

GUARANTEE AND REPLACEMENT: All plant material shall be guaranteed from final acceptance for one full growing season or one year, whichever is longer. During this period the Contractor shall replace any plant material that is not in good condition and producing new growth (except that material damaged by severe weather conditions, due to Owner's negligence, normally unforeseen peculiarities of the planting site, or lost due to vandalism). Guarantee to replace, at no cost to Owner, unacceptable plant materials with plants of same variety, age, size and quality as plant originally specified. Conditions of guarantee on replacement plant shall be same as for original plant.

Landscape Contractor shall keep on site for Owner's Representative's inspection, all receipts for soil amendment and topsoil deliveries. **PROTECTION**: Protect existing roads, sidewalks, and curbs, landscaping, and other features remaining as final work. Verify location of underground utilities prior to doing work.

Repair and make good any damage to service lines, existing features, etc. caused by landscaping installation. PLANT QUALITY ASSURANCE: Deliver direct from nursery. Maintain and protect roots of plant material from drying or other possible injury. Store plants in shade and protect them from weather immediately upon delivery, if not to be planted within four hours.

Nursery stock shall be healthy, well branched and rooted, formed true to variety and species, full foliaged, free of disease, injury, defects, insects, weeds, and weed roots. Trees shall have straight trunks, symmetrical tips, and have an intact single leader. Any trees with double leaders will be rejected upon inspection. All Plants: True to name, with one of each bundle or lot tagged with the common and botanical name and size of the plants in accordance with standards of practice of the American Association of Nurserymen, and shall conform to the <u>Standardized Plant Names</u>, 1942 Edition.

Container grown stock: Small container-grown plants, furnished in removable containers, shall be well rooted to ensure healthy growth. Grow container plants in containers a minimum of one year prior to delivery, with roots filling container but not root bound. Bare root stock: Roots well-branched and fibrous. Balled and burlapped (B&B): Ball shall be of natural size to ensure healthy growth. Ball shall be firm and the burlap sound. No loose or made ball will be acceptable.

TOPSOIL AND FINAL GRADES: Landscape Contractor is to supply and place 12" of topsoil in planting beds and 6" in lawn areas. Landscape Contractor is to verify with the General Contractor if the on-site topsoil is or is not conducive to proper plant growth. The topsoil shall be a sandy loam, free of all weeds and debris inimical to lawn or plant growth. Furnish soil analysis by a qualified soil testing laboratory stating percentages of organic matter; gradation of sand, silt and clay content; cation exchange capacity; deleterious material; pH; and plant nutrient content of the topsoil. Report suitablility of topsoil for plant growth and recommended quantities of nitrogen, phosphorus and potash nutrients and soil amendments (including compost) to be added to produce satisfactory topsoil. If stockpiled topsoil on site is not conducive to proper plant growth, the Landscape Contractor shall import the required amount.

Landscaping shall include finished grades and even distribution of topsoil to meet planting requirements. Grades and slopes shall be as indicated. Planting bed grades shall be approximately 3" below adjacent walks, paving, finished grade lines, etc., to allow for bark application. Finish grading shall remove all depressions or low areas to provide positive drainage throughout the area.

PLANTING SPECIFICATIONS:

HERBICIDES: Prior to soil preparation, all areas showing any undesirable weed or grass growth shall be treated with Round-up in strict accordance with the manufacturer's instructions.

SOIL PREPARATION: Work all areas by rototilling to a minimum depth of 8". Remove all stones (over 1½" size), sticks, mortar, large clumps of vegetation, roots, debris, or extraneous matter turned up in working. Soil shall be of a homogeneous fine texture. Level, smooth and lightly compact area to plus or minus .10 of required grades.

In groundcover areas add 2" of compost (or as approved) and till in to the top 6" of soil.

PLANTING HOLE: Lay out all plant locations and excavate all soils from planting holes to 2 1/2 times the root ball or root system width. Loosen soil inside bottom of plant hole. Dispose of any "subsoil" or debris from excavation. Check drainage of planting hole with water, and adjust any area showing drainage problems. **SOIL MIX:** Prepare soil mix in each planting hole by mixing:

2 part native topsoil (no subsoil)

1 part compost (as approved)

Thoroughly mix in planting hole and add fertilizers at the following rates:

Small shrubs - 1/8 lb./ plant Shrubs - 1/3 to 1/2 lb./ plant

Trees - 1/3 to 1 lb./ plant

FERTILIZER: For trees and shrubs use Commercial Fertilizer "A" Inorganic (5-4-3) with micro-nutrients and 50% slow releasing nitrogen. For initial application in fine seed lawn areas use Commercial Fertilizer "B" (8-16-8) with micro-nutrients and 50% slow-releasing nitrogen. For lawn maintenance use Commercial Fertilizer "C" (22-16-8) with micro-nutrients and 50% slow-releasing nitrogen. <u>DO NOT</u> apply fertilizer to Water Quality Swale.

PLANTING TREES AND SHRUBS: Plant upright and face to give best appearance or relationship to adjacent plants and structures. Place 6" minimum, lightly compacted layer of prepared planting soil under root system. Loosen and remove twine binding and burlap from top 1/2 of root balls. Cut off cleanly all broken or frayed roots, and spread roots out. Stagger Plants in rows. Backfill planting hole with soil mix while working each layer to eliminate voids.

When approximately 2/3 full, water thoroughly, then allow water to soak away. Place remaining backfill and dish surface around plant to hold water. Final grade should keep root ball slightly above surrounding grade, not to exceed 1". Water again until no more water is absorbed. Initial watering by irrigation system is not allowed. STAKING OF TREES: Stake or guy all trees. Stakes shall be 2" X 2" (nom.) quality tree stakes with point. They shall be of Douglas Fir, clear and sturdy. Stake to be

minimum 2/3 the height of the tree, not to exceed 8'-0". Drive stake firmly 1'-6" below the planting hole. Tree ties for deciduous trees shall be "Chainlock" (or better). For Evergreen trees use "Gro-Strait" Tree Ties (or a reinforced rubber hose and guy wires) with guy wires of a minimum 2 strand twisted 12 ga. wire. Staking and guying shall be loose enough to allow movement of tree while holding tree upright. Tree stakes shall be removed after one year.

MULCHING OF PLANTINGS: Mulch planting areas with dark, aged, medium grind fir or hemlock bark (aged at least 6 months) to a depth of 2" in ground cover areas and 2½" in shrub beds. Apply evenly, not higher than grade of plant as it came from the nursery, and rake to a smooth finish. Water thoroughly, then hose down planting area with fine spray to wash leaves of plants.


FINE LAWN AREAS: In fine lawn area apply Commercial Fertilizer Mix "B" at 4.5 lbs. Per 1,000 sq.ft. and rake into soil surface. Establish an even, fine textured seedbed meeting grades, surfaces and texture. Sow seed with a mechanical spreader at the uniform rates as noted below. Rake seed lightly to provide cover. ROUGH SEED AREA: In rough seeded area, establish an evenly graded seedbed. Sow seed with a mechanical spreader at the uniform rates as noted below. Rake seed


lightly to provide cover.

SEED: Bluetag grass seed conforming to applicable State laws. No noxious weed seeds. Submit Guaranteed analysis. Fine Lawn Seed Mix: To contain 50% Top Hat Perennial Ryegrass, 30% Derby Supreme Ryegrass, 20% Longfellow Chewings Fescue (Hobbs and Hopkins Pro-Time 303 Lawn Mix or as approved) Sow Seed at 5 lbs. / 1000 sq. ft. Rough Seed Mix: To Contain: 60% Perennial Ryegrass, 15% Eureka Hard Fescue, and 20% Herbaceous Plants and Clover (Hobbs and Hopkins Pro-Time 705 PDX, or approved equal). Sow at 2 lbs. Per 1,000 sq.ft.


MAINTENANCE OF SEEDED AREAS:

Fine Lawn Areas: The lawn areas shall be maintained by watering, mowing, reseeding, and weeding for a minimum of 60 days after seeding. After 30 days, or after the second mowing, apply Commercial Fertilizer Mix "C" at 5 lbs. per 1,000 sq. ft. Mow and keep at 1½" to 2" in height. Remove clippings and dispose of off site. GENERAL MAINTENANCE: Protect and maintain work described in these specifications against all defects of materials and workmanship, through final acceptance. Replace plants not in normal healthy condition at the end of this period. Water, weed, cultivate, mulch, reset plants to proper grade or upright position, remove dead wood and do necessary standard maintenance operations. Irrigate when necessary to avoid drying out of plant materials, and to promote healthy growth. CLEAN-UP: At completion of each division of work all extra material, supplies, equipment, etc., shall be removed from the site. All walks, paving, or other surfaces shall be swept clean, mulch areas shall have debris removed and any soil cleared from surface. All areas of the project shall be kept clean, orderly and complete.

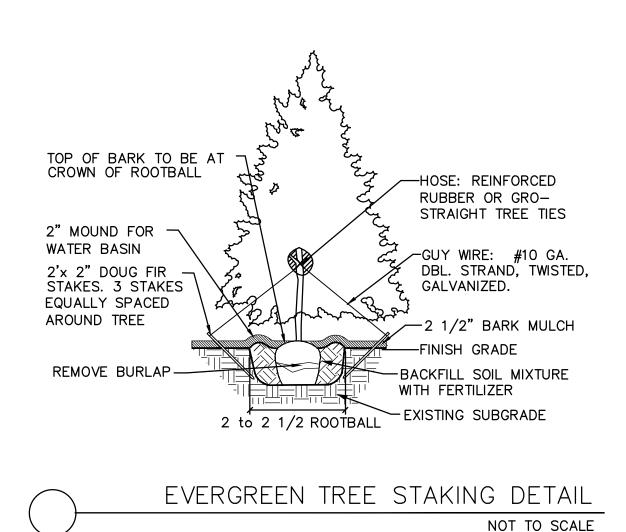


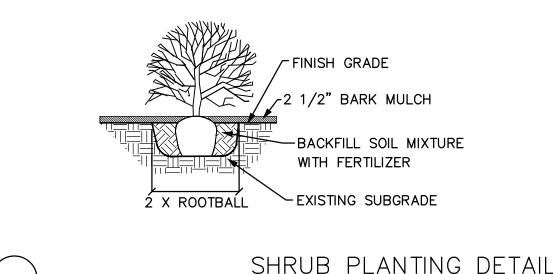


NOT TO SCALE

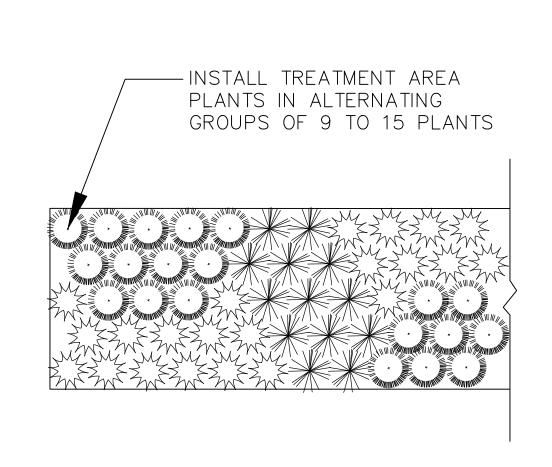


STORMWATER FACILITY PLANTING DETAIL NOT TO SCALE

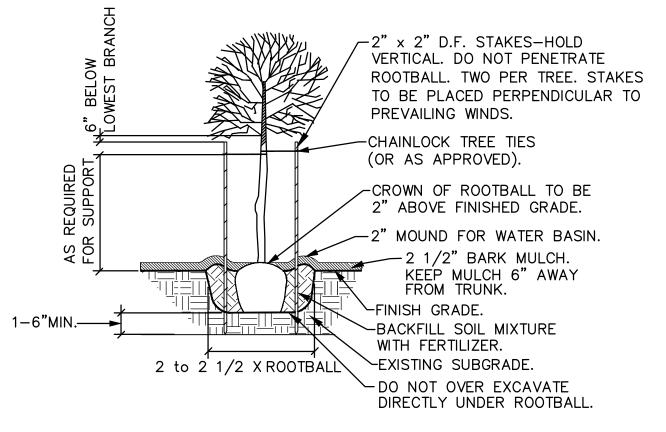



NOTE: ANY PROPOSED CHANGES TO OUR SPECIFICATION OR DETAIL SHOULD BE APPROVED BY THE LANDSCAPE ARCHITECT. LIKEWISE, IN ACCORDANCE WITH BEST PRACTICES OF LOCAL LANDSCAPE INSTALLATION, SHOULD THE LANDSCAPE CONTRACTOR FIND A PREFERRED ALTERNATE METHOD, THE LANDSCAPE ARCHITECT MAY BE SO ADVISED.

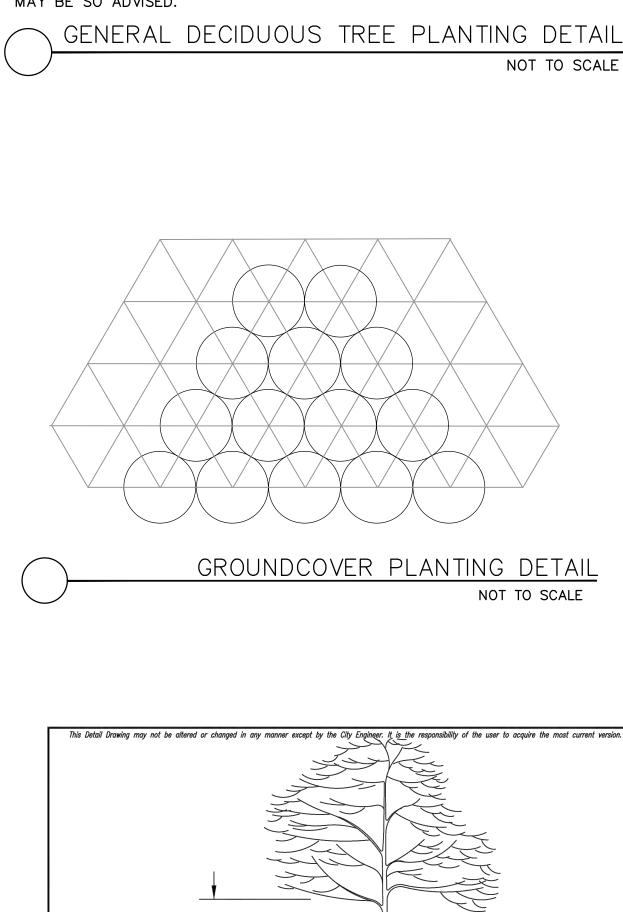

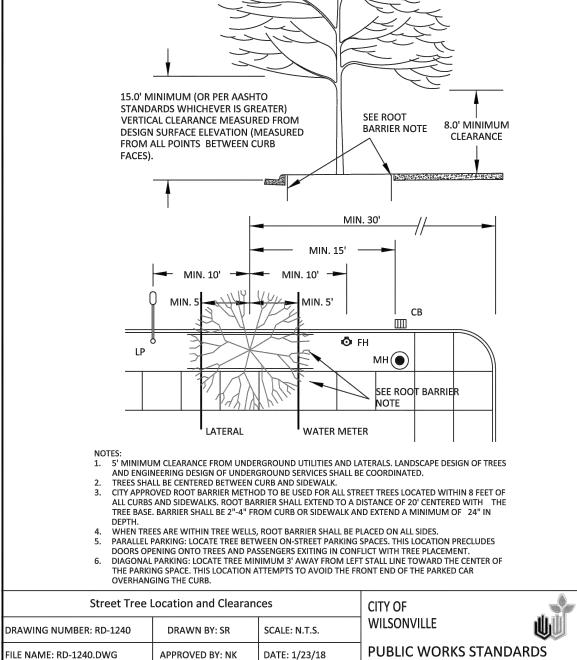

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 FRIN HOLSONBACK OREGON 5/10/2013) EXP. 5/31/23 🔏 **OTTEN + ASSOCIATES** LANDSCAPE ARCHITECTURE 3933 South Kelly Avenue, Suite B Portland, OR, 97239 (503) 972-0311 www.ottenla.com Client/ Owner: Project: PRECISION COUNTERTOP 25540 SW Garden Acres Road Wilsonville OR 97140 Sheet Title: LANDSCAPE SPECIFICATIONS & DETAILS Revisions: # Descriptio MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C 02/06/2023 Date Job Number: 121036 Sheet L2.0

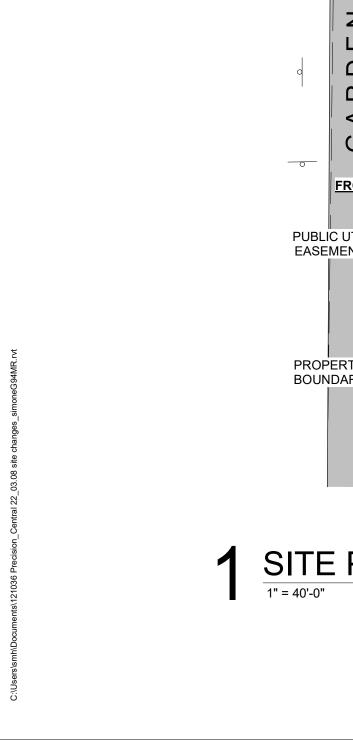

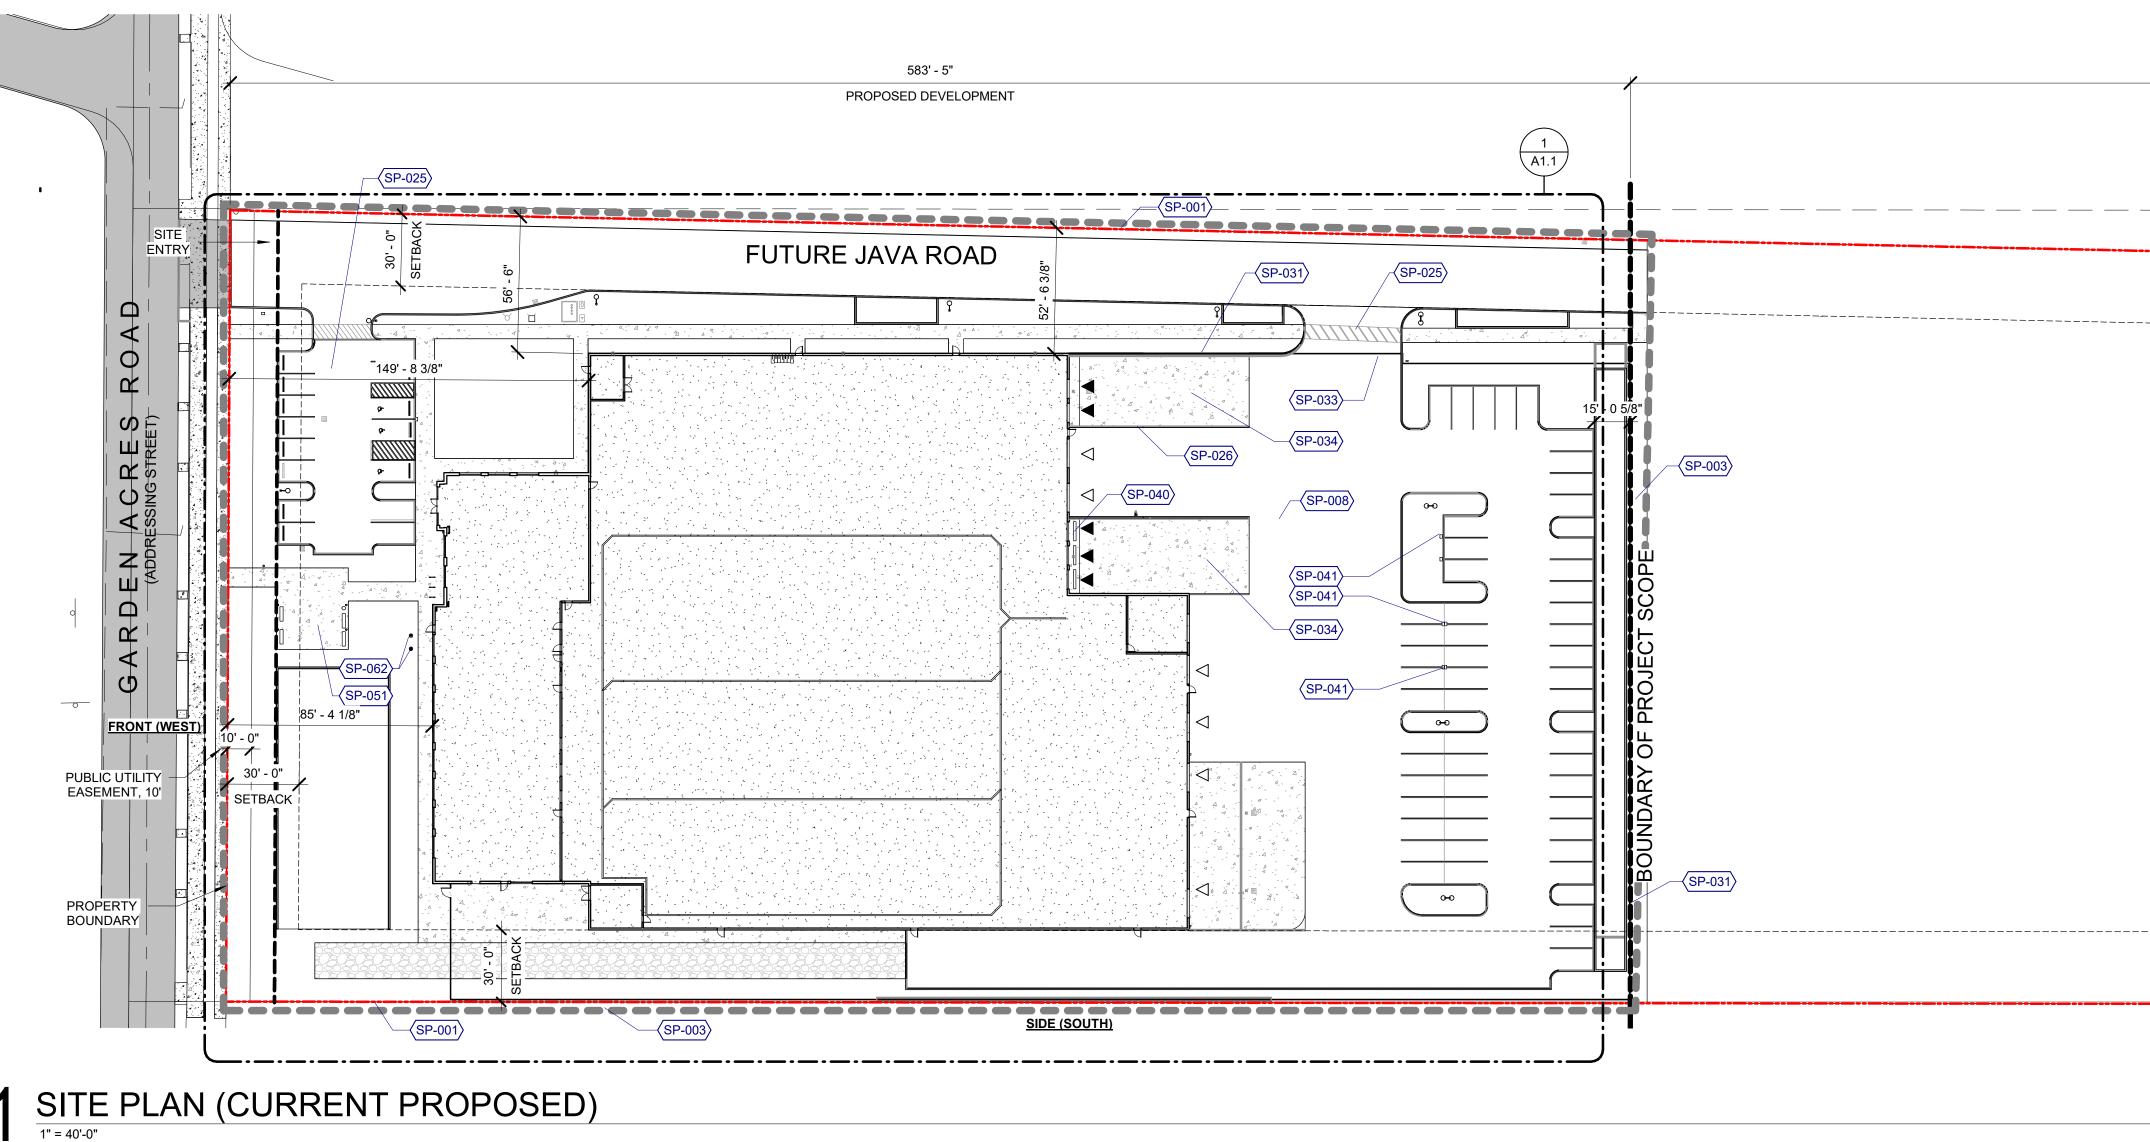

GENERAL NOTES - SITE PLAN

- 1. GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO CONSTRUCTION, CONFLICTS ARE TO BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR
- TO THE START OF CONSTRUCTION RELATED TO SUCH. REFER TO CIVIL DRAWINGS FOR GRADING AND UTILITY INFORMATION. CONTRACTORS SHALL VERIFY ALL LOCATIONS OF EXISTING UTILITIES, CARE SHOULD BE TAKE TO
- AVOID DAMAGE TO OR DISTURBANCE OF EXISTING UTILITIES. REFER TO CIVIL AND LANDSCAPE DRAWINGS FOR ALL PUBLIC RIGHT-OF-WAY IMPROVEMENTS.
- THE CONSTRUCTION SHALL NOT RESTRICT A FIVE-FOOT CLEAR UNOBSTRUCTED ACCESS TO ANY WATER OR POWER DISTRIBUTION FACILITIES (POWER POLES, PULL BOXES, TRANSFORMERS, VAULTS, PUMPS, VALVES, METERS, APPURTENANCES, ETC.) OR THE LOCATION OF THE HOOK-UP.
- 6. THE CONSTRUCTION SHALL NOT BE WITHIN 10' OF ANY POWER LINES WHETHER OR NOT THE POWER LINES ARE LOCATED ON THE PROPERTY. FAILURE TO COMPLY MAY CAUSE
- CONSTRUCTION DELAYS OR ADDITIONAL EXPENSES. 7. FIRE LANES SHALL BE DESIGNED TO SUPPORT A FIRE APPARATUS LOAD OF 75,000 LBS WITH A
- WHEEL LOAD OF 12,500 LBS. 8. DELEGATED DESIGN NFPA 13 FIRE SPRINKLER SYSTEM DESIGNED IN ACCORDANCE WITH OSSC 903.3.1.1 WILL BE A DEFERRED SUBMITTAL.
- 9. FIRE FLOW DEMAND PER OFC APPENDIX B: A. PER TABLE B105.2, SECTION 903.3.1.1 DESIGN STANDARD:
- TABLE B105.1(2) TYPE IIB, 65,071 SF: FIRE FLOW RATE: 2,750 GPM
- FIRE FLOW DURATION: 2 HRS TABLE B105.2 REQUIRED FIRE FLOW - SPRINKLERED PER IFC 903.3.1.1: FIRE FLOW REDUCTION: 2,750 GPM x 0.25 = 687.5 GPM^a ^aTHE REDUCED FIRE FLOW RATE SHALL NOT BE LESS THAN 1,000 GPM

MIN. REQUIRED FIRE FLOW RATE = 1,000 GPM MIN. REQUIRED FIRE FLOW DURATION = 2 HRS

ELECTRIC VEHICLE CHARGING STATION INFRASTRUCTURE SHALL BE PROVIDED IN ACCORDANCE WITH DIVISION 460 STRUCTURAL AND ENERGY EFFICIENCY SPECIALTY CODES SECTION 918-460-0200 SUMMARIZED GENERALLY AS FOLLOWS. CONTRACTOR TO VERIFY REQUIREMENTS AND COMPLY WITH MOST CURRENT REQUIREMENTS.

2A – NO LESS THAN 20%, ROUNDED UP TO THE NEAREST WHOLE NUMBER, OF THE SPACES IN THE GARAGE OR PARKING AREA FOR THE BUILDING; OR 2B – IF LOCAL JURISDICTION REQUIRES MORE THAN THE QUANTITY NOTED IN ITEM 2A ABOVE, SHALL BE IN ACCORDANCE WITH THE LOCAL JURISDICTION'S REQUIREMENTS. 3A – PROVISION OF BUILDING ELECTRICAL SERVICE, SIZED FOR THE ANTICIPATED LOAD OF ELECTRIC VEHICLE CHARGING STATIONS (EVCS'), THAT HAS OVERCURRENT DEVICES NECESSARY FOR EVCS' OR HAS ADEQUATE SPACE TO ADD OVERCURRENT DEVICES; 3B – A DESIGNATED SPACE WITHIN A BUILDING TO ADD ELECTRICAL SERVICE WITH CAPACITY FOR EVCS'; OR 3C – A DESIGNATED LOCATION ON BUILDING PROPERTY, IN OR ADJACENT TO A LANDSCAPED AREA, FOR INSTALLING REMOTE SERVICE FOR EVCS'.

4 – A CONDUIT SYSTEM INSTALLED FROM THE BUILDING ELECTRICAL SERVICE, OR FROM THE DEDICATED SPACE OR LOCATION FOR A FUTURE ELECTRICAL SERVICE AS DESCRIBED IN SUBSECTION 3B OR 3C TO PARKING SPACES THAT CAN SUPPORT, AT A MINIMUM, ELECTRICAL WIRING FOR INSTALLATION OF LEVEL 2 EVCS'. BOTH ENDS OF THE CONDUIT MUST BE LABELED TO SHOW THAT THE CONDUIT IS PROVIDED FOR FUTURE EVCS'. 5 – THE INSTALLATION OF A LEVEL 2 OR BETTER EVCS AT A PARKING SPACE SATISFIES THE INFRASTRUCTURE REQUIREMENTS OF THIS RULE FOR THAT PARKING SPACE. 6 – ALL ELECTRICAL INSTALLATIONS MUST COMPLY WITH THE PROVISIONS OF THE OREGON ELECTRICAL SPECIALTY CODE.

PROPOSED PARKING = 71 STALLS TOTAL PARKING = 71 STALLS X 20% = 14.2 => 15 EVCS STALLS REQUIRED < 15 PROPOSED, OKAY

TOTAL SITE AREA: SITE AREA IN PROJECT SCOPE :

BUILDING AREA: PARKING/ PAVING AREA:

REQUIRED LANDSCAPING:

VEHICLE PARKING: OFFICE

TOTAL

BICYCLE PARKING:

OFFICE

TOTAL

LOADING:

RETAIL/SHOWROOM

MANUFACTURING

WAREHOUSE/STORAGE

(1) OUTRIGHT @ 250 SF

MIN: 10.0'W x 25.0'L x 14.0'H

(1) 30,000 SF - 100,000 SF @ 500 SF

RETAIL/SHOWROOM WAREHOUSE/STORAGE

MANUFACTURING

69 SPACES PROPOSED > 66.6, OKAY

66,002 SF

78,118 SF

1.0 x 6,820/5,000 = 1.4 SPACES, 2.0 REQ'D MIN 1.0 x 2,973/8,000 = 0.4 SPACES, 2.0 REQ'D MIN 1.0 x 36,057/20,000 = 2.0 SPACES, 2.0 REQ'D MIN 1.0x 20,152/10,000 SF = 2.0 SPACES, 6.0 REQ'D MIN 12 SPACES PROPOSED > 12, OKAY PROVIDE 6 SHORT TERM, 6 LONG TERM SPACES

406,233 SF = 9.32 ACRES 189,289 SF = 4.34 ACRES

LOT COVERAGE/ IMPERV AREA: 66,002 SF + 78,118 SF = 144,120 SF 144,120 SF / 189,289 SF = 76.1 %

> 15 % OF TOTAL SITE 189,289 SF x 0.15 = 28,393 SF MIN REQ'D 39,861 SF PROPOSED > 28,393 SF, OKAY

2.7 x 6,820/1,000 = 18.5 SPACES REQ'D MIN, 4.1 x 6,820/1,000 = 28 SPACES MAX

1.67 x 2,973/1,000 = 5 SPACES REQ'D 6.2 x 2,973/1,000 = 18.5 SPACES MAX 0.3 x 36,057/1,000 = 10.8 SPACES REQ'D 0.5 x 36,057/1000 = 18.0 SPACES MAX

1.6 x 20,152/1,000 SF = 32.3 SPACES REQ'D, NO MAX 18.5 + 5.0 + 10.8 + 32.3 = 66.6 SPACED REQ'D

PER OSSC TABLE 1106.1, (3) ACCESSIBLE SPACES INCLUDING (1) VAN SPACE REQ'D

KEYNOTES

SP-001 PROPERTY LINE SP-003 LIMITS OF WORK

SP-008 ASPHALT PAVING SP-025 CROSSWALK, PAINTED

SP-026 CONCRETE SITE WALL, 6"W X 30"H SP-031 FENCE, ORNAMENTAL BLACK BAR, 6'-0"H

SP-033 GATE, ORNAMENTAL BLACK BAR, 20'W MIN CLR. ELECTRIC GATES SHALL BE EQUIPPED WITH A MEANS FOR OPERATION BY FIRE DEPT PERSONNEL

SP-034 CONCRETE LOADING DOCK SLAB SP-040 WHEEL STOP

SP-041 ELECTRIC VEHICLE CHARGING INFRASTRUCTURE PER OAR 918-460-0200 SP-051 WAYSIDE, PLAZA WITH BENCH, WASTE AND RECYCLING RECEPTACLE,


BOLLARD LIGHTING, 960 SF SP-062 (2) FLAG POLES, 20' TALL

PARKING SCHEDULE

Description	Count
9.0' X 15.0' VEHICLE COMPACT SPACE	8
9.0' X 18.0' ACCESSIBLE SPACE	3
9.0' X 18.0' VAN ACCESSIBLE SPACE	1
9.0' X 18.0' VEHICLE STANDARD SPACE	57
	69


AREA SCHEDULE - ZONING

Name	Area
MANUFACTURING	19,545 SF
OFFICE	7,114 SF
SHOWROOM/RETAIL	2,963 SF
WAREHOUSE	36,474 SF
TOTAL AREA :	66,096 SF

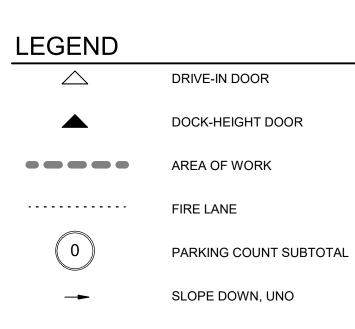

696' - 7 1/4"		
NOT IN PROJECT SCOPE		1
		I
		FROM
		<u> </u>
	30' - 0"	
	SETBAC	к
		PI
		B
	j	
		I



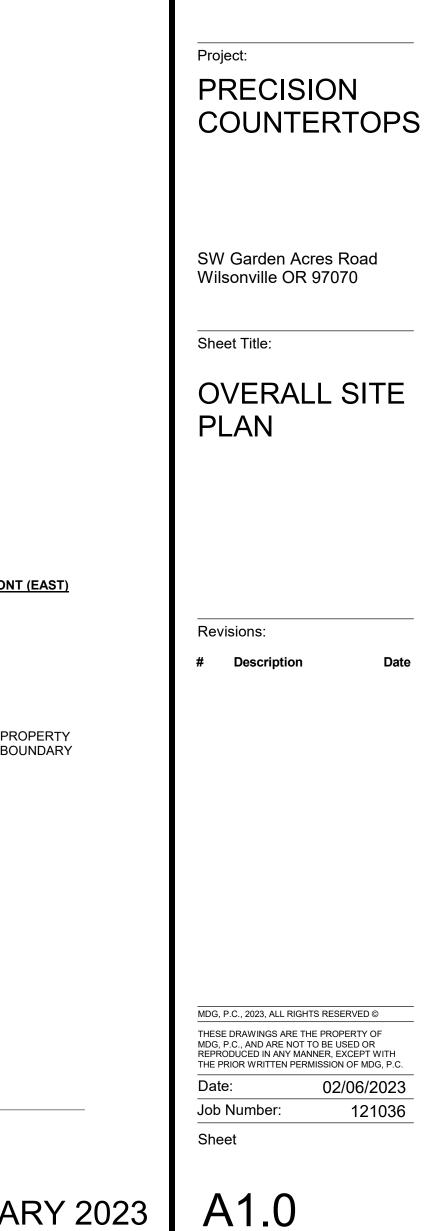


Client/ Owner: PRECISION COUNTERTOPS


26200 SW 95th Ave, Wilsonville OR 97070


uan te TLAND, OREGOI No. 4268 17,



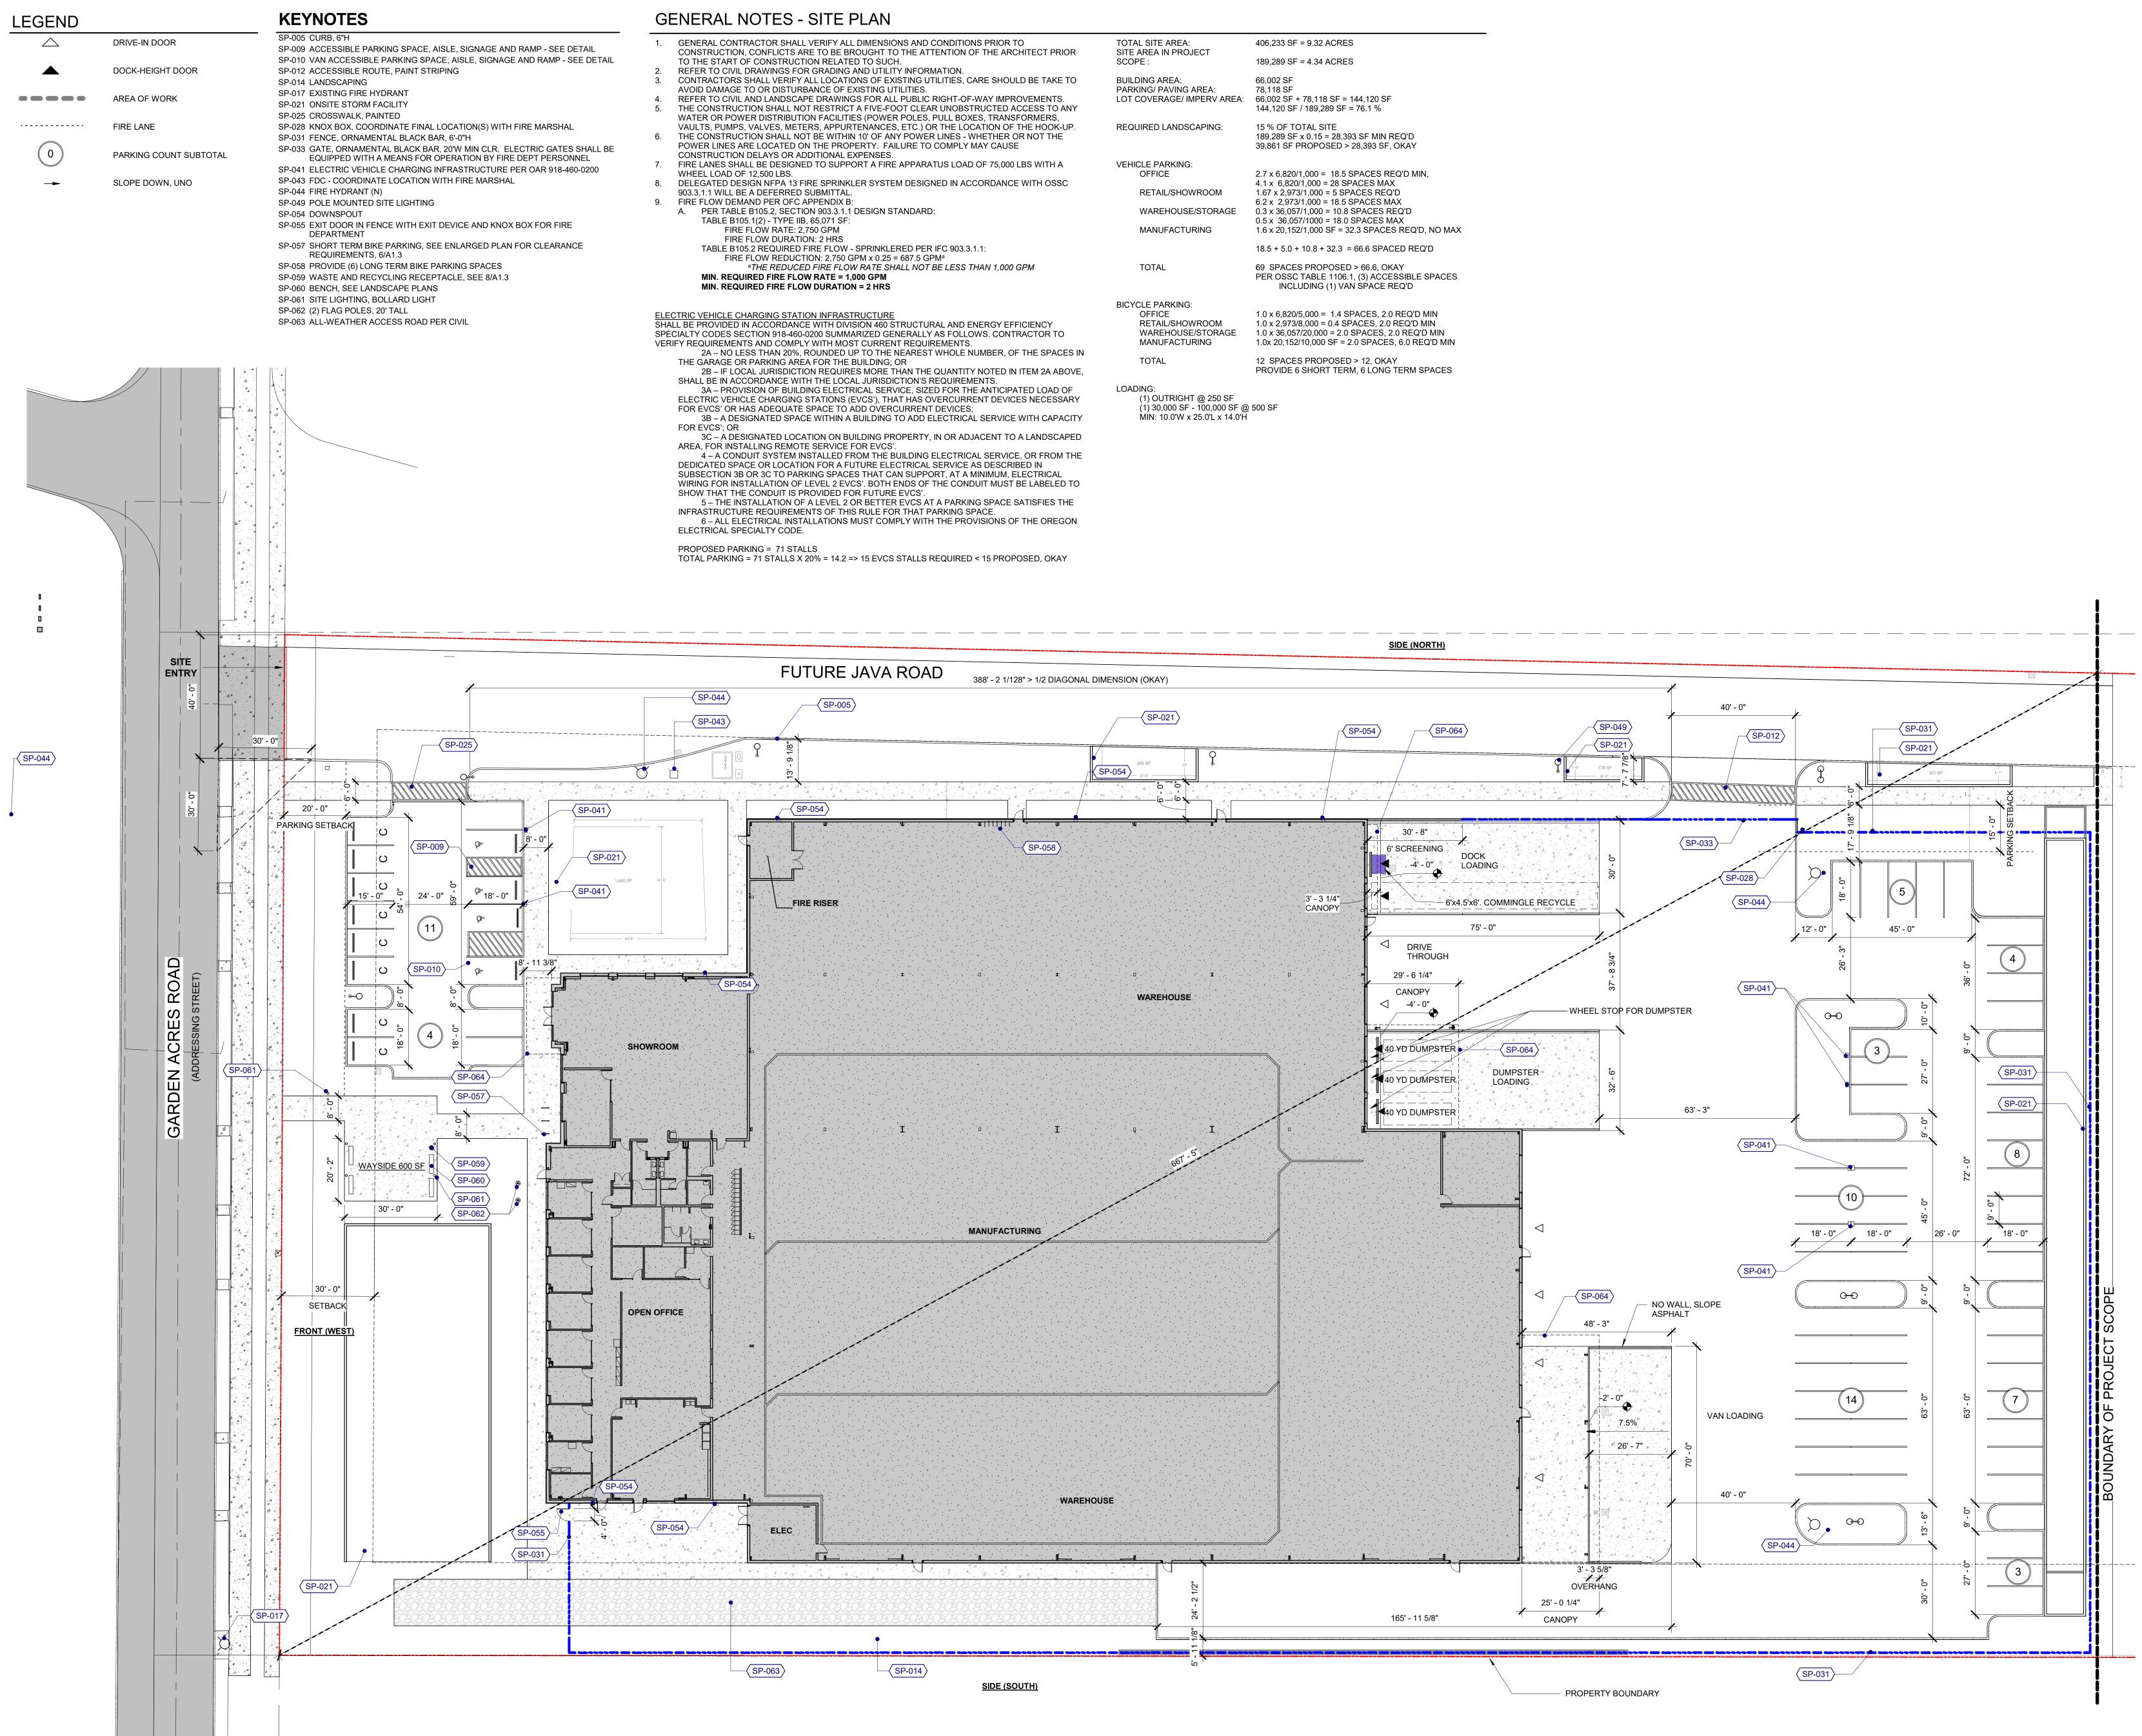

ENLARGED SITE PLAN 1" = 20'-

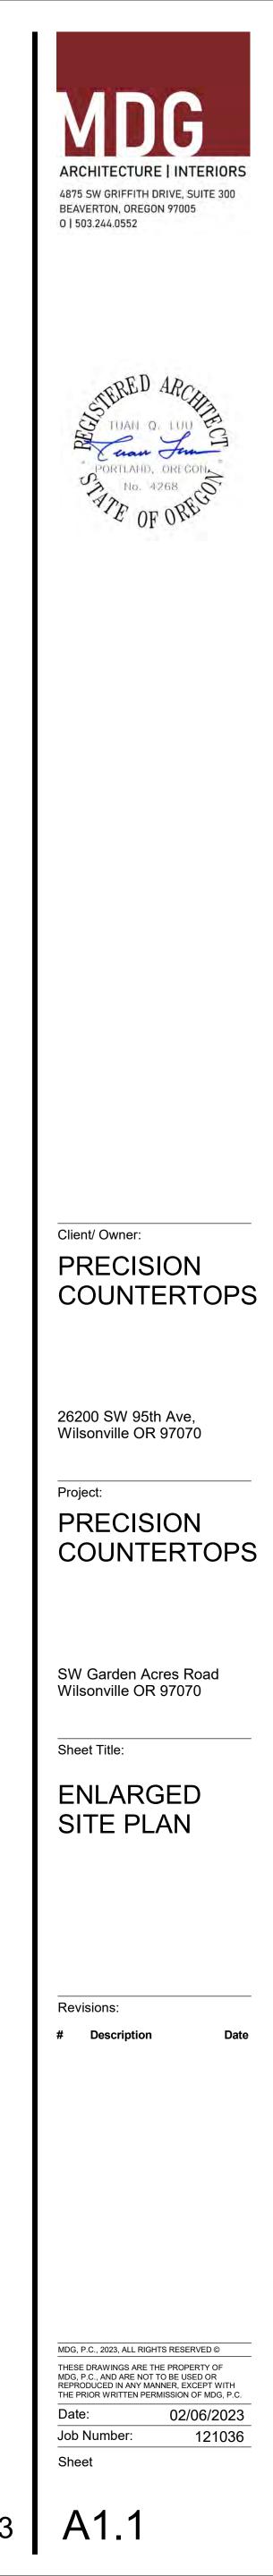

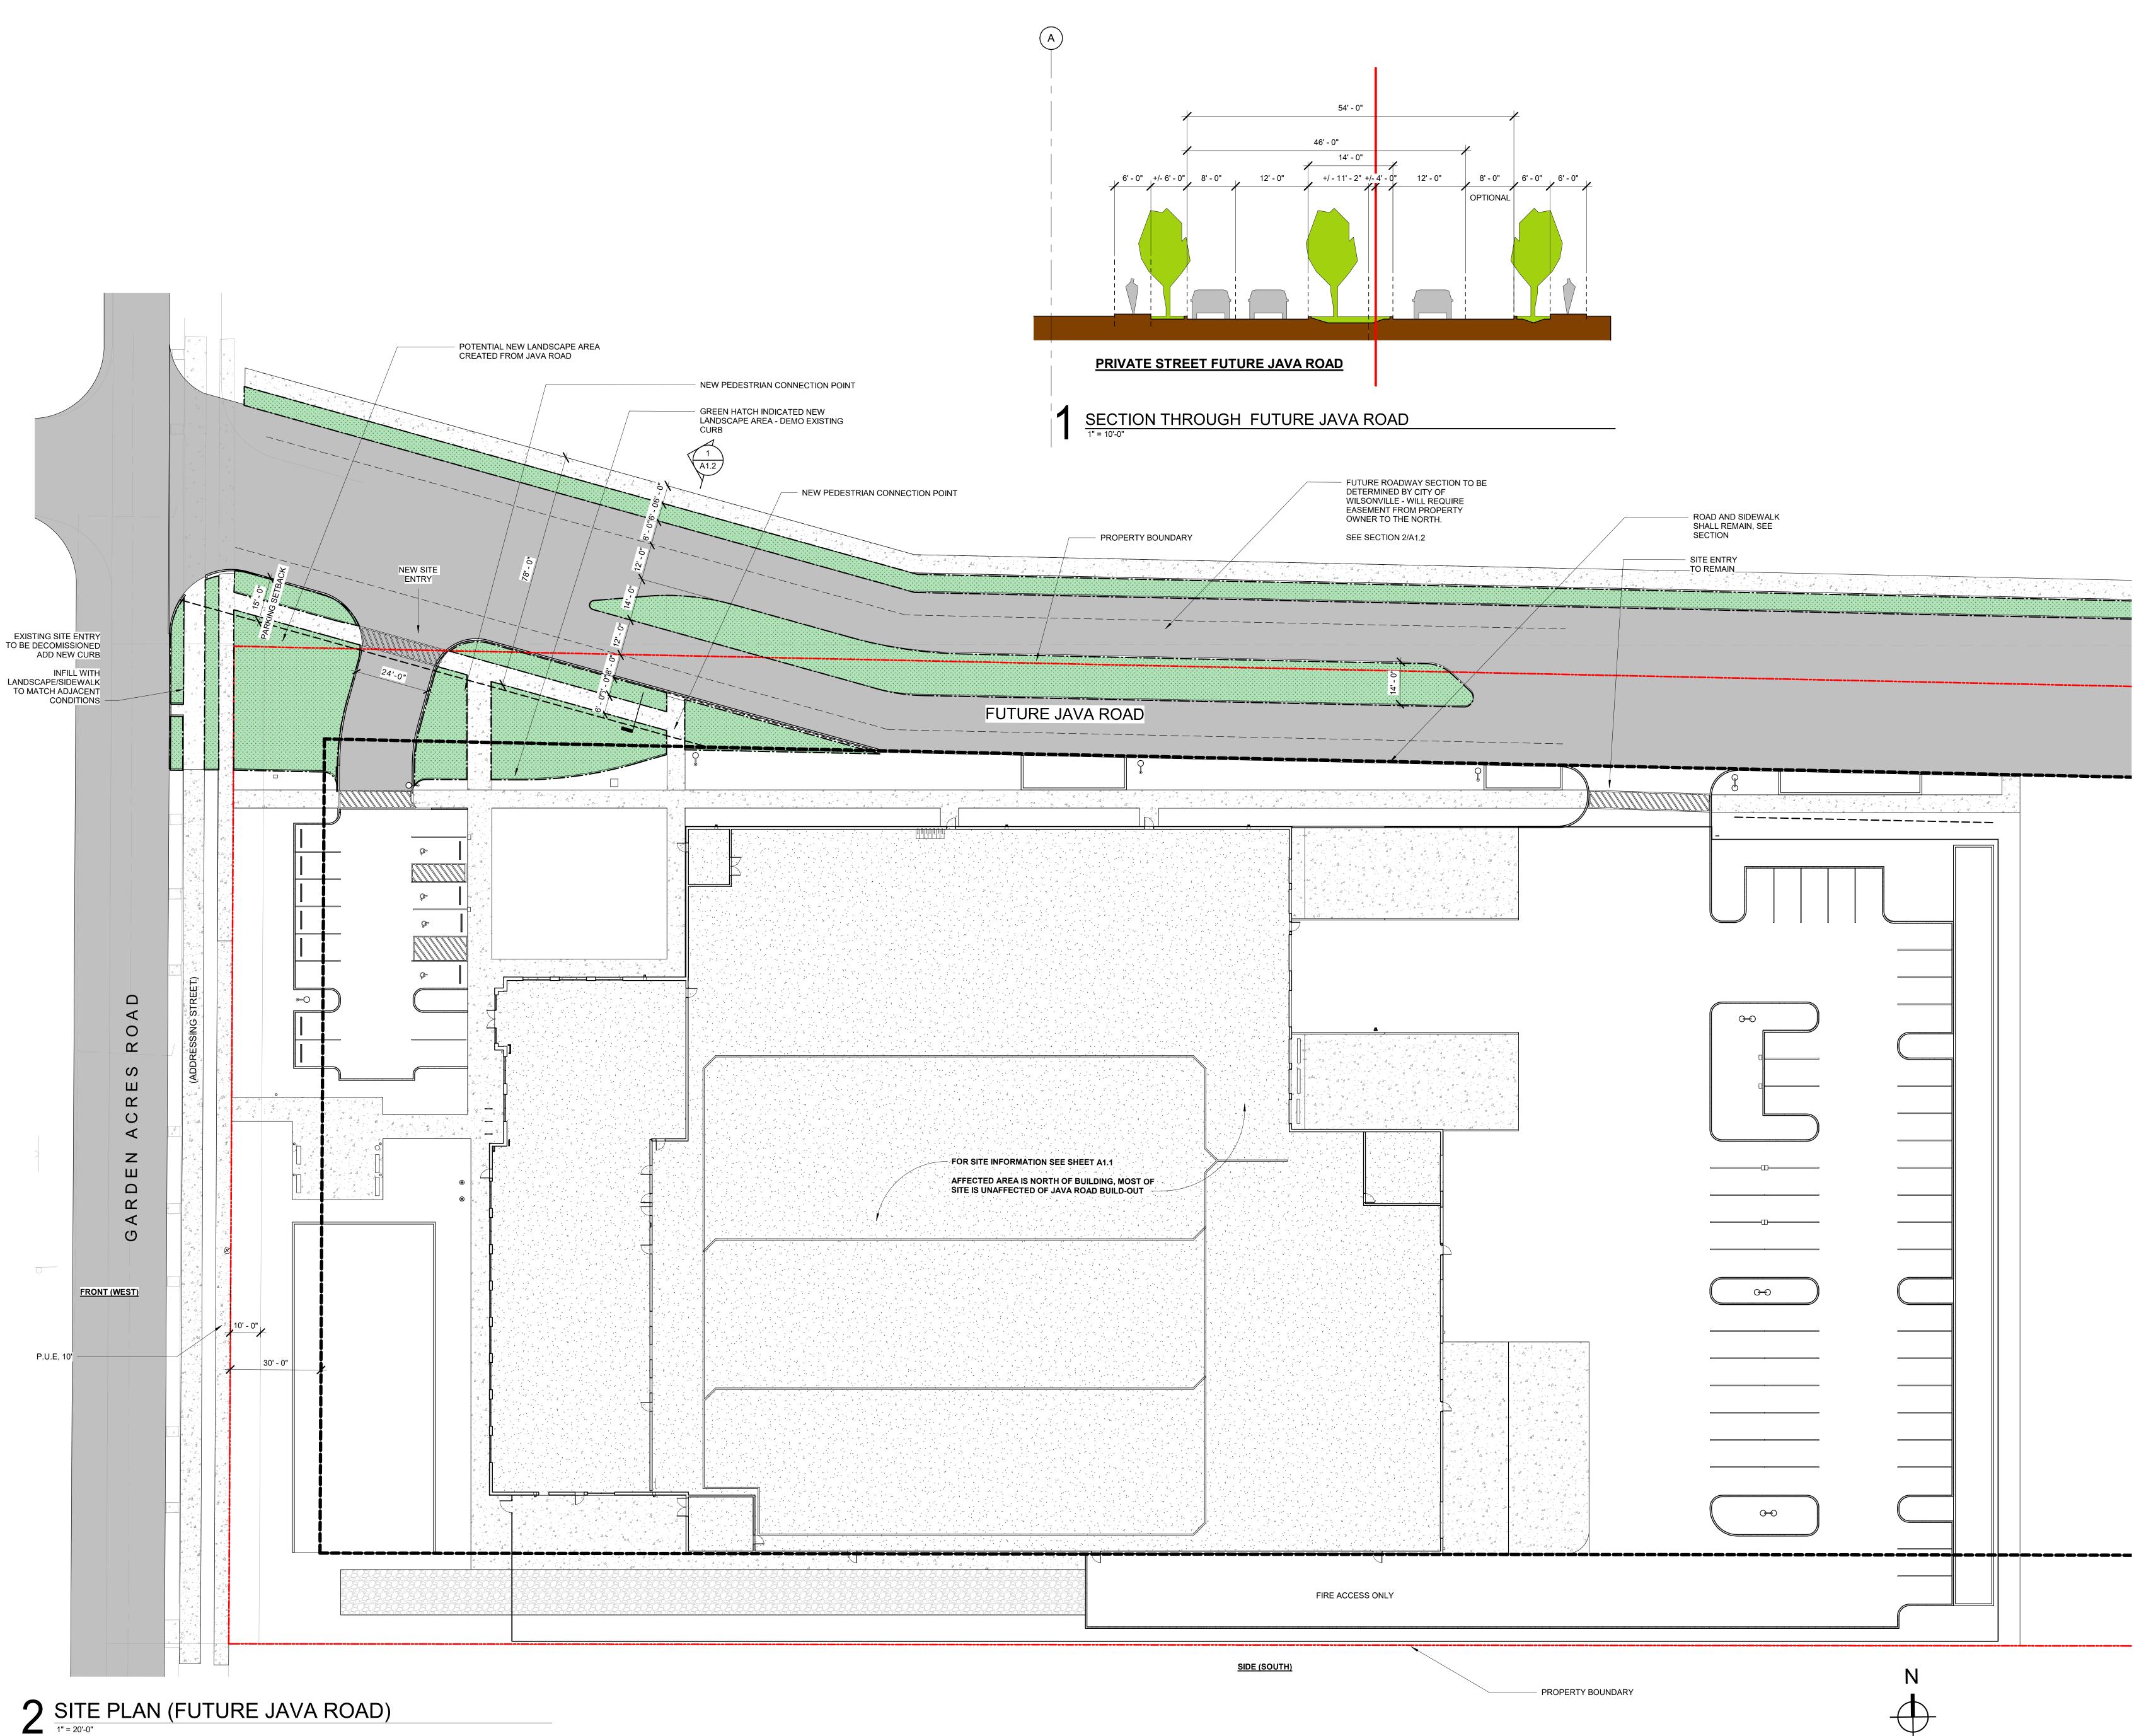


DESIGN REVIEW SET - FEBRUARY 2023 A1.2

4875 SW GRIFFITH DRIVE, SUITE 300 BEAVERTON, OREGON 97005 0 | 503.244.0552 uan C Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: SITE PLAN (FUTURE) CURRENT PROPOSED PLAN (FUTURE) PLAN Revisions: Descriptio MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: 121036 Job Number: Sheet



SECTION THROUGH CURRENT DRIVEWAY AND FUTURE JAVA ROAD


28' - 0" MIN

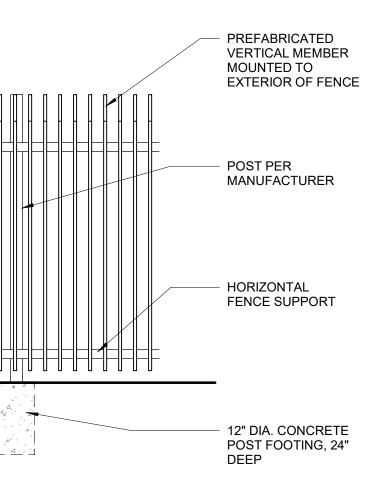




B TRASH RECEPTACLE

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 uan T Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: SITE DETAILS Revisions: Descrin MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date 121036 Job Number: Sheet A1.3

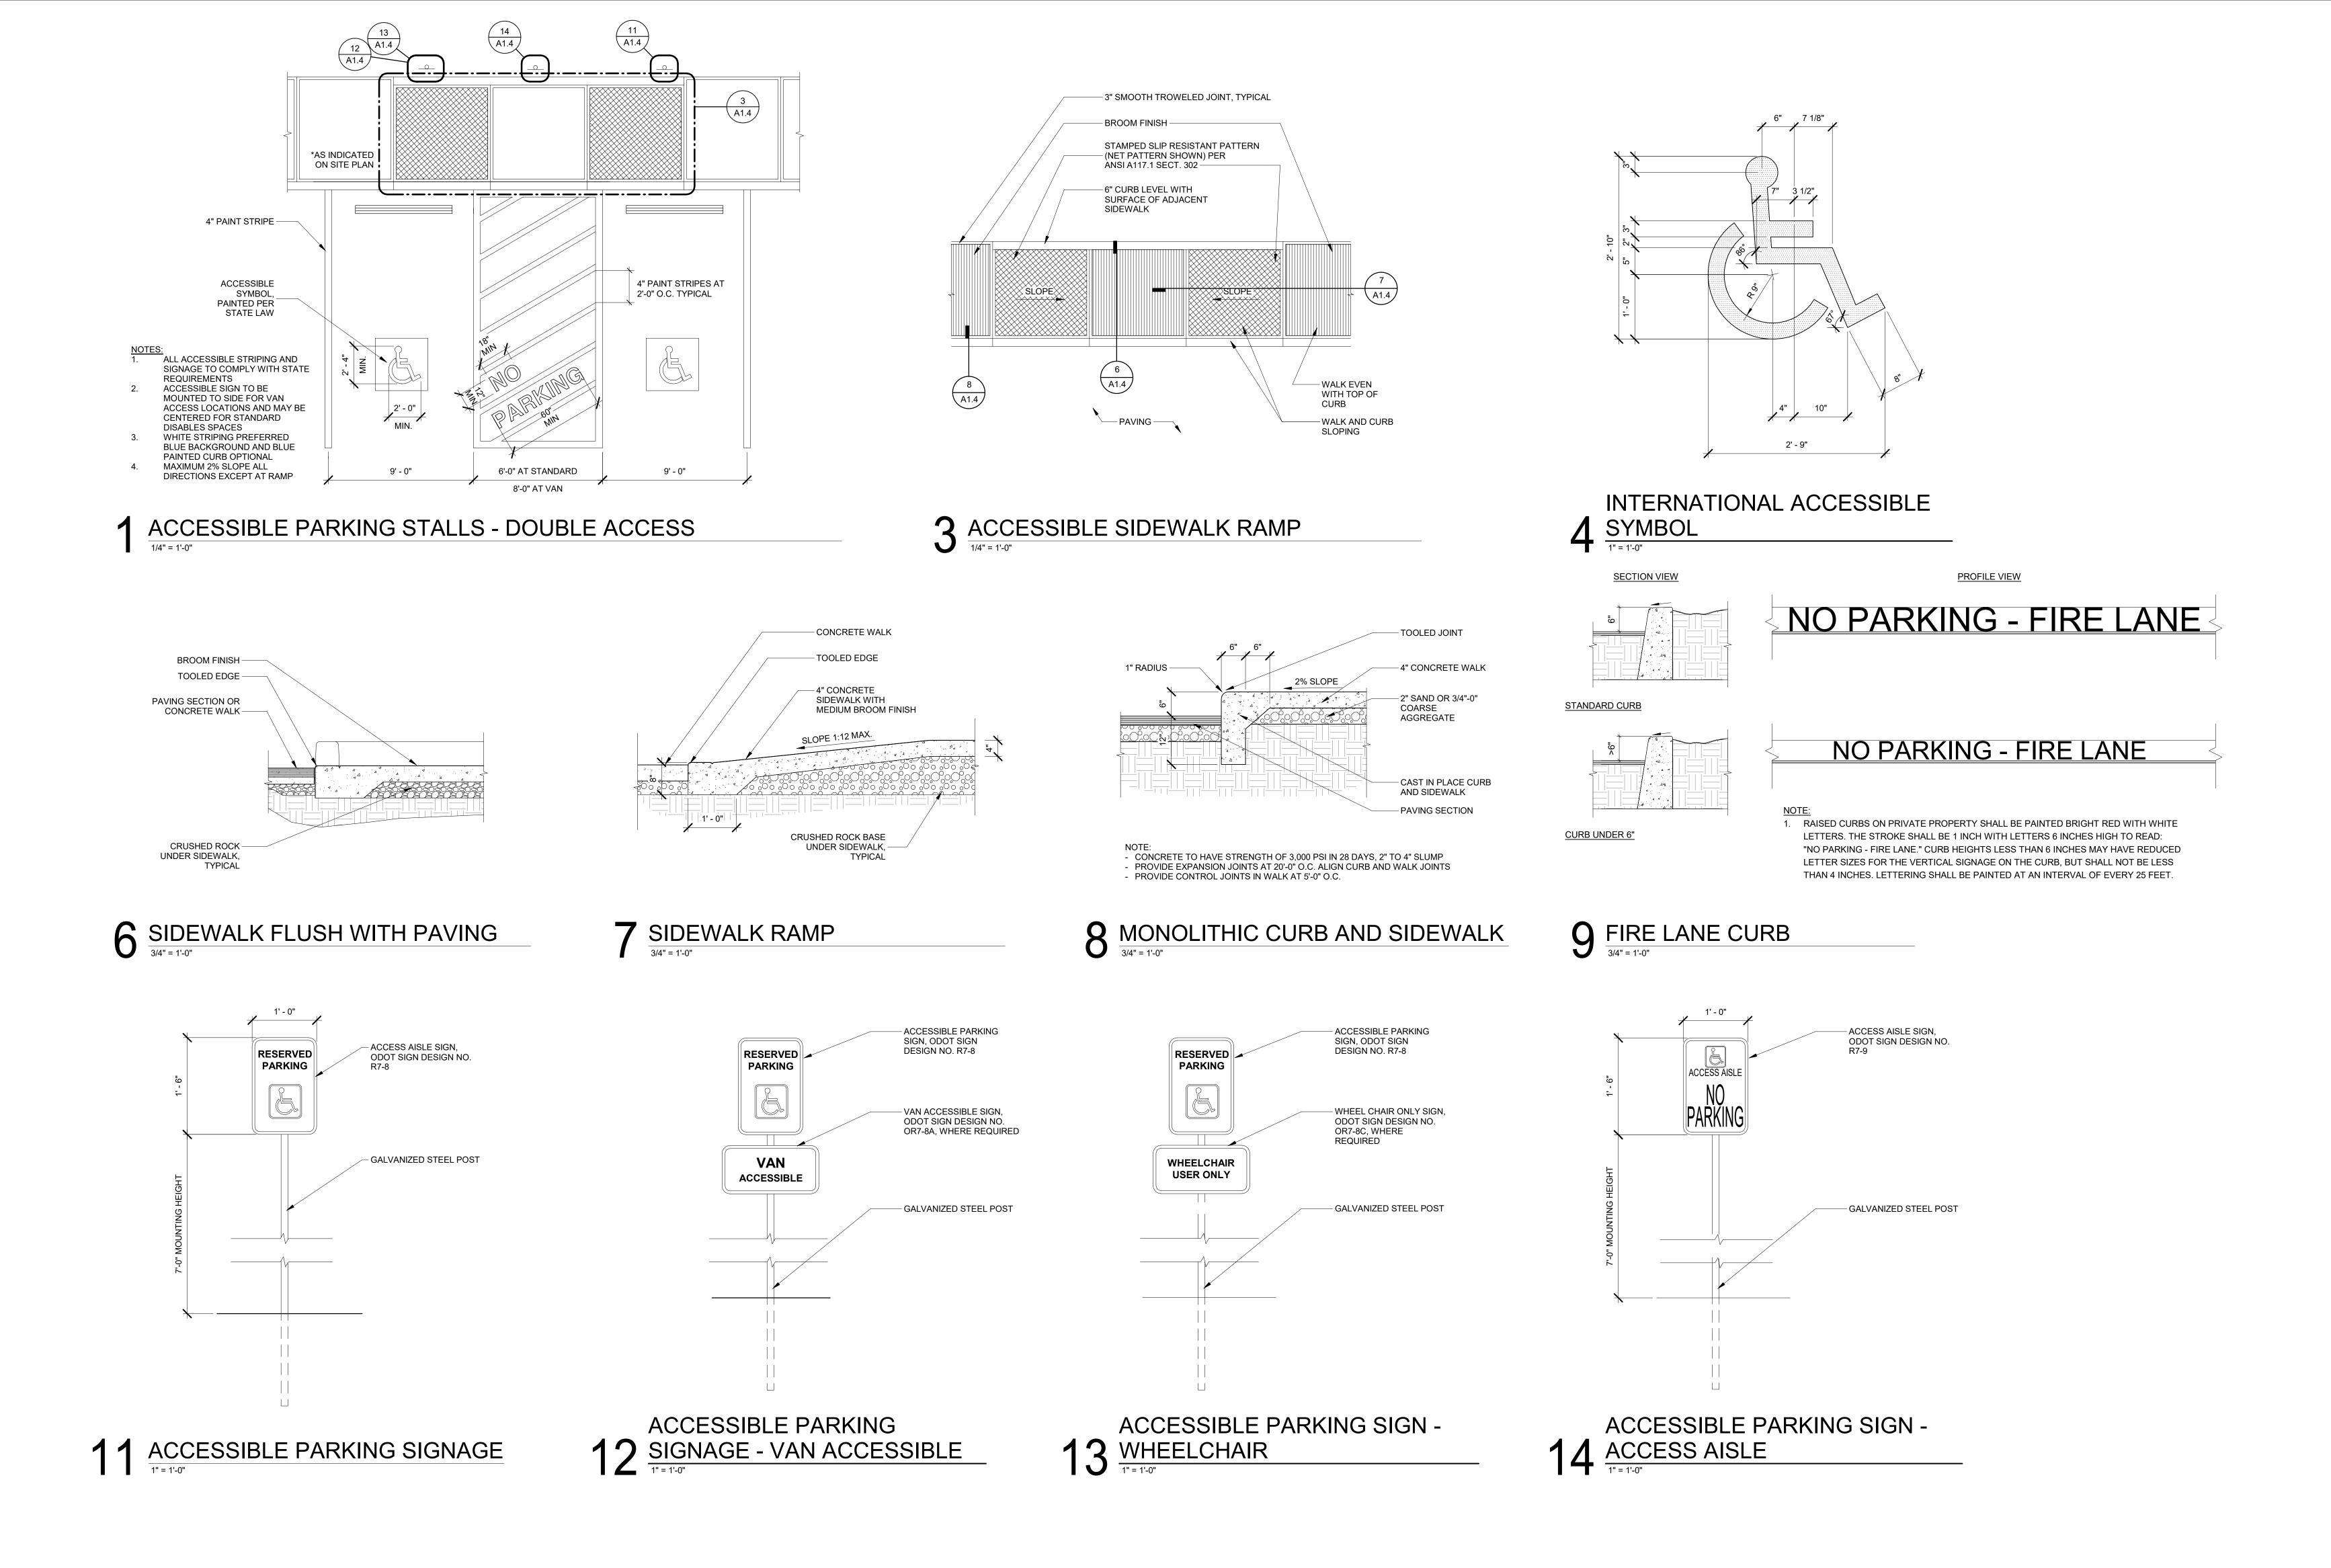

4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: SITE DETAILS Revisions: Descript MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: 121036 Job Number Sheet A1.4

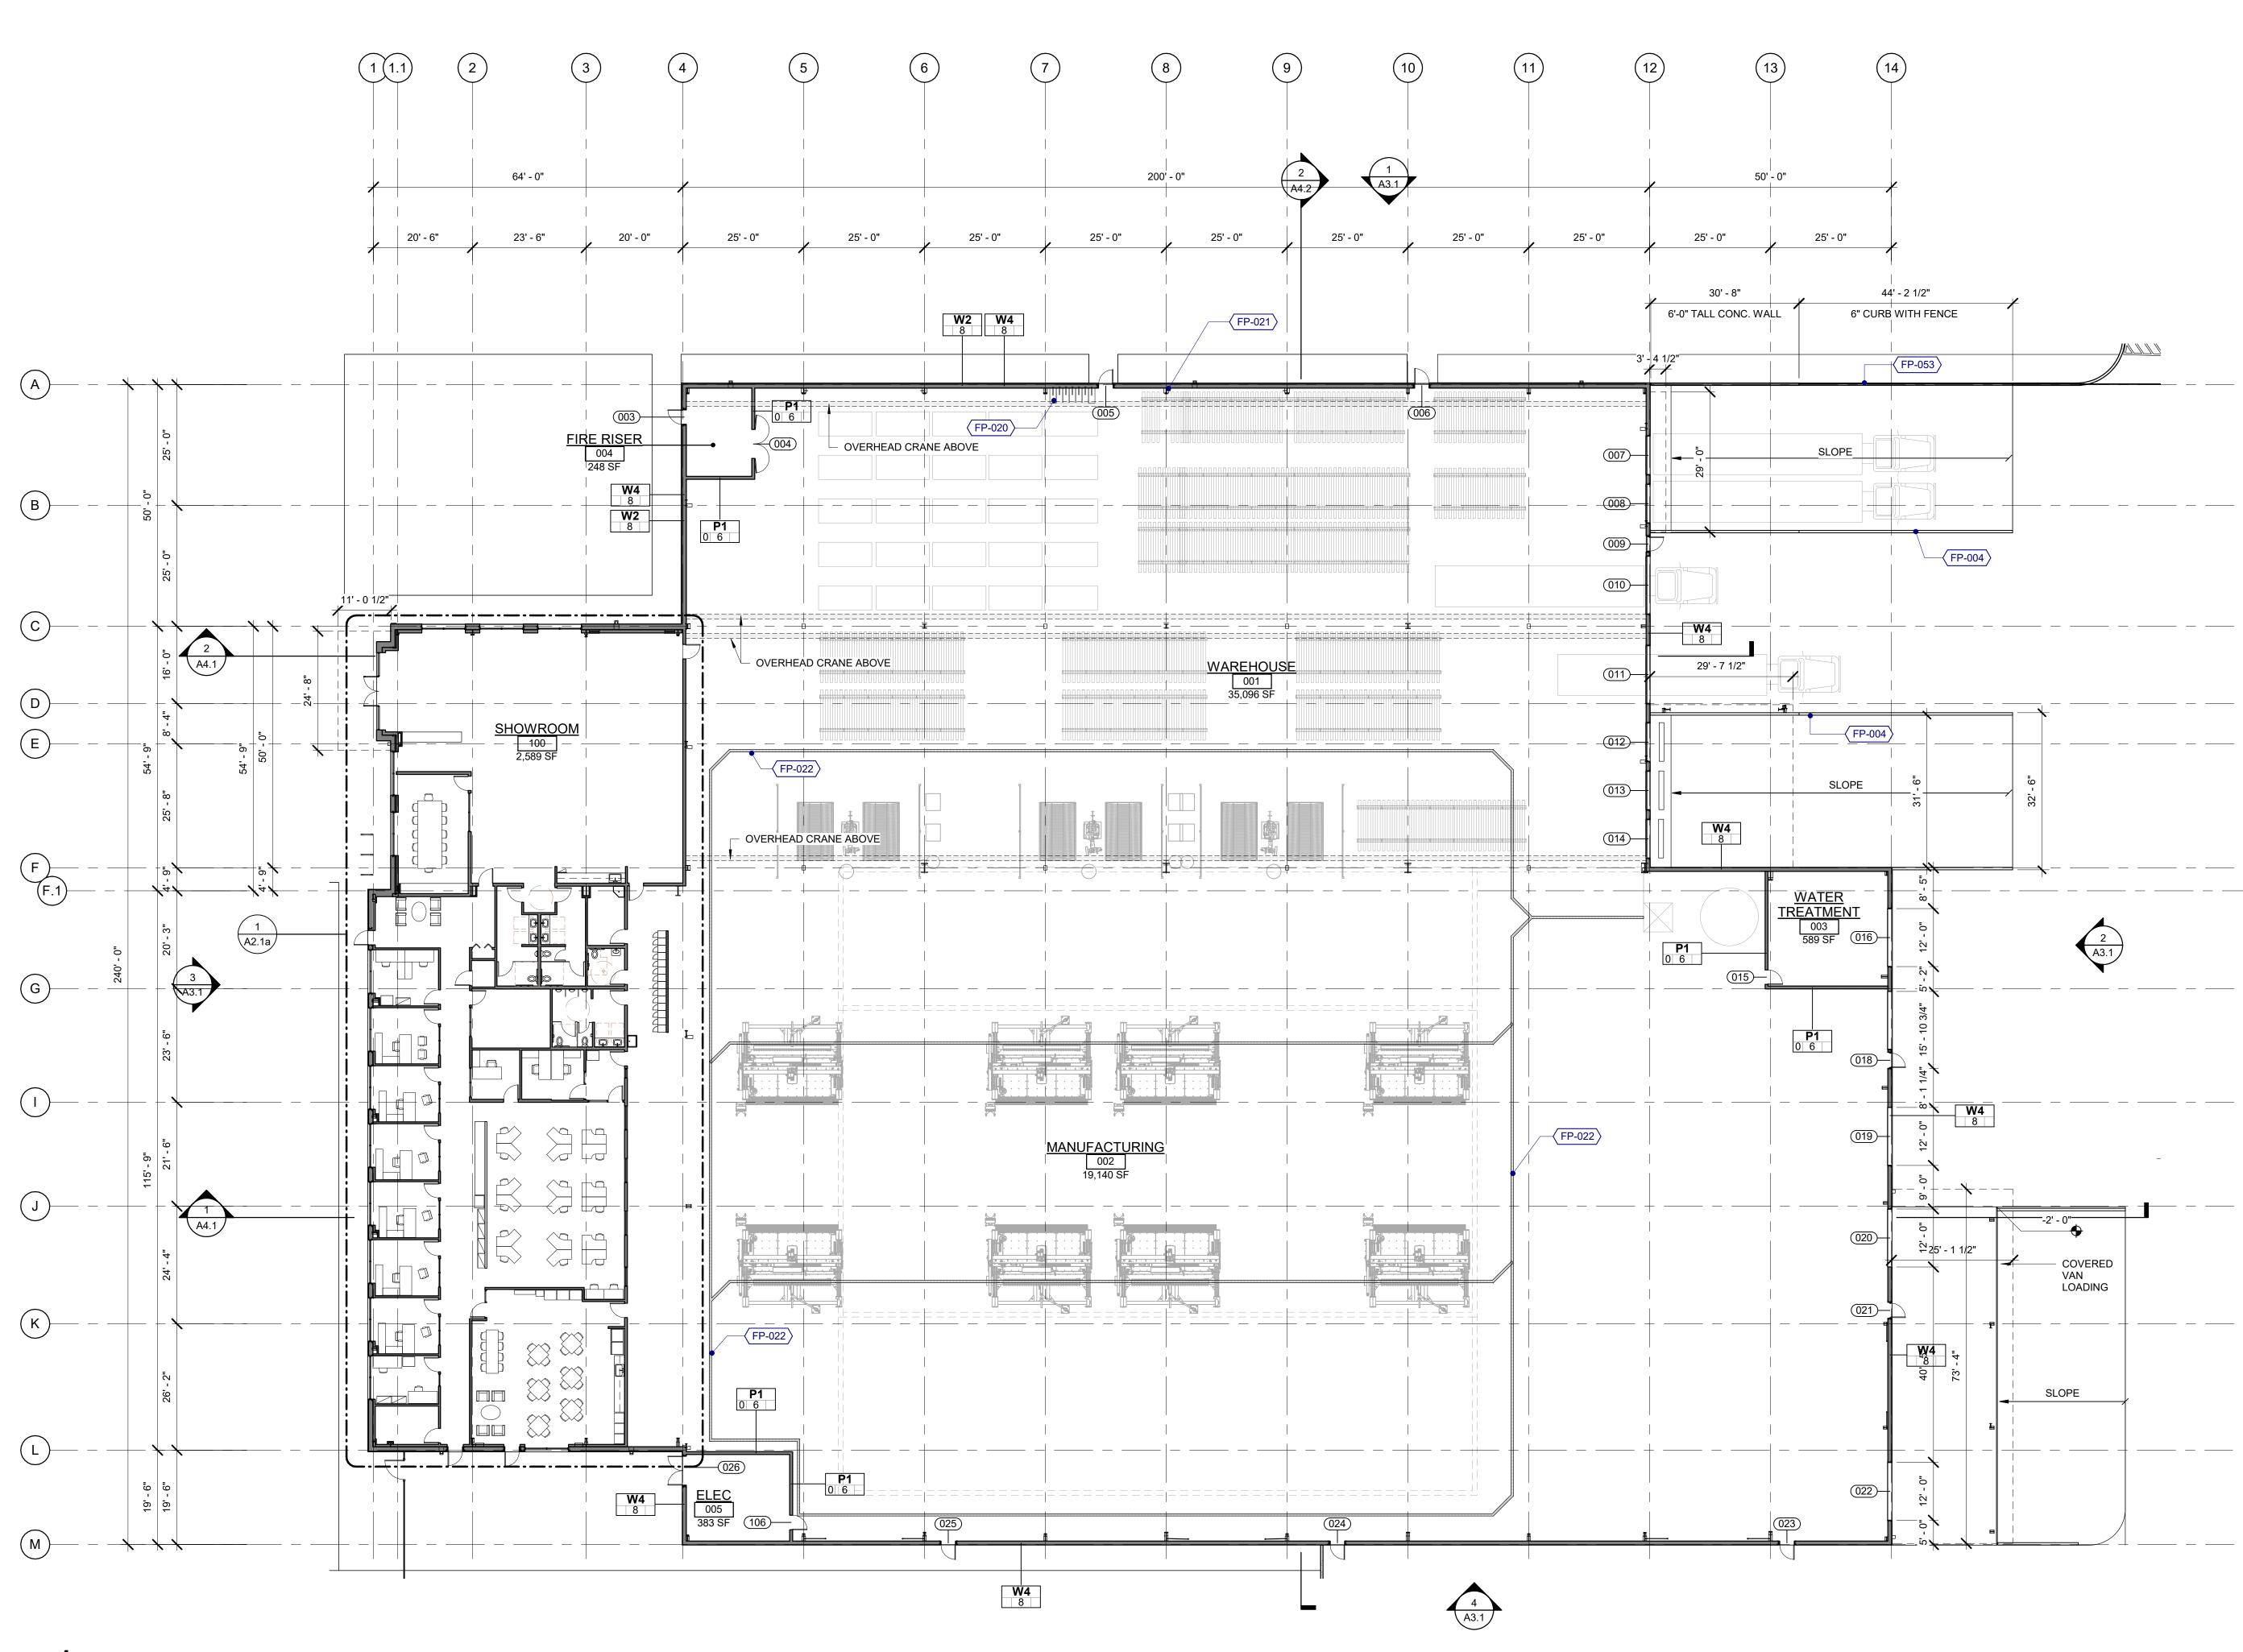


GENERAL NOTES - FLOOR PLANS


- REFER TO SHEET G0.1 FOR 'PROJECT NOTES' APPLICABLE TO ALL PORTIONS OF THE WORK.
 PRIOR TO FRAMING GENERAL CONTRACTOR TO VERIFY PLUMBING, PIPES, CONDUIT, DUCTWORK, ELECTRICAL DEVICES, CASEWORK, FIXTURES, ETC. HAVE BEEN COORDINATED. UNCOORDINATED
- WALL SIZES SHALL BE REINSTALLED SOLEY AT CONTRACTOR'S EXPENSE.
 3. SEE SHEETS G0.4 FOR WALL, FLOOR AND ROOF ASSEMBLIES.
 4. SEE FIRE/LIFE SAFETY SHEETS BEGINNING ON A2.0 FOR LOCATIONS OF FIRE EXTINGUISHERS,
- SEE TINE/EILE SALETT SHEETS BEGINNING ON A2.01 OK EOCATIONS OF TIKE EXHIGOISTICK EXIT SIGNS, ETC.
 REFER TO STRUCTURAL DRAWINGS FOR COLUMNS, SHEAR WALL, BEAM SIZES AND SO ON.
- KEI EK TO STRUCTORAD DRAWINGS TO COLOMINS, STILLAR WALL, BEAM SIZES AND SO OF
 VERIFY AND COORDINATE SLAB PENETRATIONS INCLUDING SLEEVES & BLOCKOUTS AS
- REQUIRED FOR PLUMBING, MECHANICAL, ELECTRICAL, ETC. NOTIFY ARCHITECT OF ANY CONFLICTS OR DISCREPENCIES.
 7. USE THE FOLLOWING DEFAULT ASSEMBLY TYPES UNLESS OTHERWISE NOTED ON THE
- DRAWINGS: A. EXTERIOR WALLS TYPE W1 / 8" CORE
- B.INTERIOR PARTITIONSTYPE P1 / 3.5" COREC.INTERIOR STAIR PARTITIONSTYPE P2 / 6" CORE
- POWER & DATA OUTLETS INSTALLED 18" AFF, UNO.
 PARTITIONS WITH SOLID FILL PATTERN DENOTE ACOUSTICALLY RATED, UNO. PROVIDE ACOUSTICAL SEALANT, BATTS, PUTTY PADS, ETC.
 FINISH NOTES:
- A. OFFICE AREAS GYPSUM BOARD WALL SURFACES TO RECEIVE A LEVEL 4 FINISH, SMOOTH TEXTURE PER AWCI STANDARDS. APPLY A DRYWALL PRIMER (SHEETROCK BRAND "FIRST COAT" OR APPROVED) PRIOR TO FINAL FINISH COAT TO MINIMIZE SURFACE TEXTURE VARIATIONS.
- B. WAREHOUSE AREAS GYPSUM BOARD WALL SURFACES TO BE TAPED/ MUDDED ONLY, UNO.


KEYNOTES


- FP-004 CONCRETE SITE WALL WITH 42" CONCRETE GUARDRAIL WHERE CHANGE IN GRADE IS OVER 30" FP-020 WALL MOUNTED LONG TERM BIKE PARKING
- FP-021 PRE-ENGINEERED METAL BUILDING FRAME, SEE PEMB SUPPLIER FP-022 6" TRENCH DRAIN
- FP-053 FENCE, ORNAMENTAL BLACK BAR, 6'-0"H

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 uan th ORTLAND, ORECON No. 4268 Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: FLOOR PLAN Revisions: MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: 121036 Job Number: Sheet A2.′

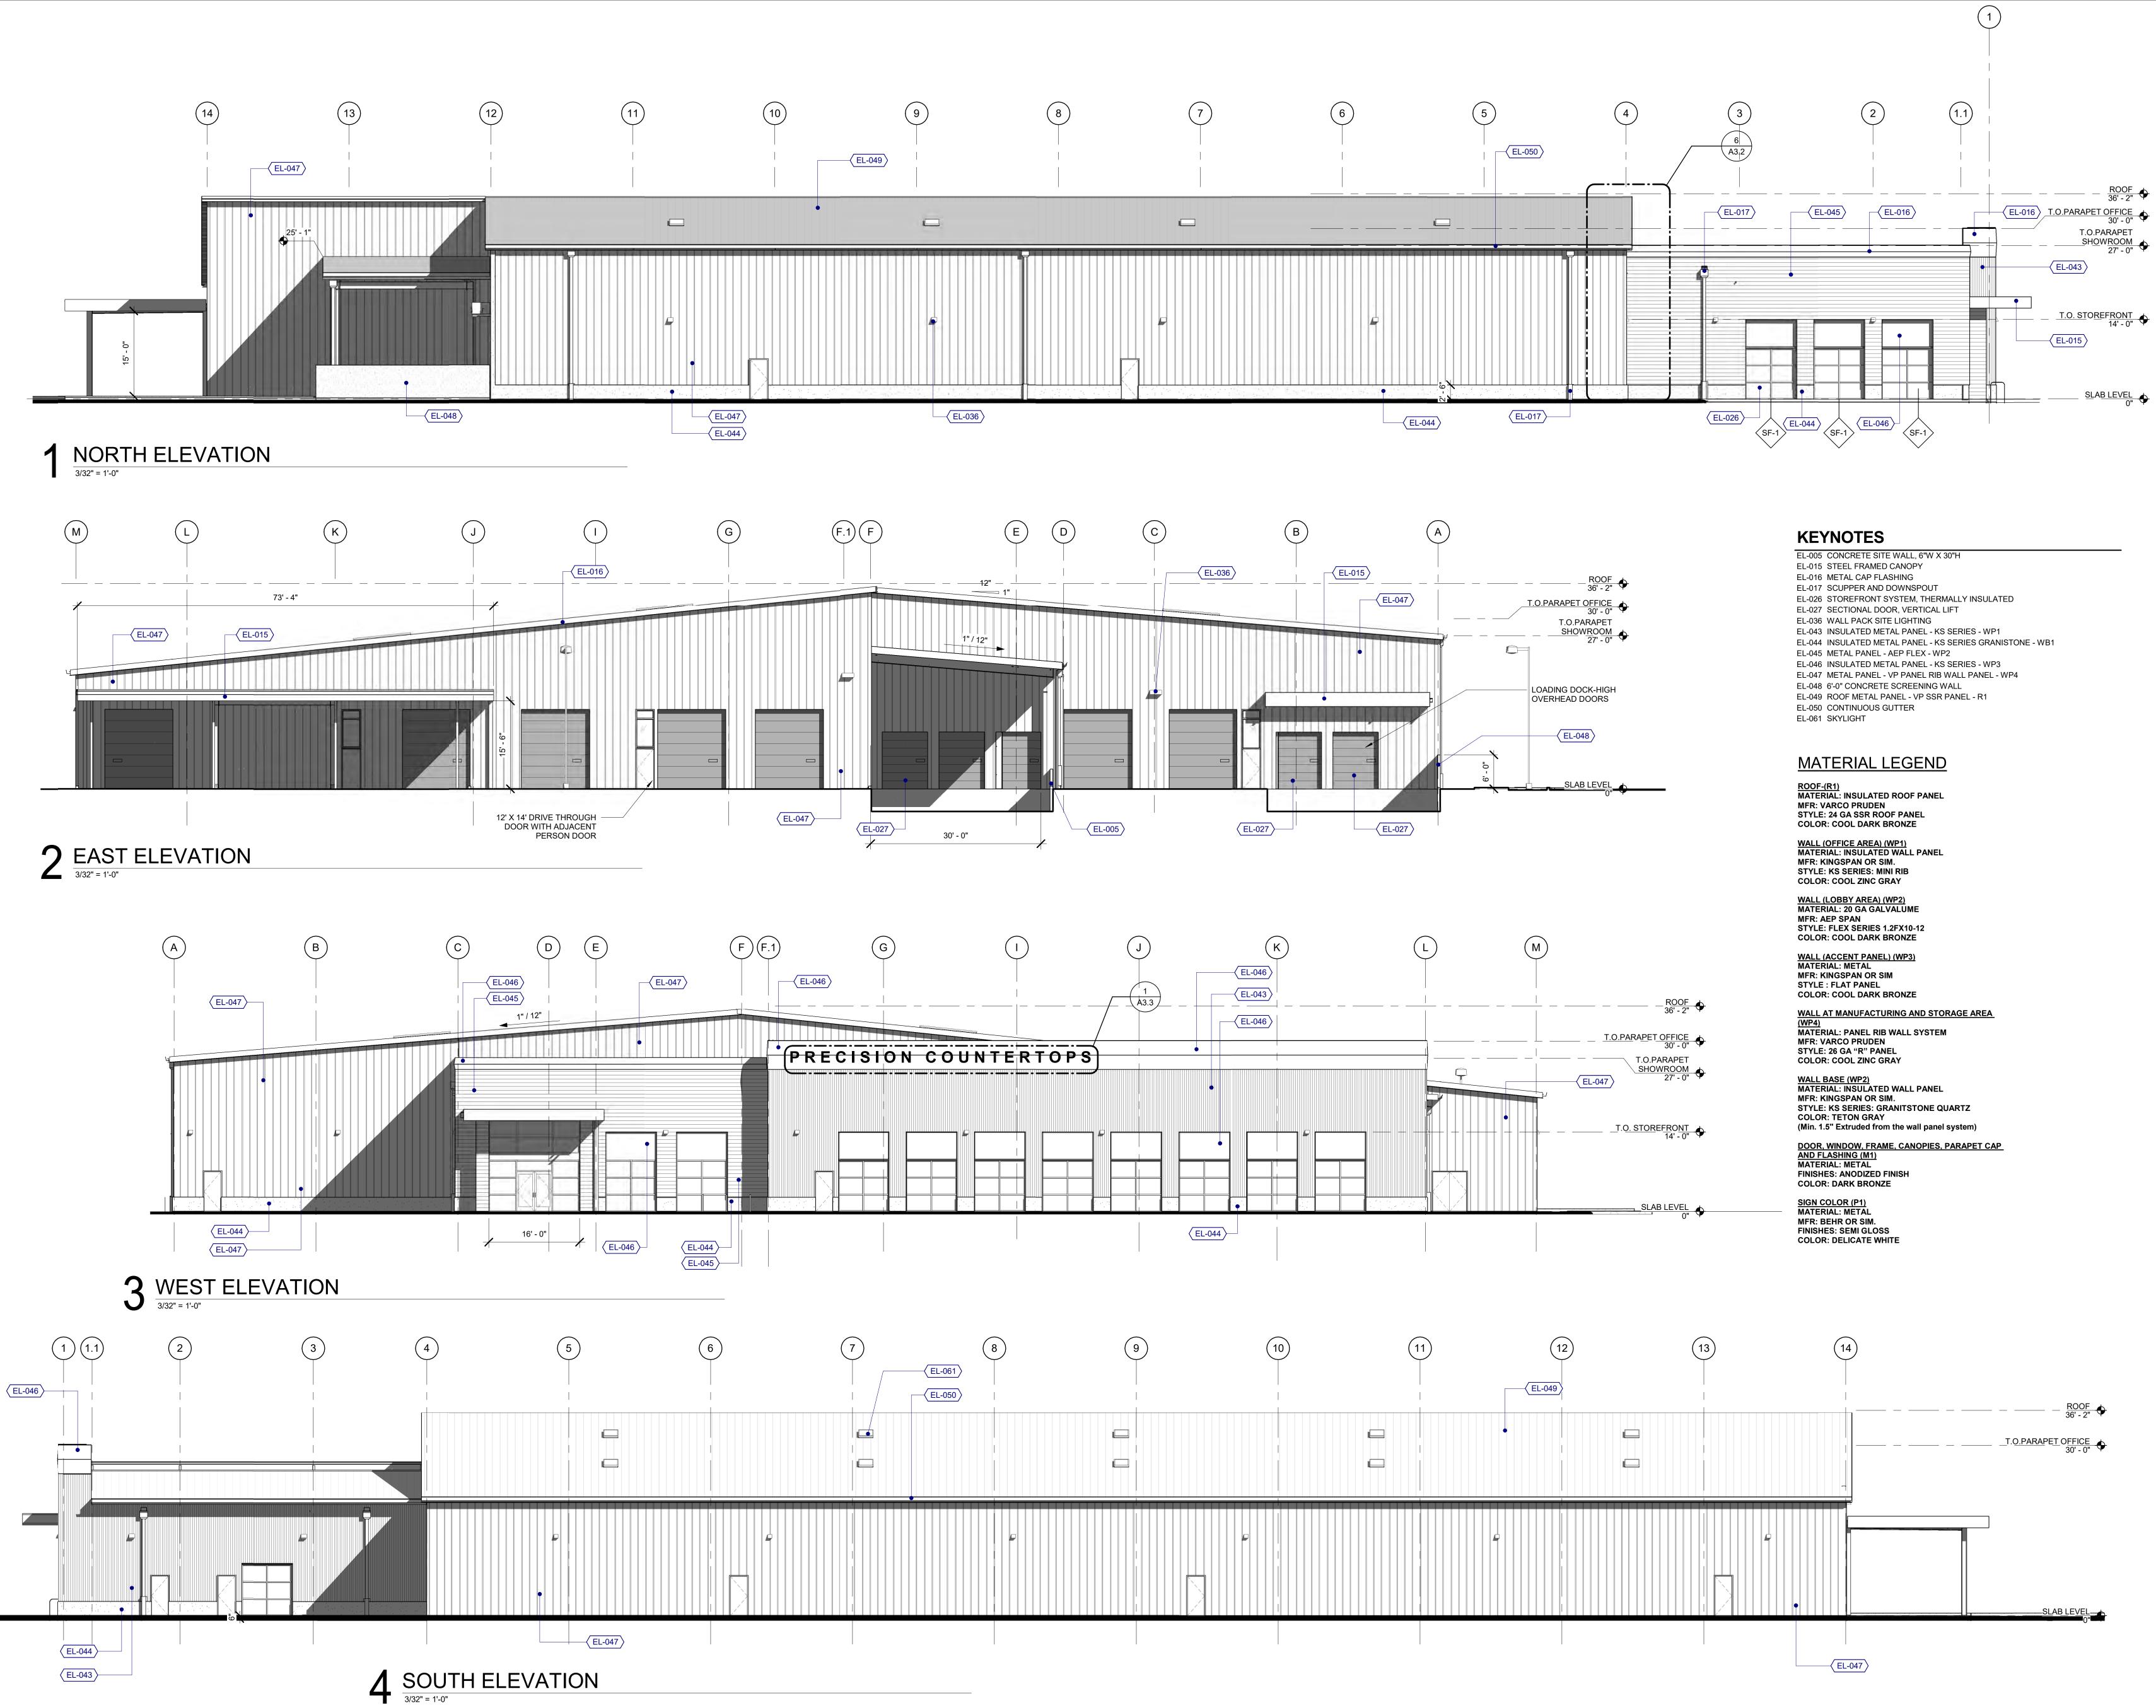

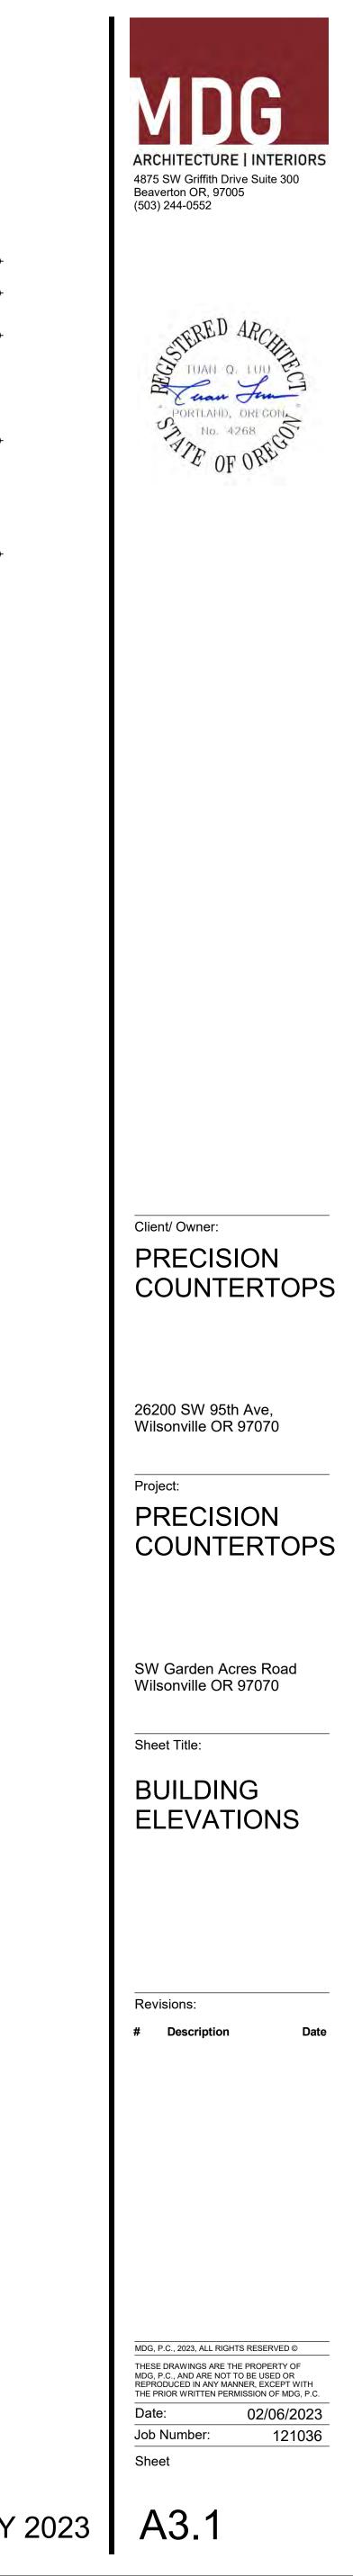

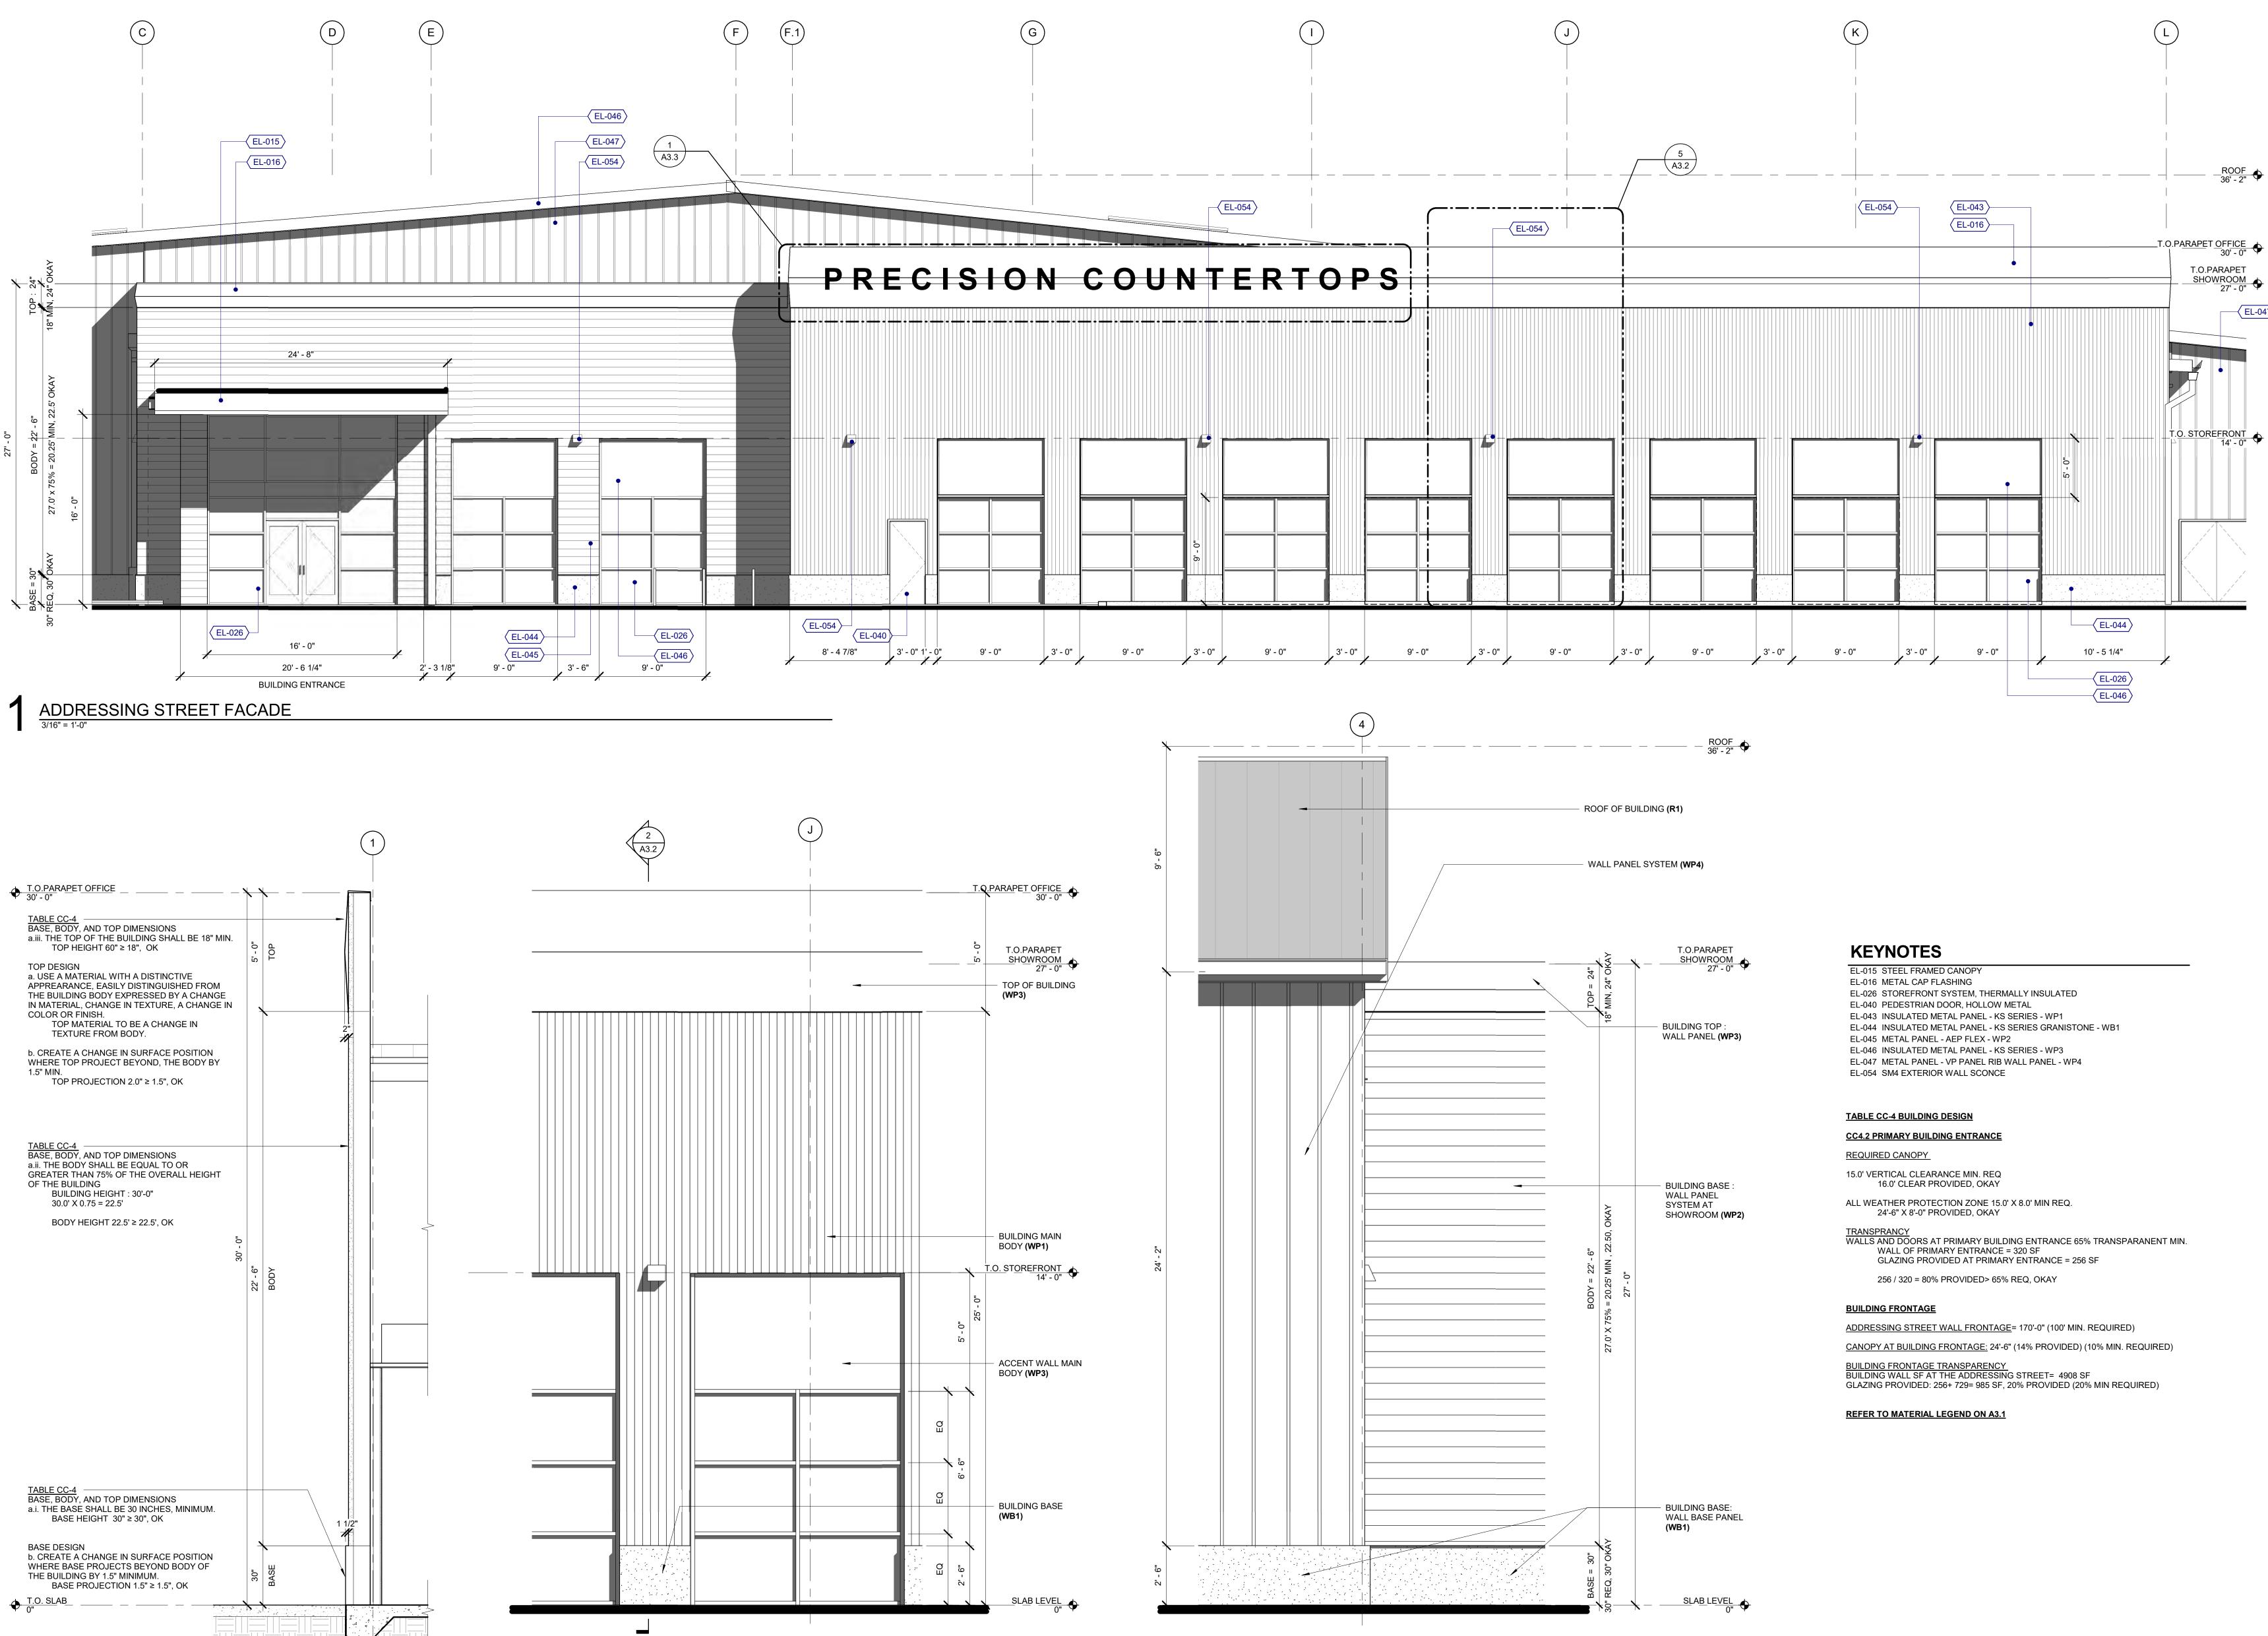

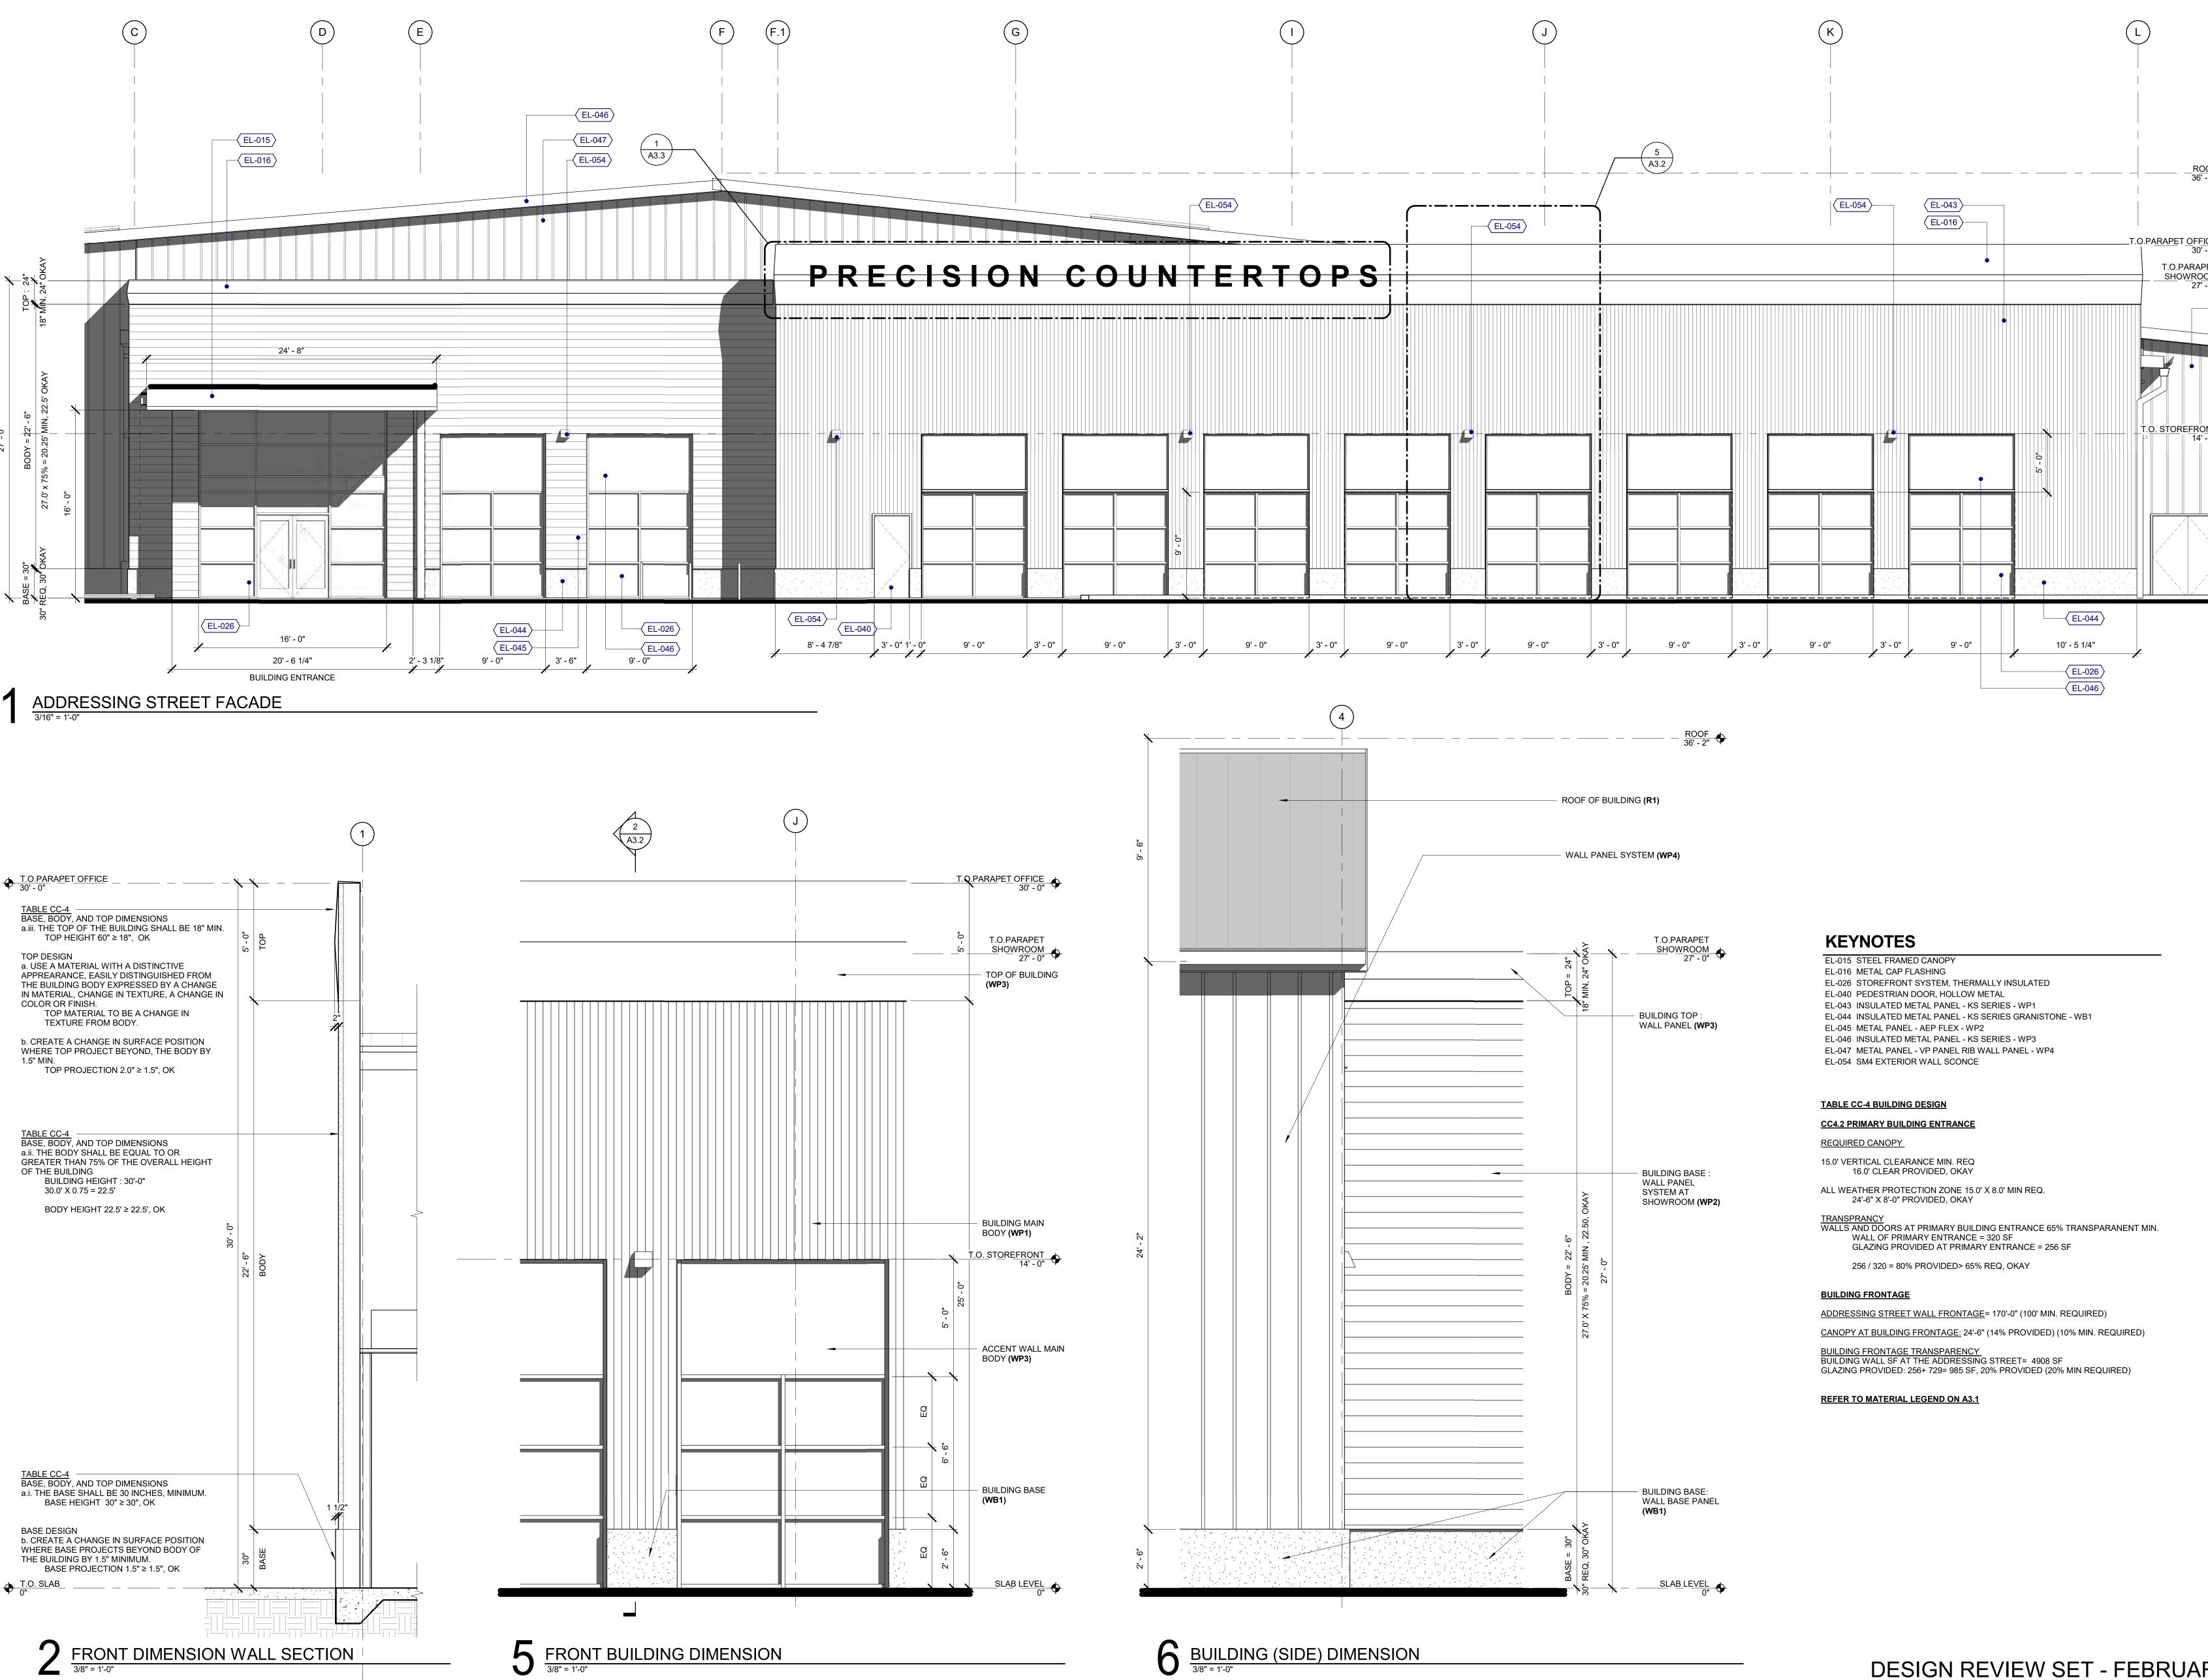

A3.2

MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: 121036 Job Number: Sheet

Description

Revisions:

SIGNAGE, ENTRY, GLAZING CALCULATION

Sheet Title:


SW Garden Acres Road Wilsonville OR 97070

Project: PRECISION COUNTERTOPS


26200 SW 95th Ave, Wilsonville OR 97070

Client/ Owner: PRECISION COUNTERTOPS



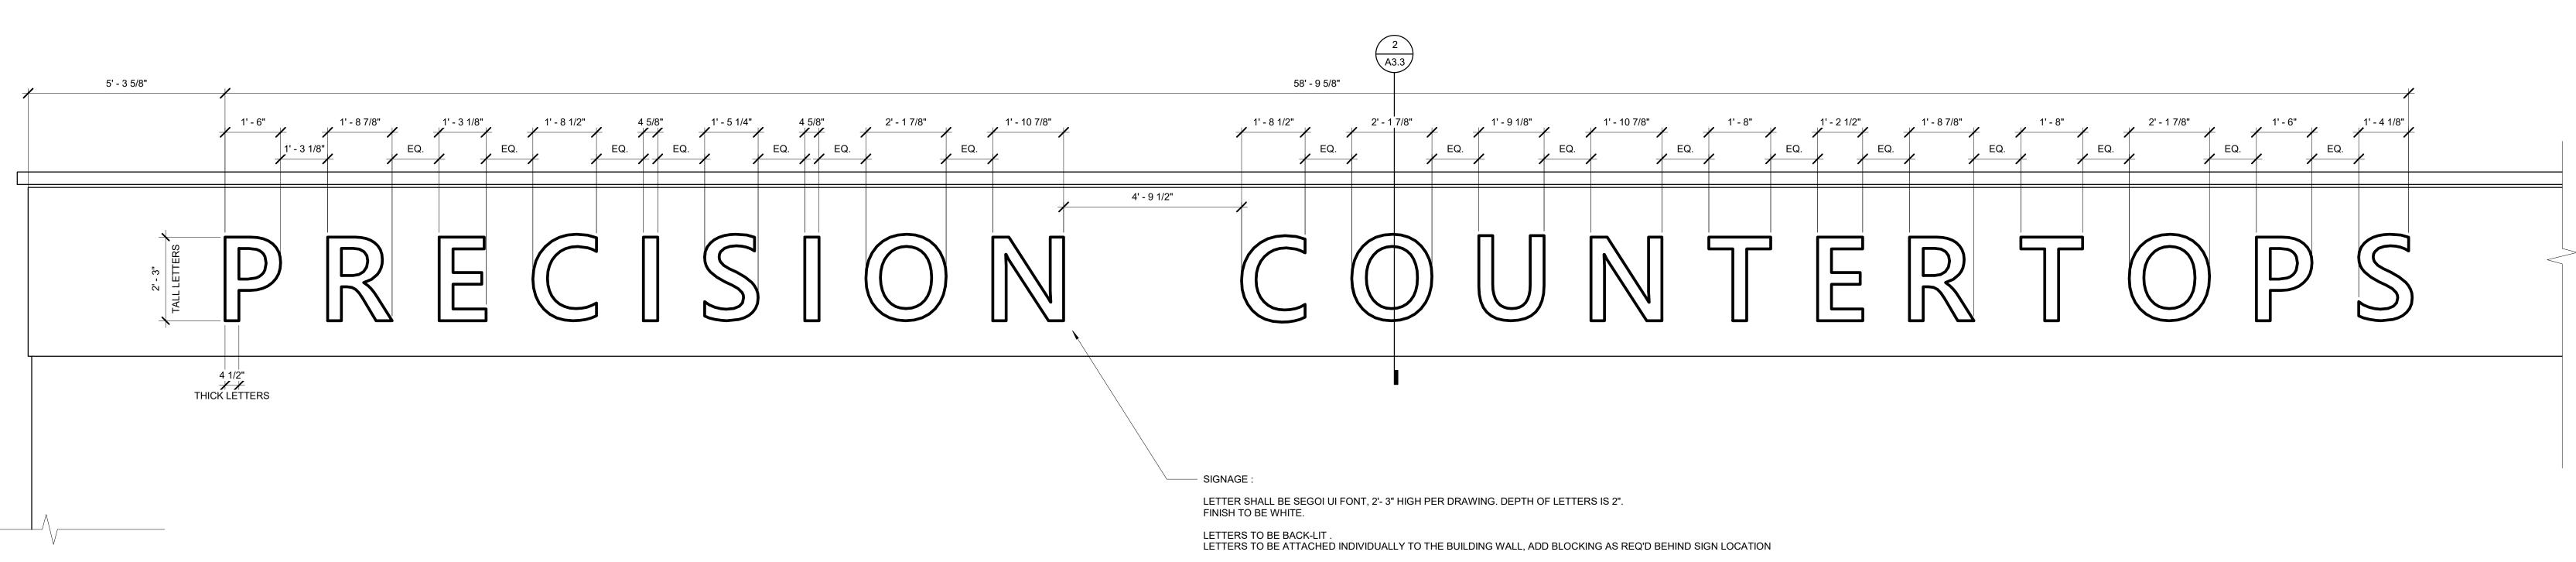

BUILDING SIGNAGE DETAIL

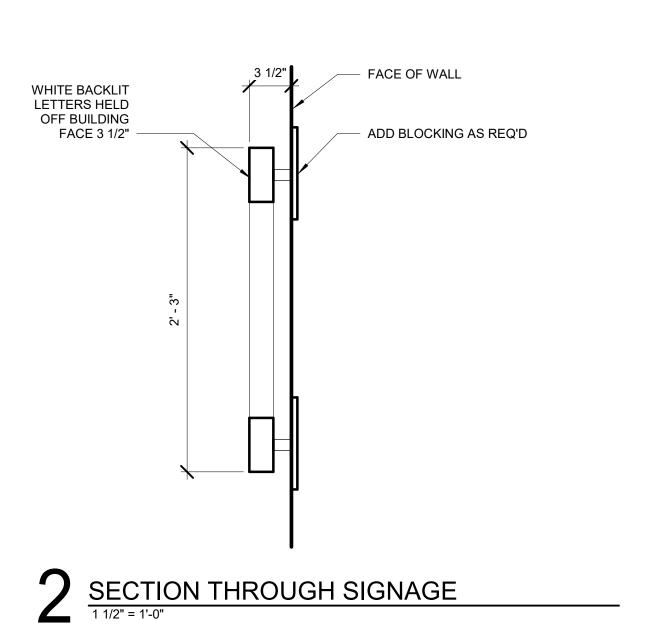



<u>SIGN AREA: COMBINED AREA OF ALL BACKLIT LETTERS : 40 SF < 85 SF (OKAY)</u>

BUILDING SIGNAGE CALCULATIONS

LINEAR LENGTH OF FACADE 170', SIGN AREA ALLOWED= 36 SF + (((170'-72')/24)x12)= 85 SF

ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 uan t ORTLAND, OREGOI No. 4268 F OF O Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: SIGNAGE Revisions: Date # Descriptio MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: 121036 Job Number: Sheet

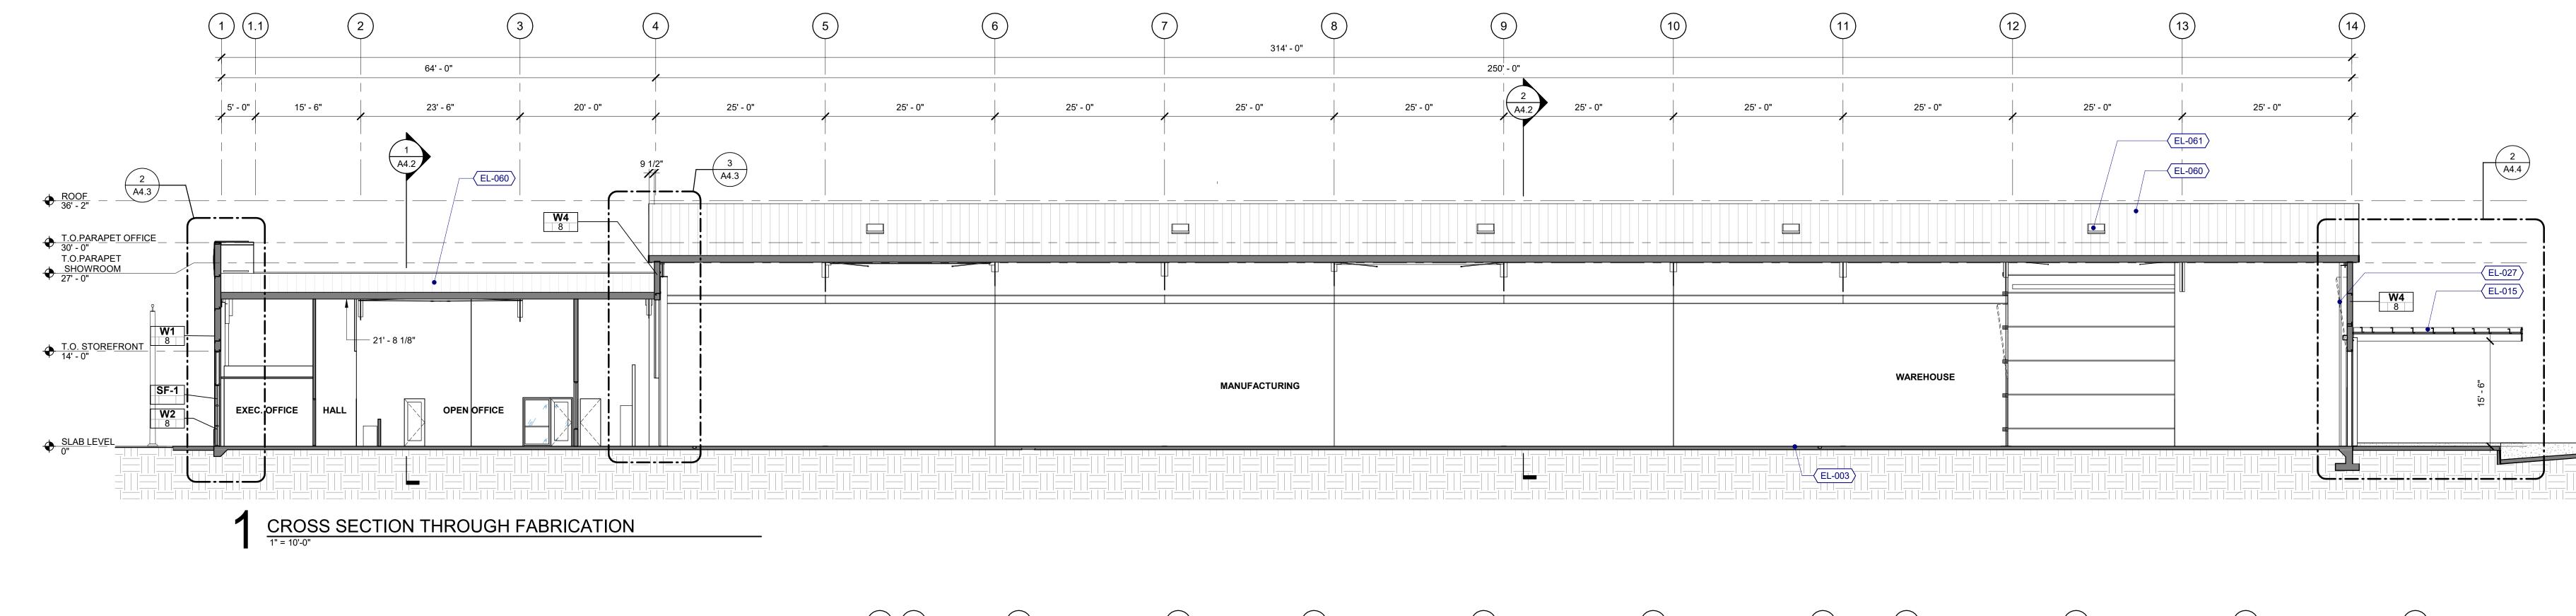

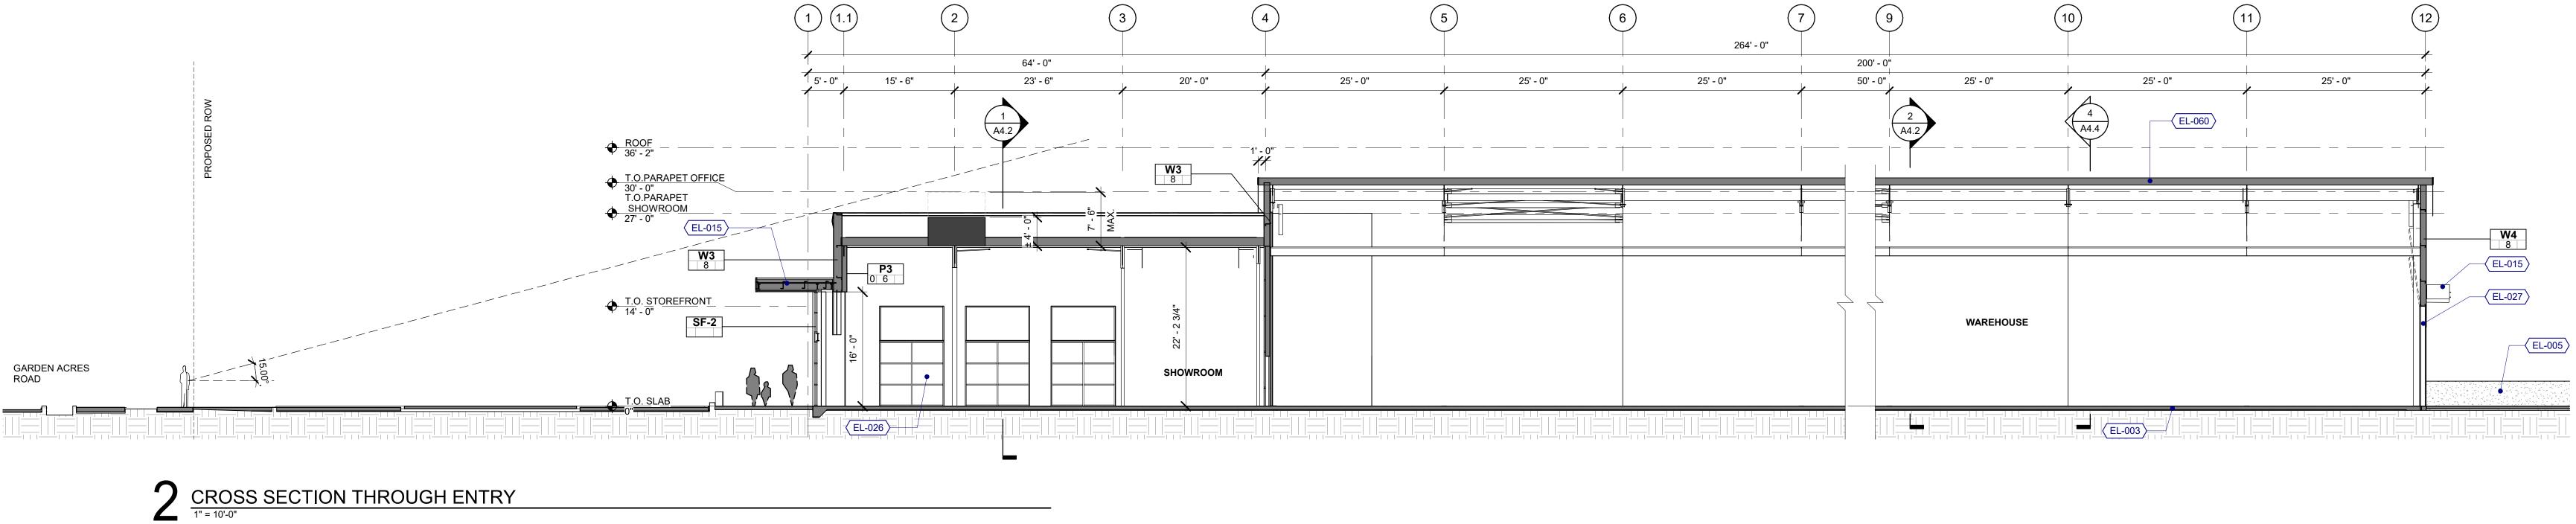

KEYNOTES

EL-003 CONCRETE SLAB ON GRADE OVER GRAVEL BASE - SEE STRUCTURAL


EL-005 CONCRETE SITE WALL, 6"W X 30"H EL-015 STEEL FRAMED CANOPY

EL-026 STOREFRONT SYSTEM, THERMALLY INSULATED

EL-027 SECTIONAL DOOR, VERTICAL LIFT EL-060 STANDING SEAM METAL PANEL ROOF, SEE ROOF PLAN FOR ASSEMBLY

EL-061 SKYLIGHT EL-062 PRE ENGINEERED METAL BUILDING FRAME, SEE PEMB SUPPLIER

DESIGN REVIEW SET - FEBRUARY 2023



MDG, P.C., 2023, ALL RIGHTS RESERVED ©THESE DRAWINGS ARE THE PROPERTY OF
MDG, P.C., AND ARE NOT TO BE USED OR
REPRODUCED IN ANY MANNER, EXCEPT WITH
THE PRIOR WRITTEN PERMISSION OF MDG, P.C.Date:02/06/2023Job Number:121036

Revisions: # Description

Date

BUILDING SECTIONS


Sheet Title:

SW Garden Acres Road Wilsonville OR 97070

Project: PRECISION COUNTERTOPS

26200 SW 95th Ave, Wilsonville OR 97070



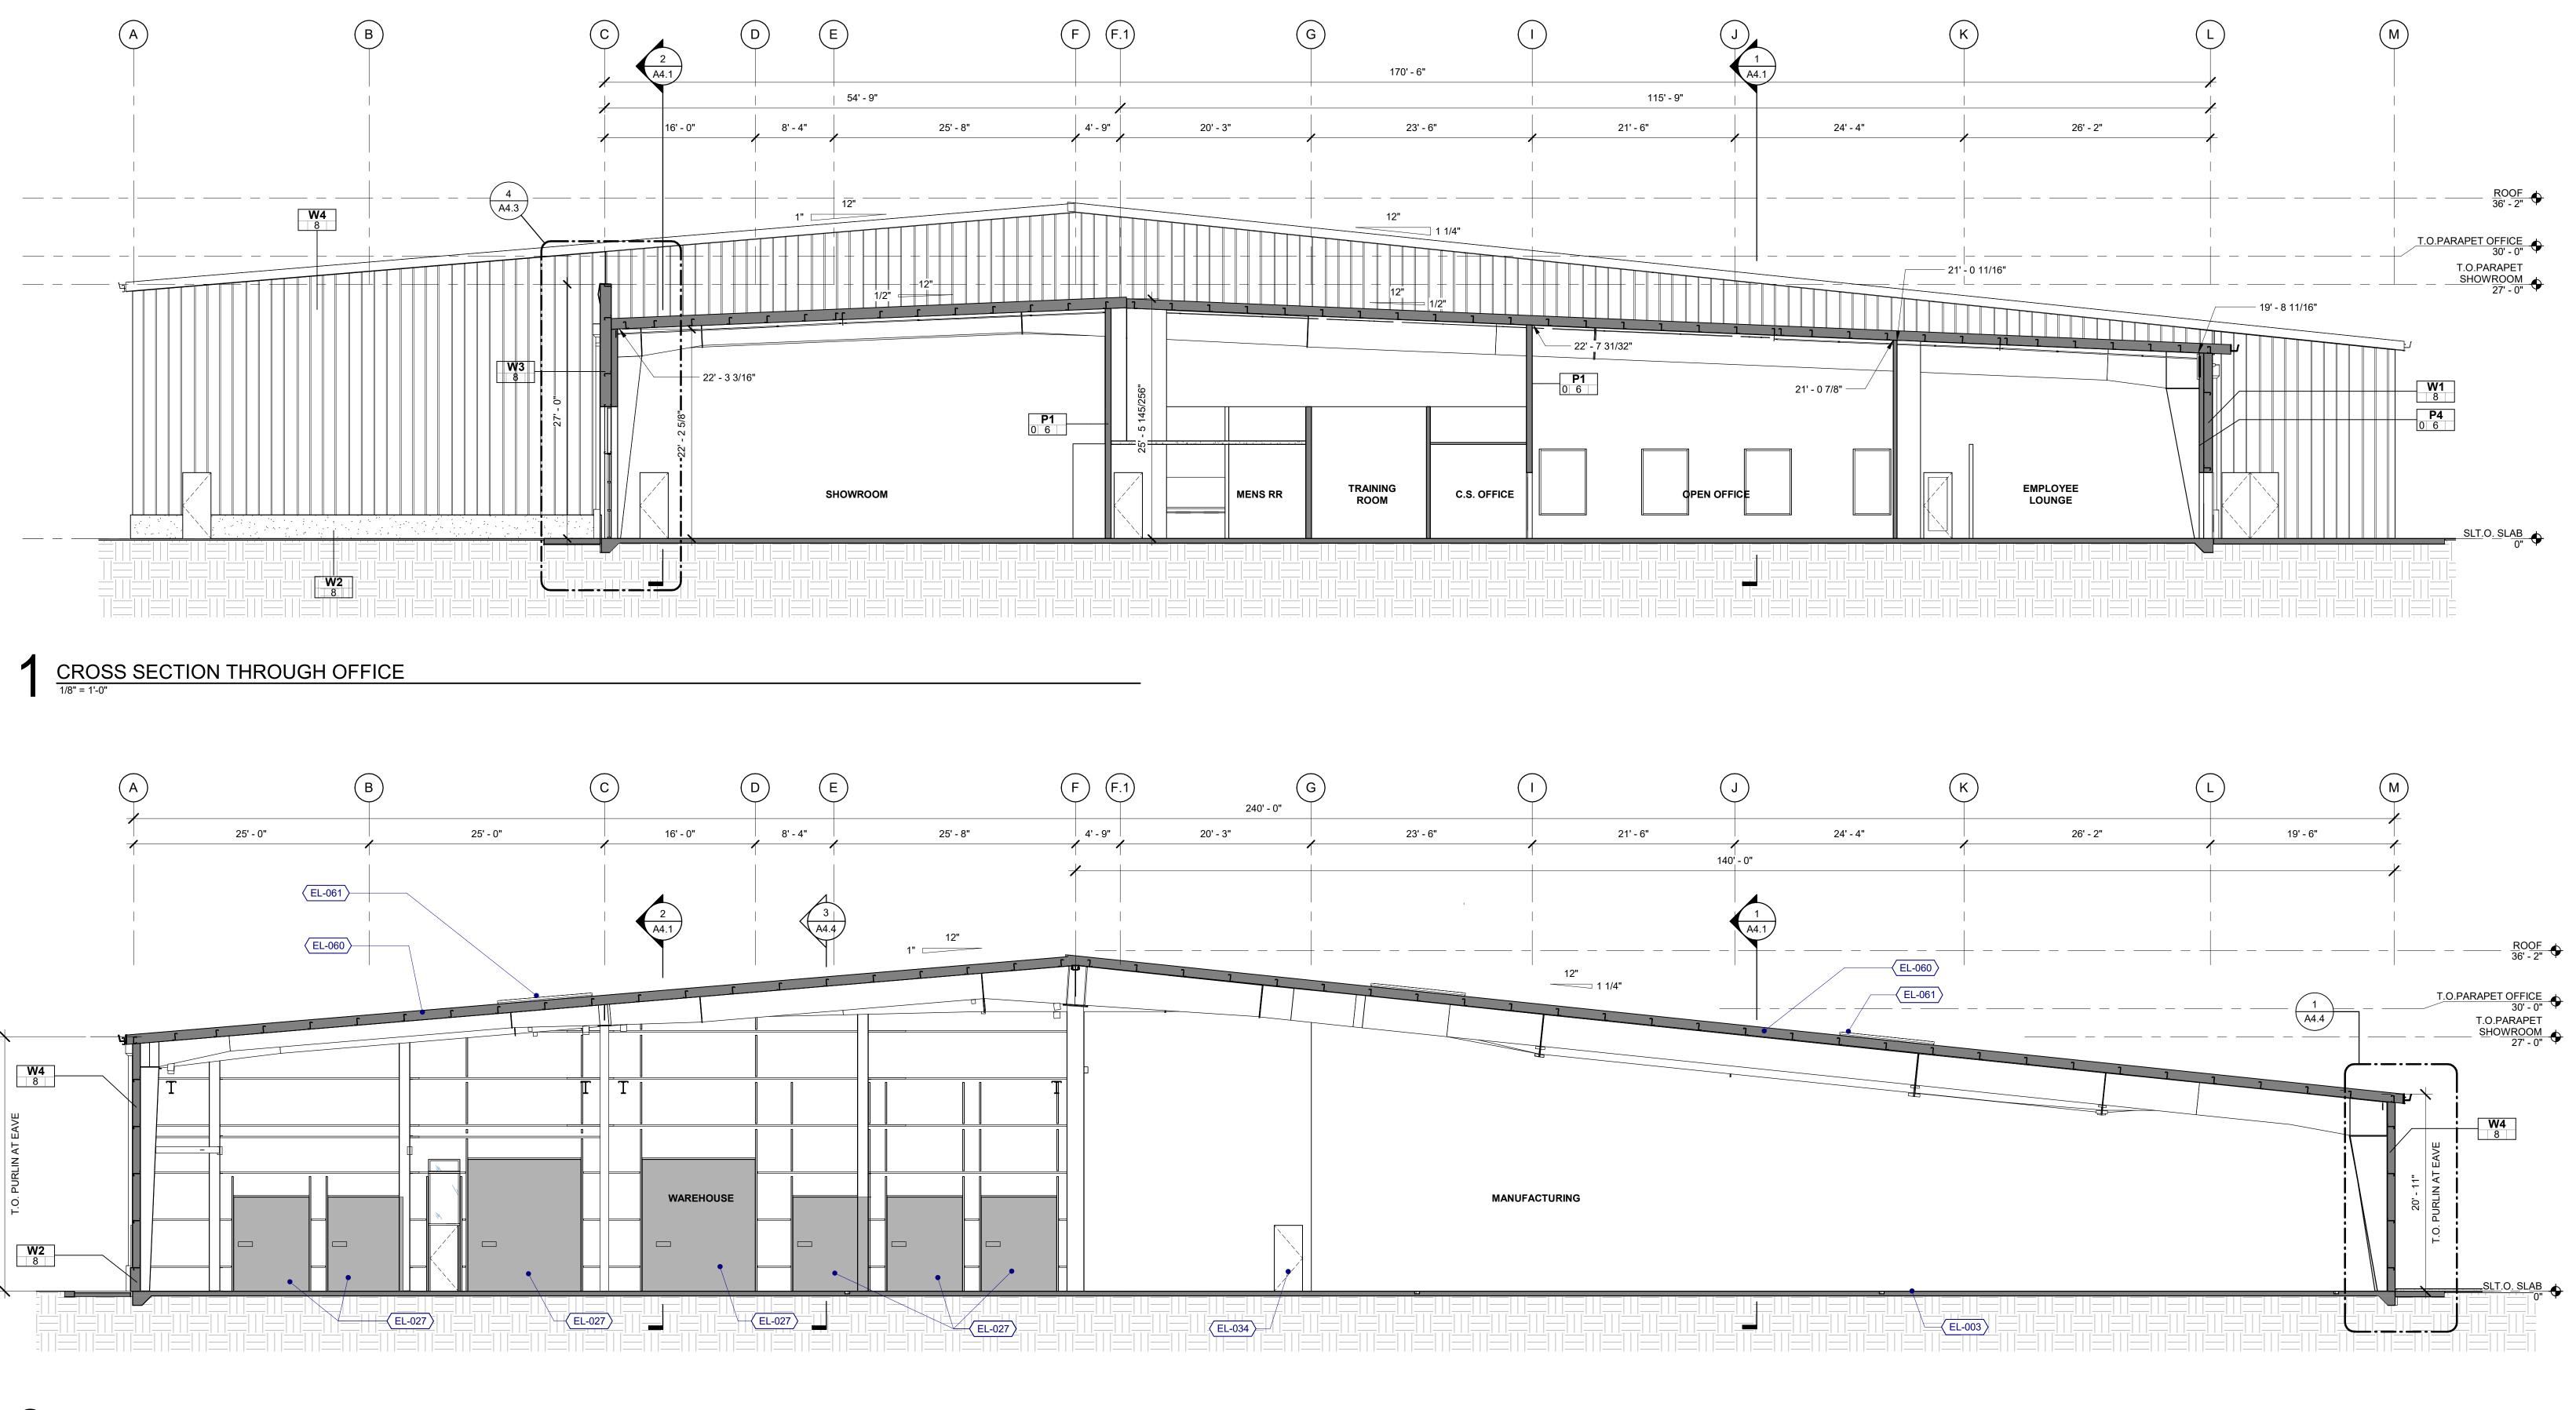



 $\frac{2}{1/8" = 1'-0"}$

KEYNOTES

EL-003 CONCRETE SLAB ON GRADE OVER GRAVEL BASE - SEE STRUCTURAL

EL-027 SECTIONAL DOOR, VERTICAL LIFT EL-034 PEDESTRIAN DOOR, HOLLOW METAL

EL-060 STANDING SEAM METAL PANEL ROOF, SEE ROOF PLAN FOR ASSEMBLY EL-061 SKYLIGHT

EL-062 PRE ENGINEERED METAL BUILDING FRAME, SEE PEMB SUPPLIER

DESIGN REVIEW SET - FEBRUARY 2023

A4.2

MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. 02/06/2023 Date: 121036 Job Number: Sheet

Descrip

Revisions:

BUILDING SECTIONS


Sheet Title:


SW Garden Acres Road Wilsonville OR 97070


Project: PRECISION COUNTERTOPS

26200 SW 95th Ave, Wilsonville OR 97070




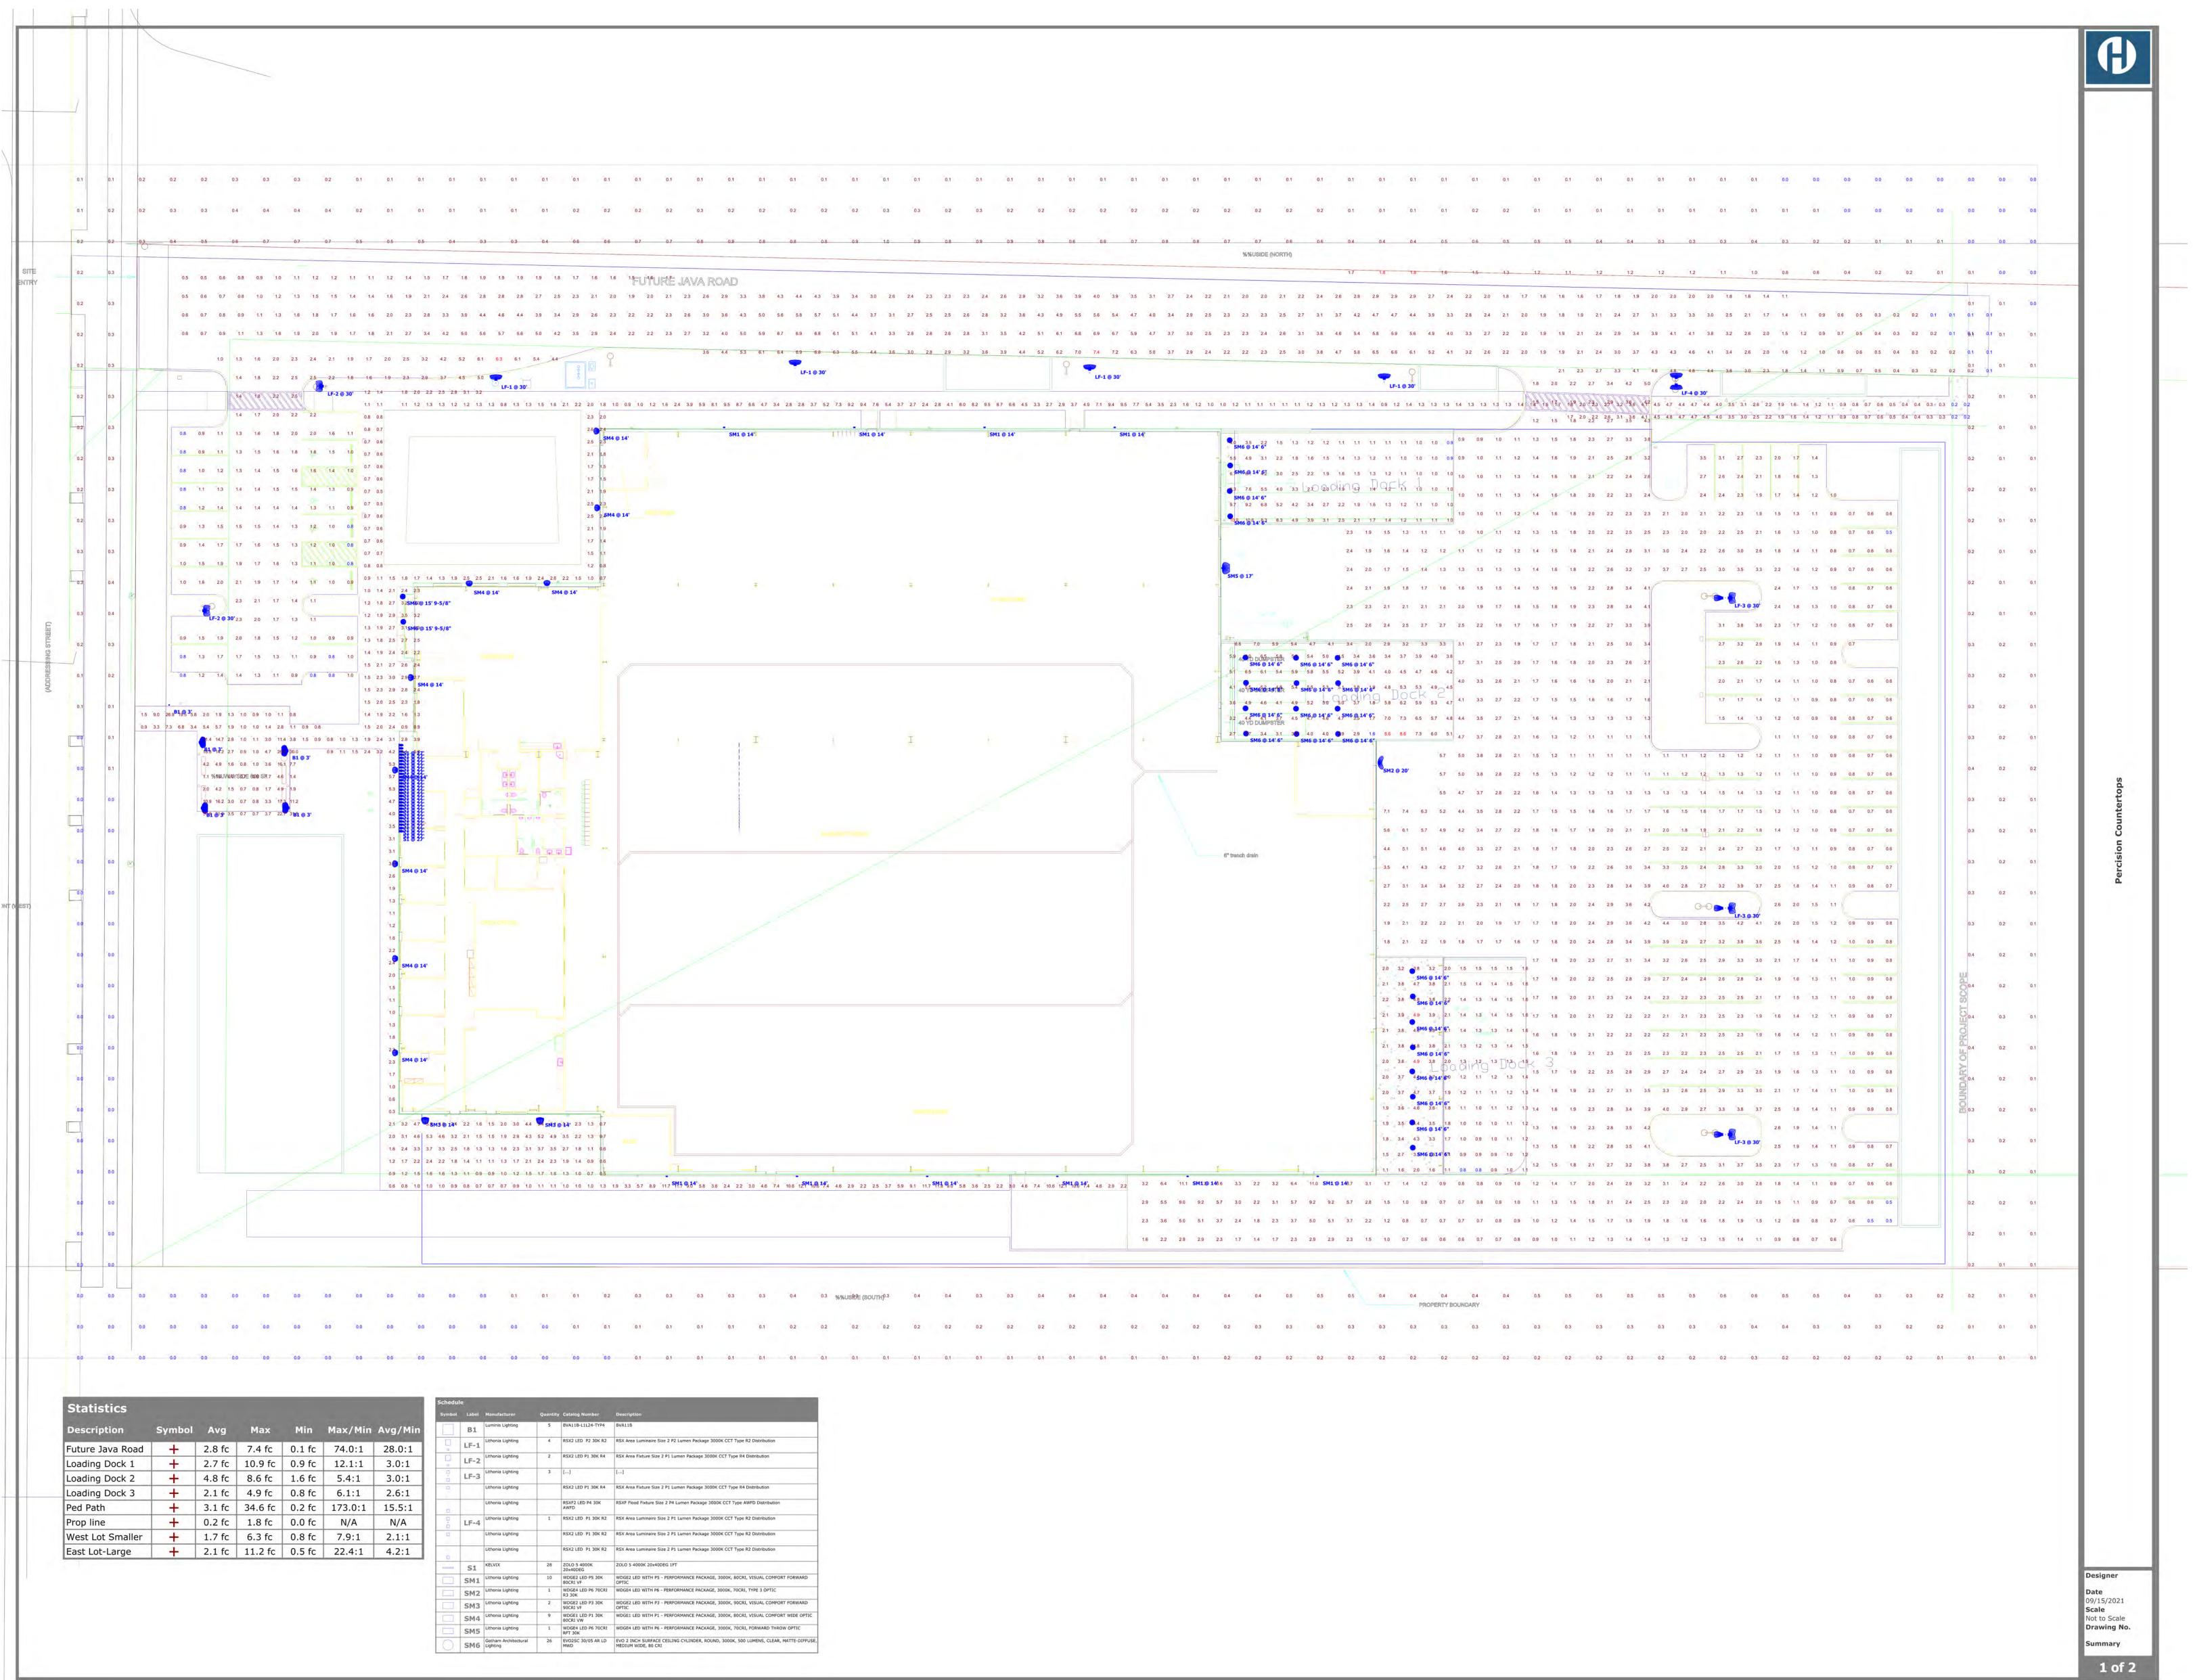

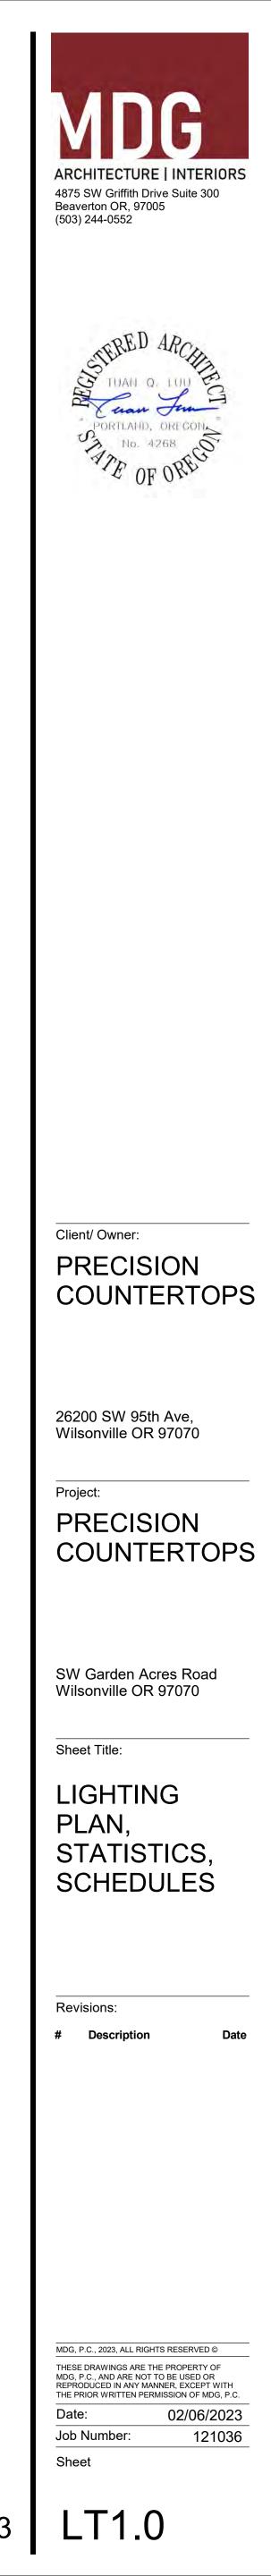


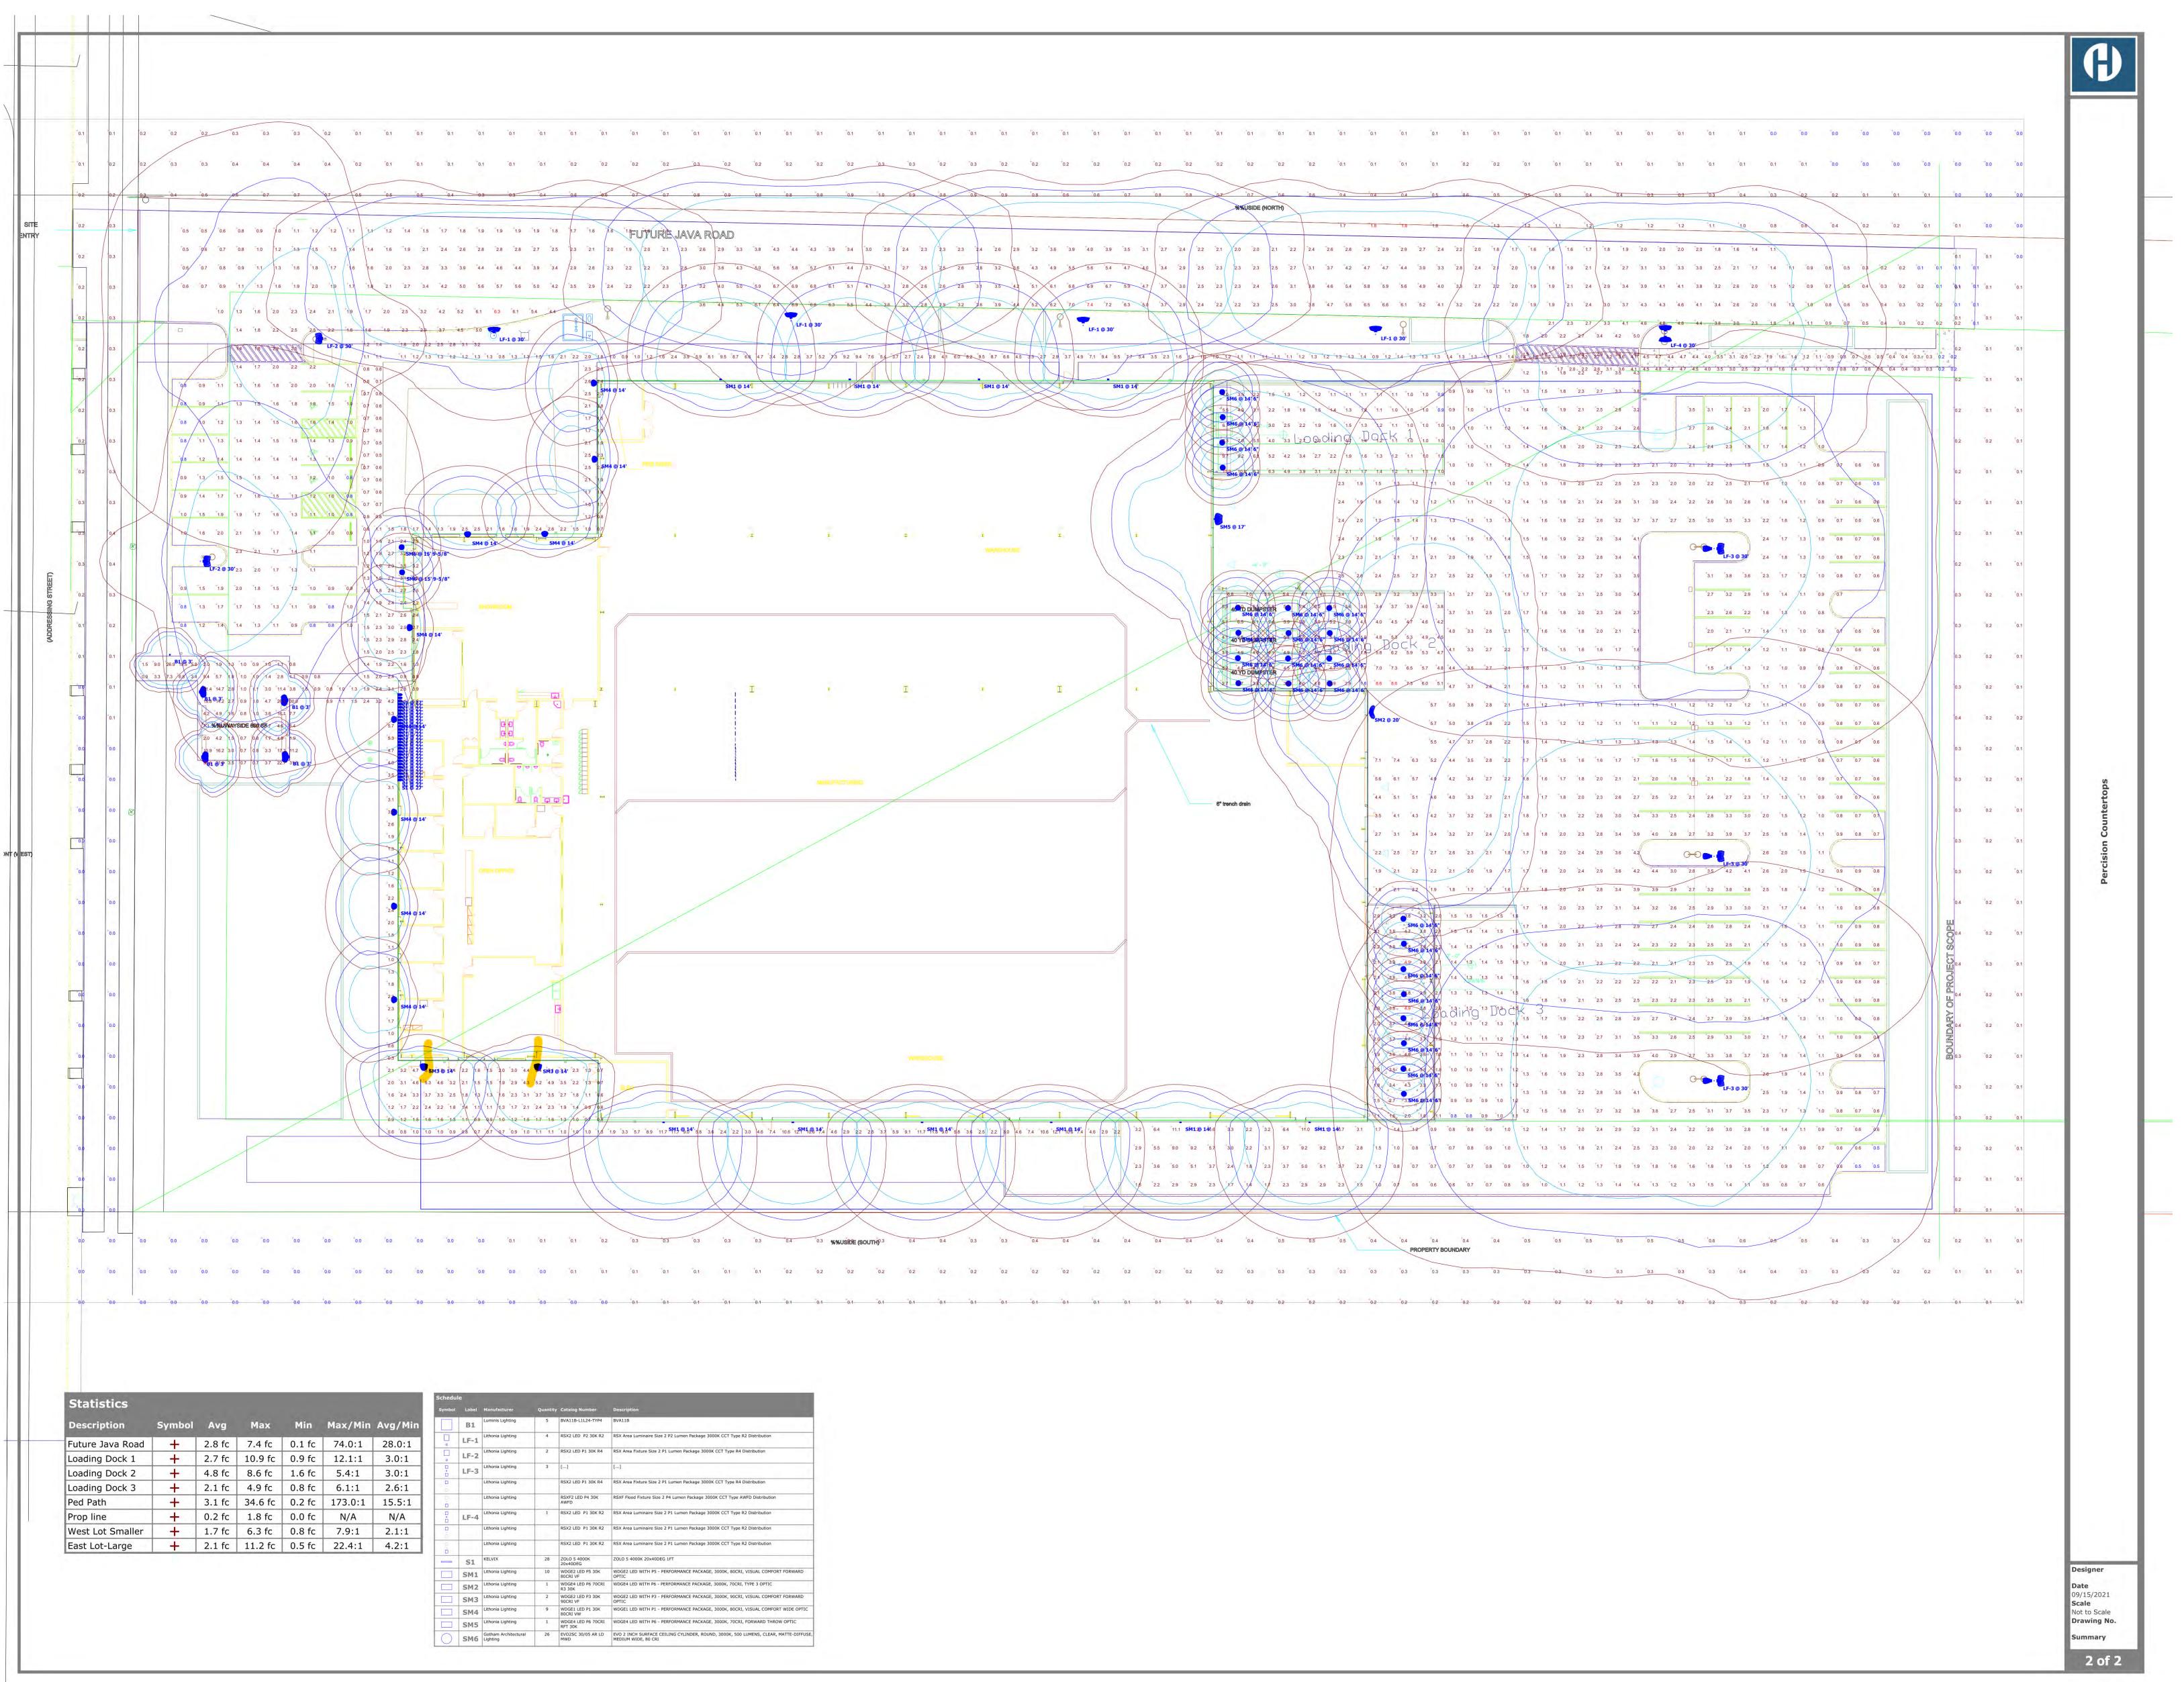

4875 SW Griffith Drive Suite 300 Beaverton OR, 97005 (503) 244-0552 Client/ Owner: PRECISION COUNTERTOPS 26200 SW 95th Ave, Wilsonville OR 97070 Project: PRECISION COUNTERTOPS SW Garden Acres Road Wilsonville OR 97070 Sheet Title: LIGHTING PLAN, STATISTICS, SCHEDULES Revisions: MDG, P.C., 2023, ALL RIGHTS RESERVED © THESE DRAWINGS ARE THE PROPERTY OF MDG, P.C., AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MDG, P.C. Date: 02/06/2023 121036 Job Number: Sheet

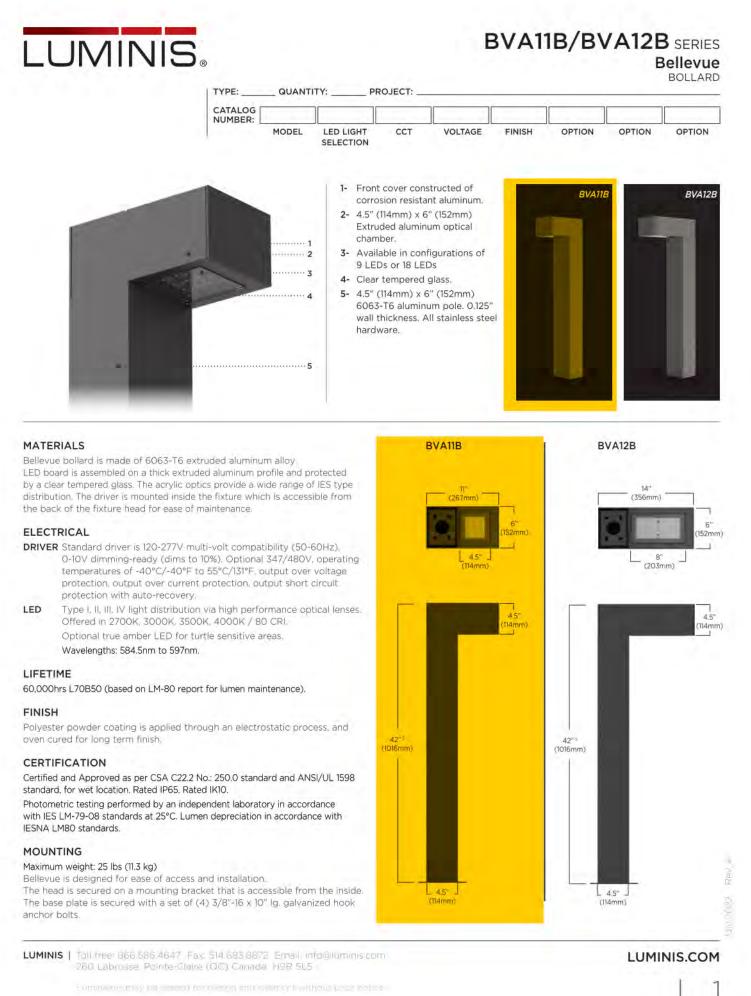


B-1 B-1 LIGHT FIXTURE

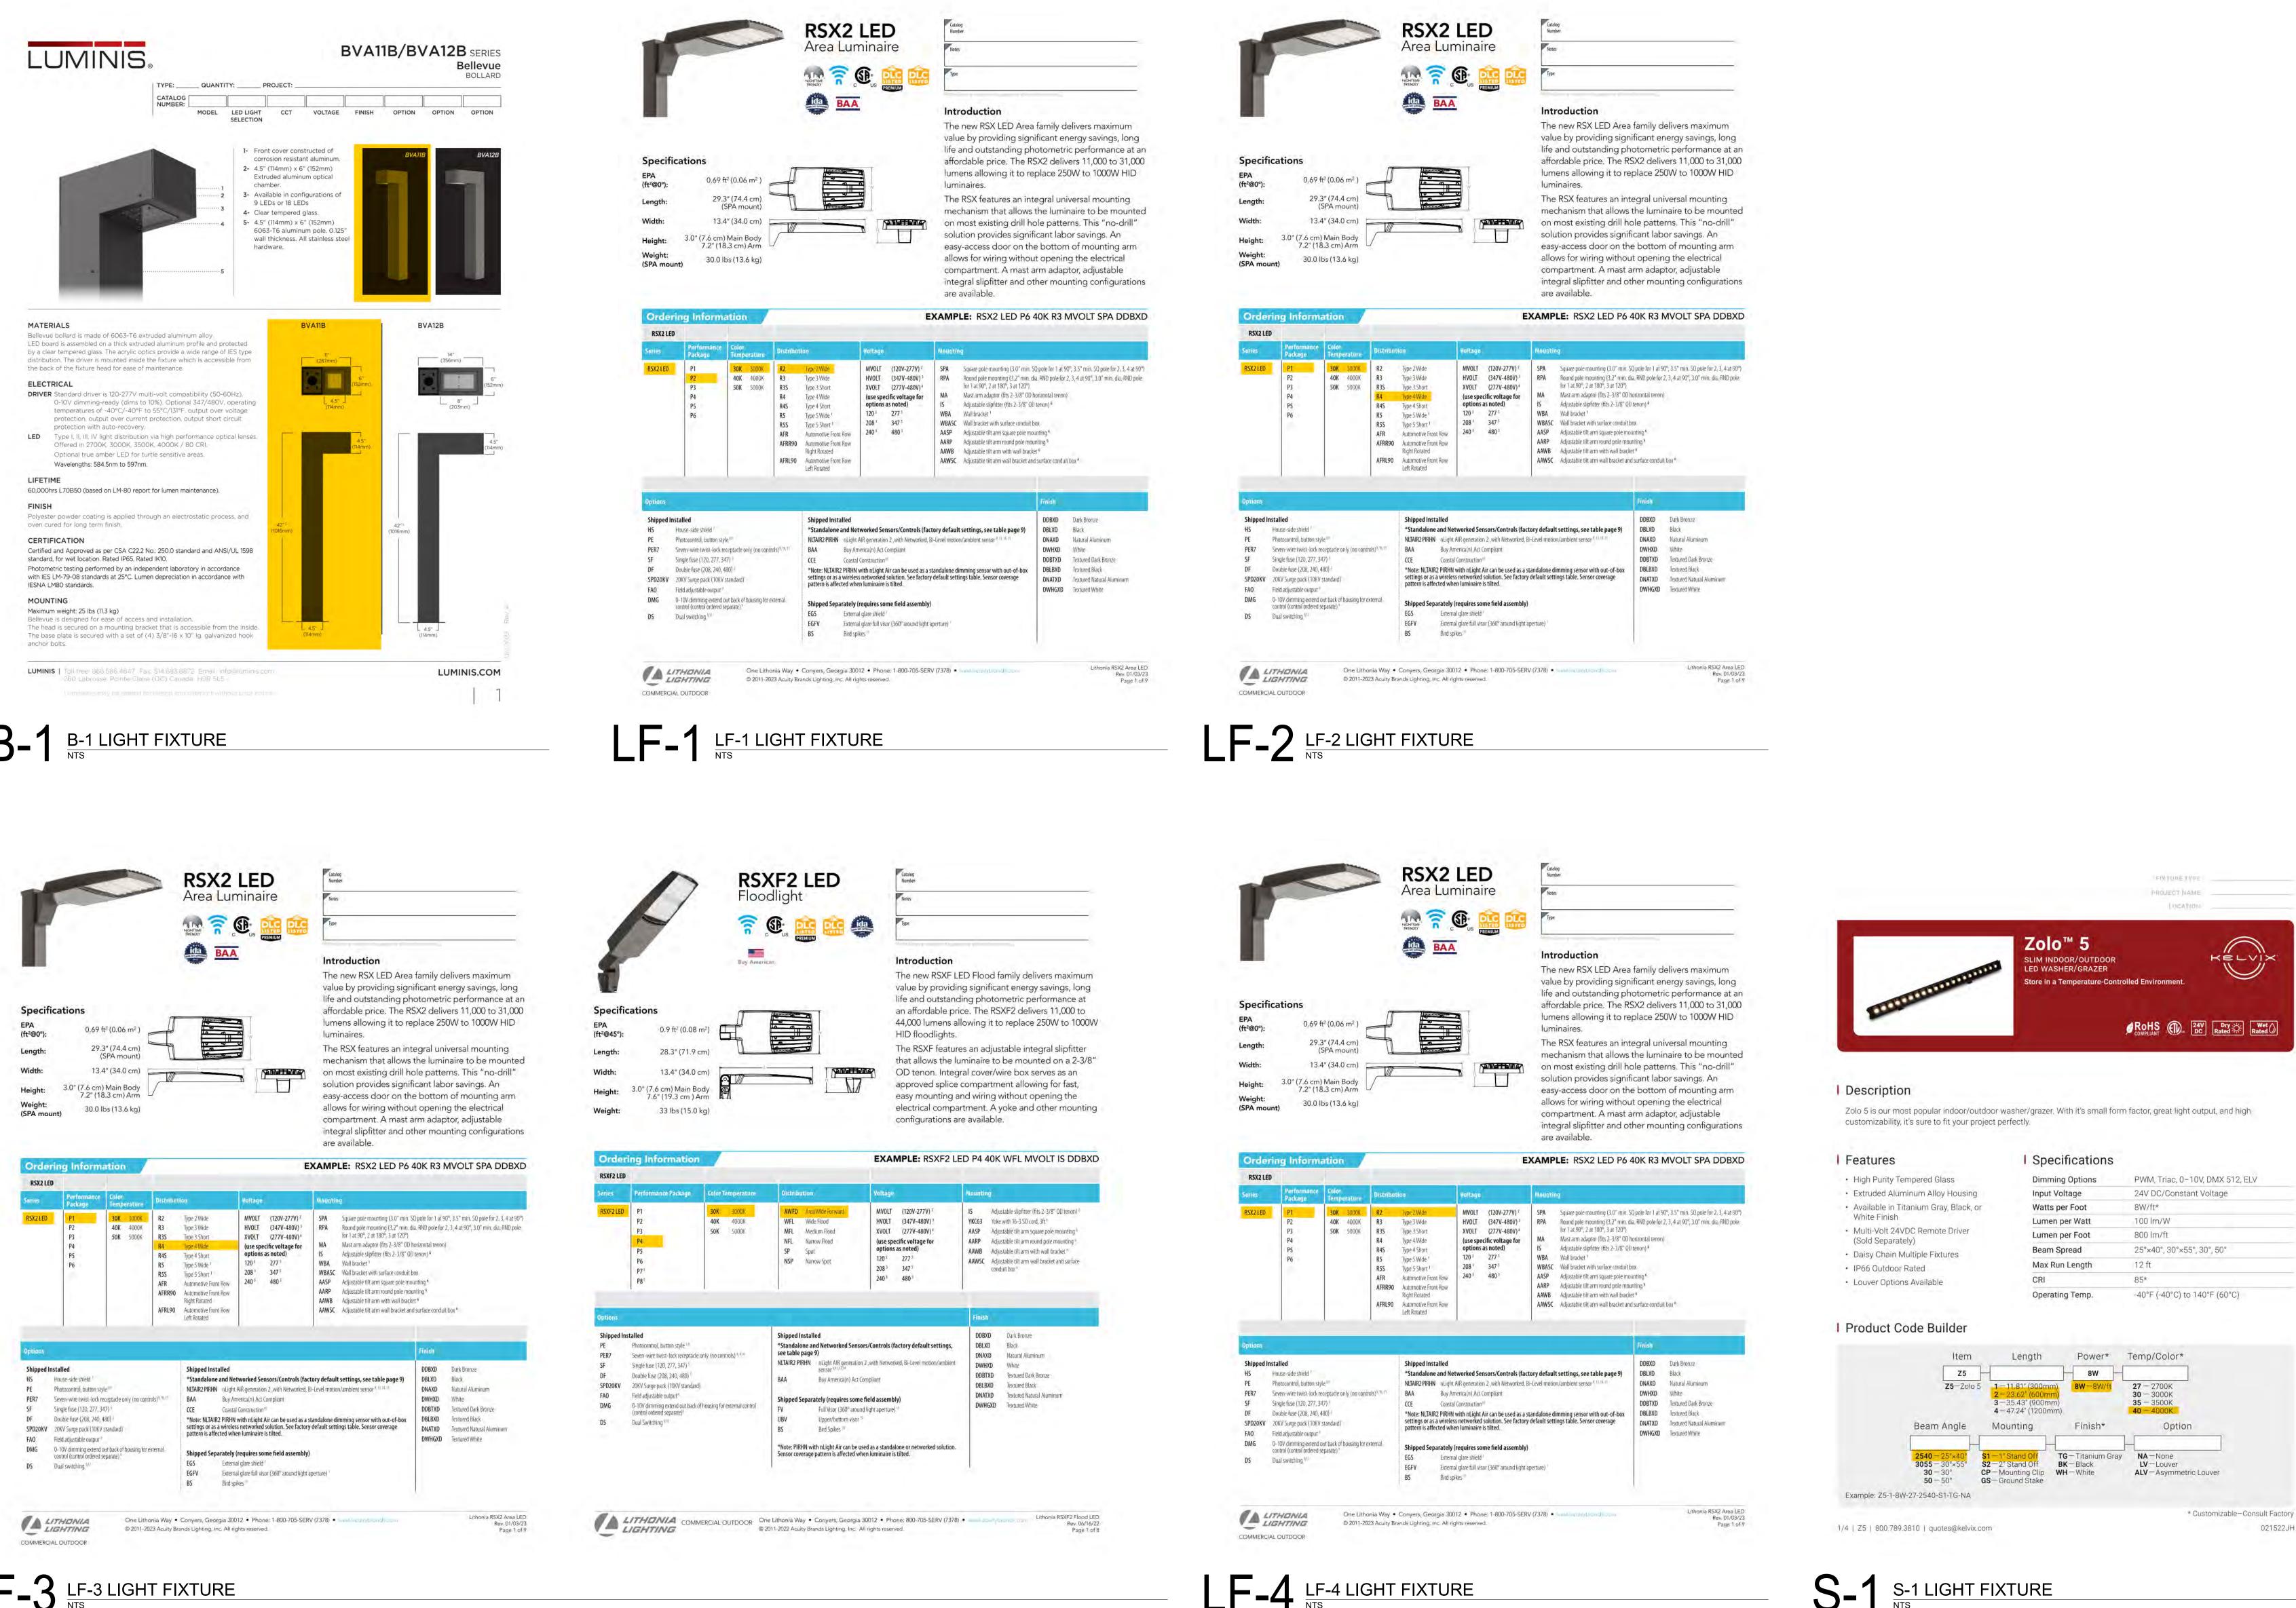

LF-3 LIGHT FIXTURE

LF-4 LIGHT FIXTURE

DESIGN REVIEW SET - FEBRUARY 2023

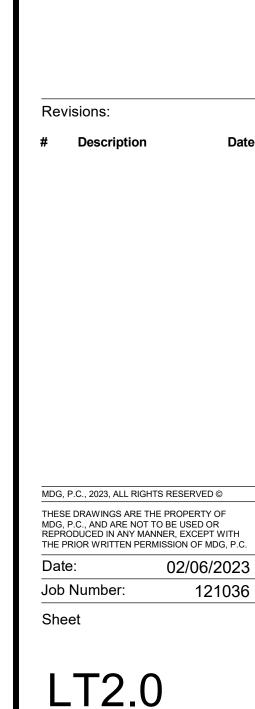

LIGHTING CUT SHEETS

SW Garden Acres Road Wilsonville OR 97070

Sheet Title:


Project: PRECISION COUNTERTOPS

26200 SW 95th Ave, Wilsonville OR 97070

uan T No. 4268





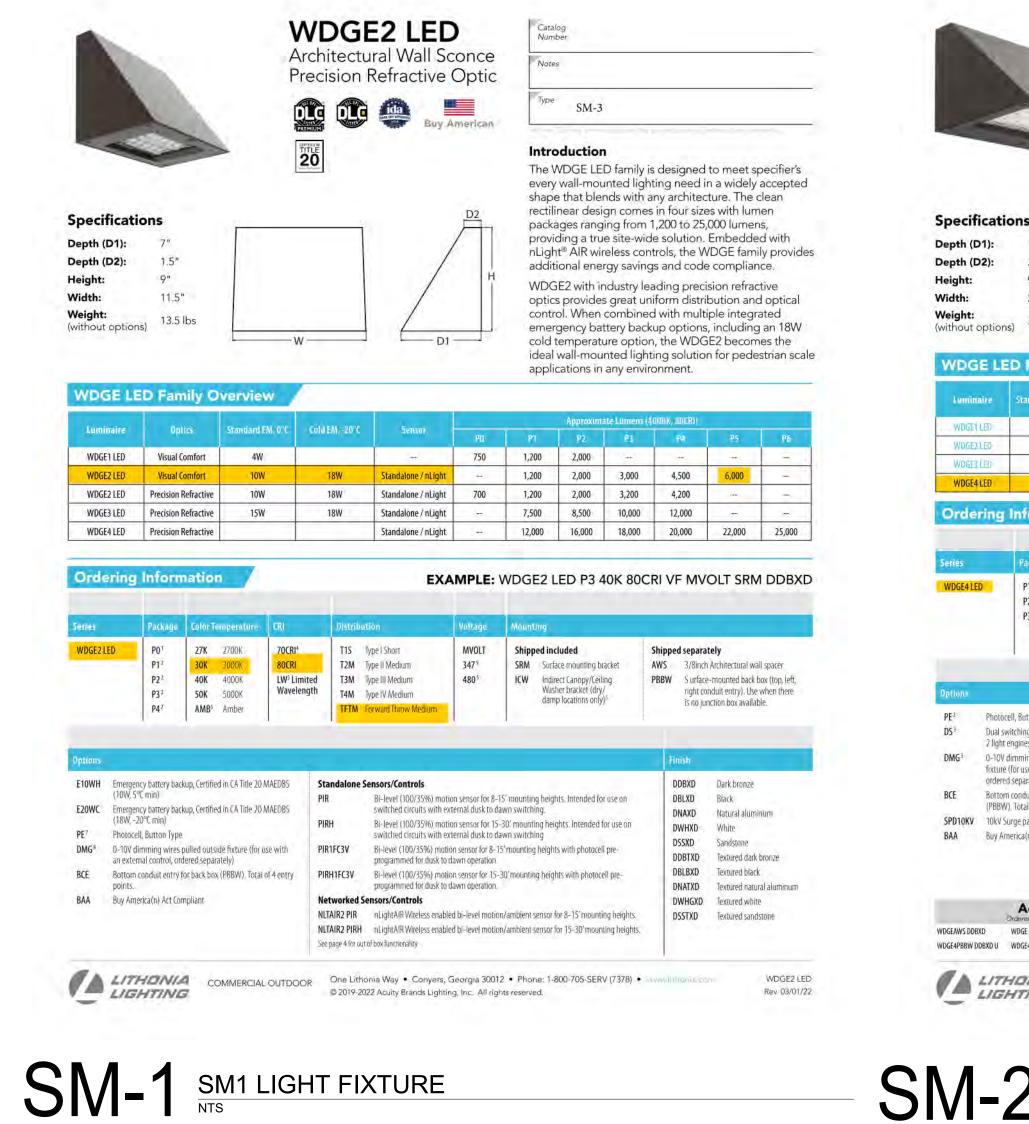



SM-5 SM5 LIGHT FIXTURE

			WDGE Architectu			Catalog Number Notes Type							ł	Architect Precision	E2 LEC ural Wall So Refractive	cond
cifications h (D1): 10" h (D2): 2" ht: 9" ht: 25" ht: 25" ht: 30.5 lbs		Introduct The WDG specifier's a widely at architectur in four size 1,200 to 25 solution. E controls, th energy sav WDGE4 h 25,000 lur with wide	Introduction The WDGE LED family is designed to meet specifier's every wall-mounted lighting need in a widely accepted shape that blends with any architecture. The clean rectilinear design comes in four sizes with lumen packages ranging from 1,200 to 25,000 lumens, providing a true site-wide solution. Embedded with nLight® AIR wireless controls, the WDGE family provides additional energy savings and code compliance. WDGE4 has been designed to deliver up to 25,000 lumens through a precision refractive lens with wide distribution, perfect for augmenting the lighting from pole mounted luminaires.				Specificati Depth (D1): Depth (D2): Height: Width: Weight: (without option	7" 1.5" 9" 11.5"			Buy	D2				
OGE LE	D Family O	verview	1				1.11.11.21							_		
iminaire	Standard EM, 0°C	Cold EM20°C	Sensor	P1	P2	Lumen P3	(4000K) P4	PS	P6		WDGE LE	D Family O	verview	e	-	
DGET LED DGEZ LED	4W 10W		- Standalone / nLight	1,200	2,000	3,000	4,500	6,000	-		Luminaire	Optics	Standard EM, 0°C	Cold EM, -20°C	Sensor	P
IOGES LED	15W	18W	Standalone / nLight	7,500	8,500	10,000	12,000		-		WDGE1 LED WDGE2 LED	Visual Comfort Visual Comfort	4W 10W	18W	Standalone / nLīght	75
DGE4 LED	÷ .	+	Standalone / nLight	12,000	16,000	18,000	20,000	22,000	25,000		WDGE2 LED	Precision Refractive	10W	18W	Standalone / nLight	-
dering	Information			E	KAMPLE: WI	DGE4 LED P	3 40K 70	OCRI R3 MVOL	T SRM DDBXD		WDGE3 LED WDGE4 LED	Precision Refractive Precision Refractive	15W	18W	Standalone / nLight Standalone / nLight	
_	Package	Color Temp	erature CRI	Distribution	Voltage	Mounting					WDGL4LLD	Flecision Reflactive			Stanuaione / Incigine	
E4 LED	P1 P4 P2 P5 P3 P6	30K 30 40K 40 50K 50	00K 80CRI	R2 Type 2 R3 Type 3 R4 Type 4 RFT Forward	MVOLT 347 ' 480 ¹	Shipped includ SRM Surface ICW Indirect Washer	led mounting bracke Canopy/Ceiling oracket (dry/ cations only) ¹	PBBW Surface-m right condi	y chitectural wall spacer ounted back box (top, left, uit entry). Use when there ion box available.		Ordering Series WDGE2 LED	P0 ¹ 27K	mperature CRI			AMPL Voltag MVOL 347 ⁵
Dual sv 2 light 5 0-10V i fixture orderei Bottom (PBBW 0KV 10kV S	II, Button Type itching (comes with 2 driv ngines) imming wires pulled outs for use with an external c separately) conduit entry for back bo . Total of 4 entry points. rge pack erica(n) Act Compliant	ers and PIR aide PIRH ontrol. PIRH x PIRH NET NUTA	circuits with ex Bi-level (100/3 circuits with ex FC3V Bi-level (100/3 dusk to dawn o ITFC3V Bi-level (100/3 for dusk to daw worked Sensors/Control: JIR2 PIR nLightAlR Wirel	5%) motion sensor fo ternal dusk to dawn s 5%) motion sensor fo ternal dusk to dawn s 5%) motion sensor for peration. 5%) motion sensor for n operation. 5 ses enabled bi-level m	r 15-30' mounting height	s. Intended for use on s with photocell pre-progra with photocell pre-prog 8-15' mounting heights.	witched immed for rammed	DBLBXD Textured b	uminum e lark bronze olack uatural aluminum vhite		(10W, S1 E20WC Emerger (18W, -2 PE ⁷ Photoce DMG ^a 0-10V di an exter	P37 SOK P42 AMB ³	5000K Amber d in CA Title 20 MAEDBS d in CA Title 20 MAEDBS d in CA Title 20 MAEDBS de fixture (for use with stely)	length T4M	Type III Medium Type IV Medium Forward Throw Medium Forward Throw Medium Sensors/Controls Bi-level (100/35%) moti switched circuits with ey Bi-level (100/35%) moti switched circuits with ey Bi-level (100/35%) moti programmed for dusk to Bi-level (100/35%) moti programmed for dusk to	external dus tion sensor external dus tion sensor l o dawn oper tion sensor l
VS DDBXD	Accessories Provened and shipped second WDGE 3/8inch Architectural V WDGE4 surface-mounted bac	arely Vall Spacer (specify finis	ih)			2 PE not 3 DS and	available in 48 DMG not ava	vailable with DS. OV and with sensors/con ilable with sensors/contri . Not available with eme	ols.		BAA Buy Ame	rica(n) Act Compliant		NLTAIR2 PIR NLTAIR2 PIRH	Sensors/Controls nLightAIB Witeless enable	aled bi-level
	HTING	mmercial out	IDOOK	2 Acuity Brands Lig	rs, Georgia 30012 • hting, Inc. All rights n		SERV (7378)	• Avvw.IIIInanie.com	WDGE4 LED Rev. 03/01/22			HTING	I3 LIGF	© 2019-24	ionia Way • Conyers, 022 Acuity Brands Lightir	1 1 1 1 1 T

	ľ │ E ∨ le Layers of	O [®] Light	\bigwedge			uminaire Type: talog Number: Buy American		Comptilia Electrony Start	
lluminat	ion Surface	Ceiling C	linder	2				_	
es ™ optical desi source and sou ngeable optic	n horizontal and ign	 Fixtures are v option) ENERGY STA 20 standard 	5 CRI typical,	90+ CRI optio wered ceiling (roduct ed and gloss fi	onal WL				
medi 1.0 S	ium wide wid :MH 1.2	le S:MH							_
540 81 6.3 9	50 1000 1500 02 1073 1537 .7 12.7 21.2 13 84 73	2000 2094 31.7 66							
ertures Mul	Itiple Layers of Lig	nt		1	-		-	1	1
• • •				T			-	-	
ral Illumination	Layer I EVO		ligh Center Bea	m Layer I Incite		EVO +	Incito — Multip	le Layers of L	ight
	A constant of the second of th	-	Aligh Center Bear	m Layer I Incitor	cylinder	EVO +	Incito — Multip Bevel	le Layers of L Hyperbolic	ight
ral Illumination ore hcare		Adjustable		~		•	•	÷.	ight

GOTHAM ARCHITECTURAL DOWNLIGHTING | 1400 Lester Road Convers, GA 30012 | P 800-705-SERV (7378) | gothamlighting.com © 2014-2022 Acuity Brands Lighting Inc. All Rights Reserved. Rev. 09/08/22 Specifications subject to change without notice. The product images shown are for illustration purposes only and may not be an exact representation of the product.

IXTURE

EXAMPLE:	Capable options indica his color background.	ted				
AND A DESCRIPTION OF A	EV02SC 35/10 A	R LSS MWD MVOLT UGZ RO	GH DWHG			_
Series		Color Temperature	Lumens		Reflector Color	-
	EVO 2in Round Surface Ceiling Cylinder Open Downlight	27/ 2700 K 30/ 3000 K 35/ 3500 K 40/ 4000 K 50/' 5000 K	05 500 07 750 10 100 15 150	lumens lumens lumens O lumens O lumens O lumens	AR Clear PR Pewter WTR Wheat GR Gold WR ² White pain BR ² Black pain BZR ² Dark Bron	
Voltage		Dalizati		Manushing		Contr
MVOLT 1 120 1	20V - 277V 20V 277V	(0-10V, 120V TRIAC or ELV) SGB Surface (SGBPR Surface (Conceale SGBCC Direct Co Gear Box JBXCC - Surface J			essed Gear Housing face Gear Box face Gear Box with cealed Plaster Ring ect Conduit Surface r Box face J-Box with iduit Covers	1.440.000
Options			Archite	ctural Colors - I	Powder Paint ^a	
90CRI ¹ N80 ⁷ WL ⁸	High CRI (90+) nLight Lumen Cr Wet Location	ompensation	DDB DBL DWH DMB DNA DSS DGC DBR DSB	Gloss Dark Bron Matte Black Gloss White Matte Medium Gloss Natural A Gloss Sandston Gloss Charcoal Gloss Tennis Gr Gloss Bright Re Gloss Steel Bluu	Bronze Juminum e Grey een d	DDBT DBLB DWHO DBNH DNAT DSST DSPD DSPE DSPH DWH/

page 2 of 8 © 2014-2022 Acuity Brands Lighting Inc. All Rights Reserved. Rev. 09/08/22 Specifications subjec The product images shown are for illustration purposes only and may not be an exact representation of

1				
or				
D	ot	ic	-	
ne	ric	án		

Catalog Number

Notes	
Туре	SM-3
Intro	duction
nuroc	DGE LED family is designed to meet specifier's

applications in any environment.


shape that blends with any architecture. The clean rectilinear design comes in four sizes with lumen packages ranging from 1,200 to 25,000 lumens, providing a true site-wide solution. Embedded with nLight® AIR wireless controls, the WDGE family provides additional energy savings and code compliance. WDGE2 with industry leading precision refractive optics provides great uniform distribution and optical control. When combined with multiple integrated emergency battery backup options, including an 18W cold temperature option, the WDGE2 becomes the ideal wall-mounted lighting solution for pedestrian scale

	Auto	Approximate Lumens (4000K, 80CRI)									
l, -20°C	Sensor	PO	P1	P2	P3	R4	R5	P6			
		750	1,200	2,000		-		-			
W	Standalone / nLight	-	1,200	2,000	3,000	4,500	6,000	-			
W	Standalone / nLight	700	1,200	2,000	3,200	4,200	-	-			
W	Standalone / nLight	-	7,500	8,500	10,000	12,000	+				
	Standalone / nLight		12,000	16,000	18,000	20,000	22,000	25,00			
Distribu	tion	Voltage	Mounting								
T2M T3M	Type I Short Type II Medium Type III Medium Type IV Medium	MVOLT 347 ⁵ 480 ⁵	ICW India Wasi	cluded ace mounting br ect Canopy/Ceili her bracket (dry, p locations only)	ng	PBBW Surface	tely Architectural wa e-mounted back b nduit entry). Use nction box availab	box (top, left, when there			
TETM	Forward Throw Medium			p reserves any			nenon box ayanat	лс.			
TETM	forward Throw Medium			, assuments and t		Finish	nchon box availat	ле.			
dalone S C3V	ensors/Controls Bi-level (100/3596) motic switched circuits with exit switched circuits with exit Bi-level (100/3596) motic switched circuits with exit Bi-level (100/3596) motio programmed for dusk to d Bi-level (100/3596) motio programmed for dusk to d ensors/Controls	ternal dusk to d on sensor for 15 ternal dusk to d on sensor for 8-1 awn operation on sensor for 15-	15' mounting heigt awn switching. -30' mounting heig awn switching '5' mounting height	nts. Intended fo ghts. Intended f is with photocell	r use on or use on pre-		Dark bronze Black Natural alumi White Sandstone Textured dark Textured black Textured natur Textured matur	num bronze (. al aluminur			

Specificati Depth (D1): Depth (D2): Height: Width: Weight: (without option	5.5" 1.5" 8" 9" 9 Ibs		Archite 20	State of the state	ida	America D2	n L T s a a ir 1 s v N v v b	pecifier widely rchitect four si: ,200 to olution. VDGE1 on-pixe omforta VDGE1, ackup c	ction GE LED family 's every wall-mo accepted shap ure. The clean zes with lumen 25,000 lumens, delivers up to 2 able environme able environme with its integra option, makes i unted lighting s	punted lighting rectilinear de packages ra providing tra 2,000 lumens rce, creating ent. The comp ated emerge t an ideal over	ng need ir s with any esign com- nging fror ue site-wid s with a so a visually pact size c ncy batter
WDGE LE	D Family	Overview	<u></u>	-				(and	ens (400DX)		
Luminaire	Standard EM, 0°C	Cold EM, +20°C	Sensor		- P1	12		73	P4	P5	PE
WDGE1 LED	4W	-	-		1,200	2,000			-	Jec.	-
WDGE2 LED	10W	18W	Standalone / n	Light	1,200	2,000		3,000	4,500	6,000	
WDGE3 LED	15W	18W	Standalone / n	Light	7,500	8,500		10,000	12,000	1 Her	-
WDGE4 LED	1	12,22	Standalone / n	Light	12,000	16,000	0	18,000	20,000	22,000	25,000
Ordering	Informatio	on /			EXAN	IPLE: W	DGE1 L	ED P2	40K 80CRI VF	MVOLT SR	M PE DD
Ordering Series WDGE1 LED	Package C P1 P2	olor Temperature 27K 2700K 30K 3000K 35K 3500K 40K 4000K 50K' 5000K	CFI 80CRI 90CRI				VDGE1 L Voltage MVOLT 347 ²	Mountin Shippe SRM ICW		eet Washer bracket (dry/da vall spacer box (top, left, right cond	imp locations enily.
Series	Package C P1 P2	olor Temperature 27K 2700K 30K 3000K 35K 3500K 40K 4000K	80CRI	VF Visi	on ual comfort forwa		Voltage MVOLT	Mountin Shippe SRM ICW Shippe AWS	rg dincluded Sufface mounting brack Indirect Canopy/Ceiling d separately 3/Binch Architectural w Sufface-mounted back	eet Washer bracket (dry/da vall spacer box (top, left, right cond	smp locations only)


SM-4 SM4 LIGHT FIXTURE


	Luminaire Typ Catalog Numbe	-	
fle S	ctor Finish Semi-specular Matte diffuse	Distrib ND MWD WD	Narrow (0.8 s/mh) Medium Wide (1.0 s/mh) Wide (1.2 s/mh)
er	face ^s		
4	nLight® AIR dimmin nLight® AIR dimmin	ack for fixt g pack. g pack fo	ures on emergency circuit r fixtures on emergency circuit r fixtures on emergency circuit
	Textured Dark Bronze Textured Black Textured White Textured Bronze Textured Natural Alun Textured Sandstone Textured Dark Grey Textured Green Textured Light Red Gloss White with Anti-		finish
VL.	rer.		
S	GBCC or JBXCC.	ease see	Architectural colors.
ct	178) gothamlighting.co o change without notice. e product.	m	😢 gothar

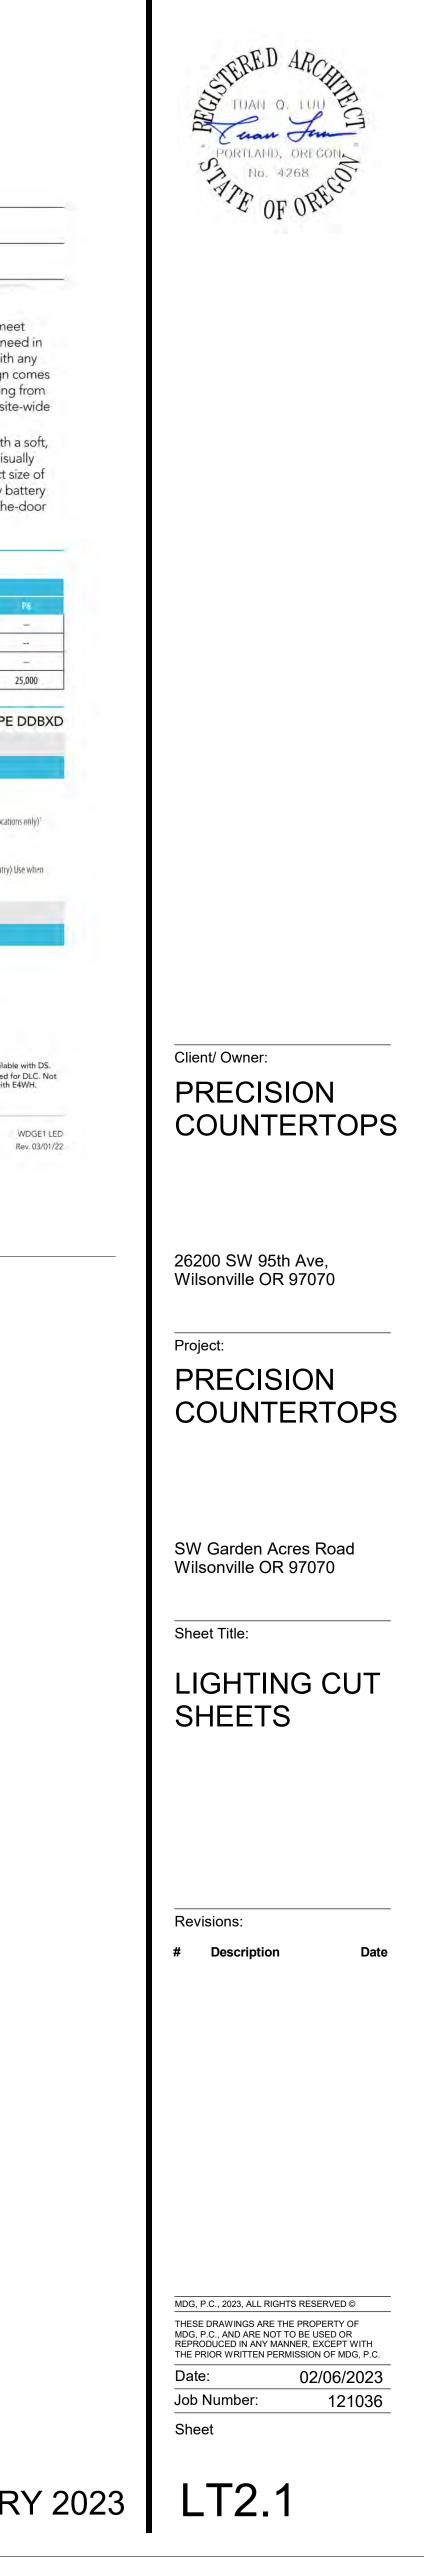


ARCHITECTURE | INTERIORS 4875 SW Griffith Drive Suite 300

Beaverton OR, 97005 (503) 244-0552

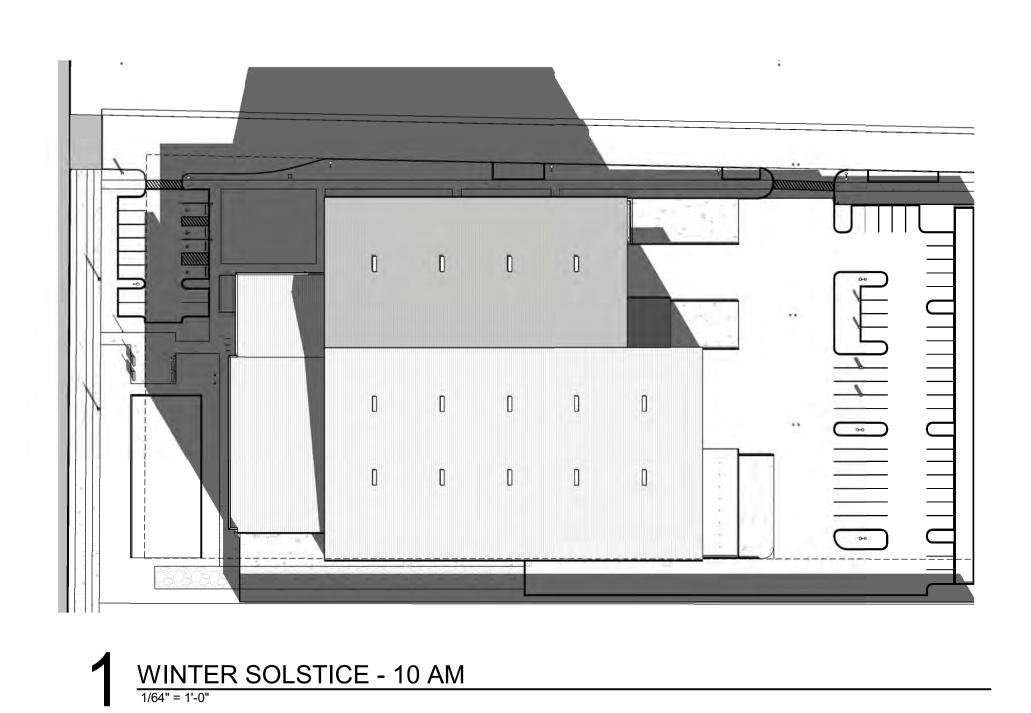


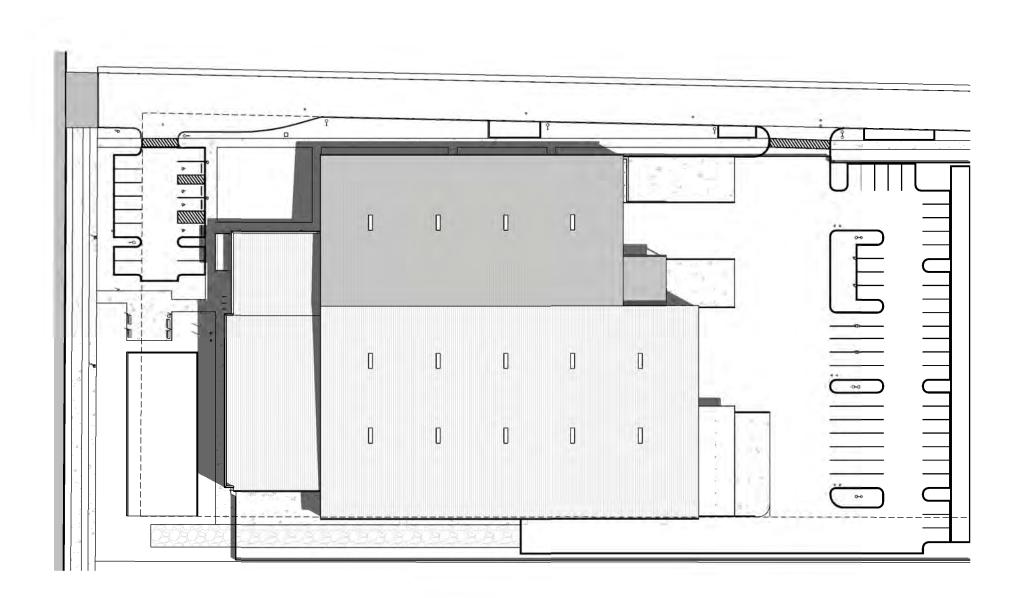


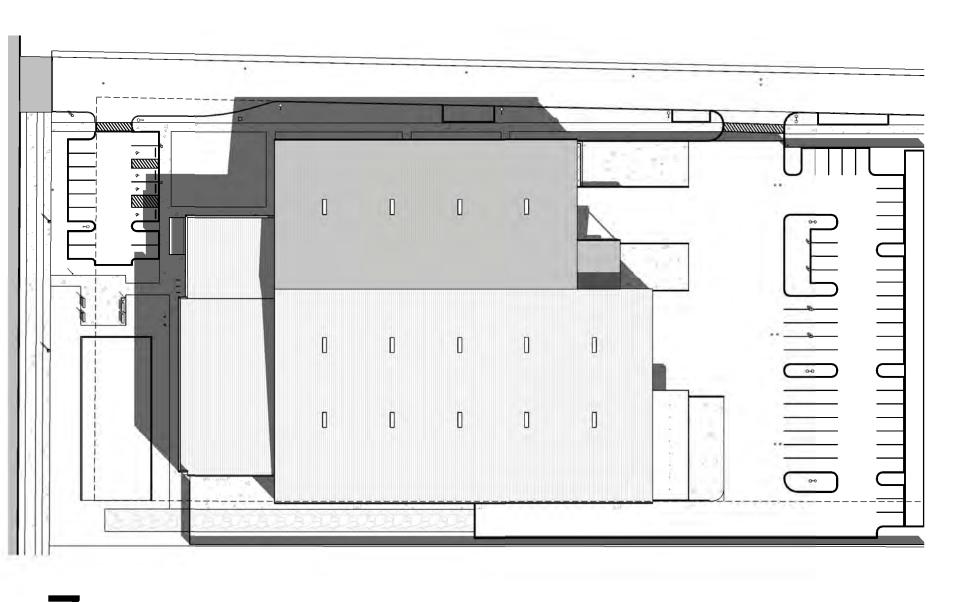

SPRING/FALL EQUINOX - 10 AM


 $4 \quad \frac{\text{SUMMER SOLSTICE - 10 AM}}{\frac{1}{64"} = 1'-0"}$

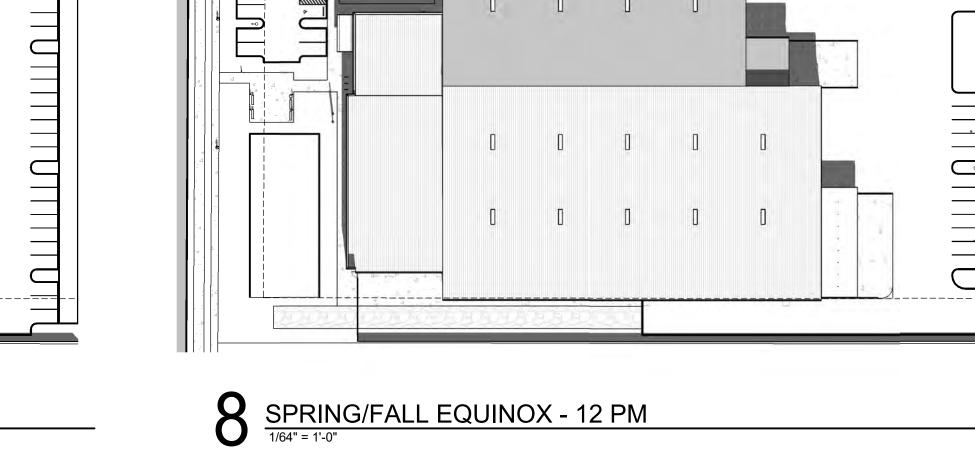


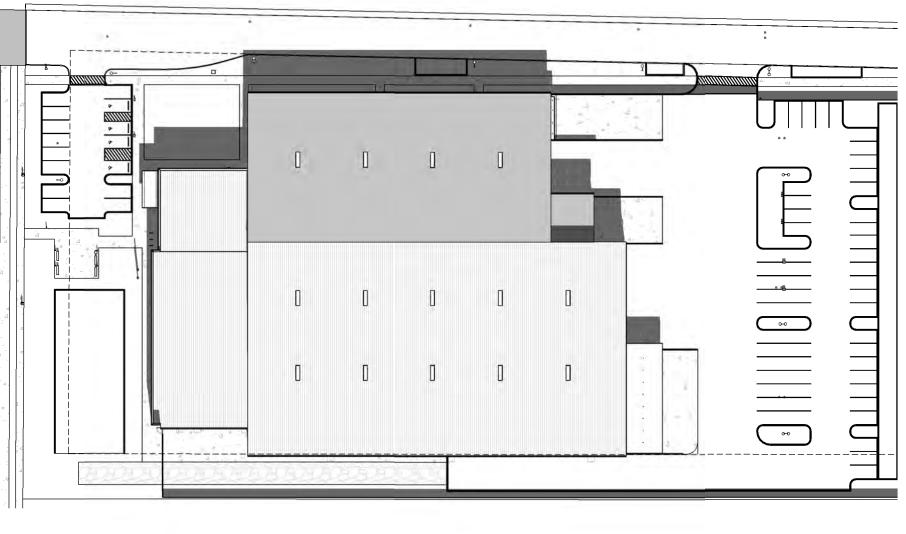





1/04 - 1-0

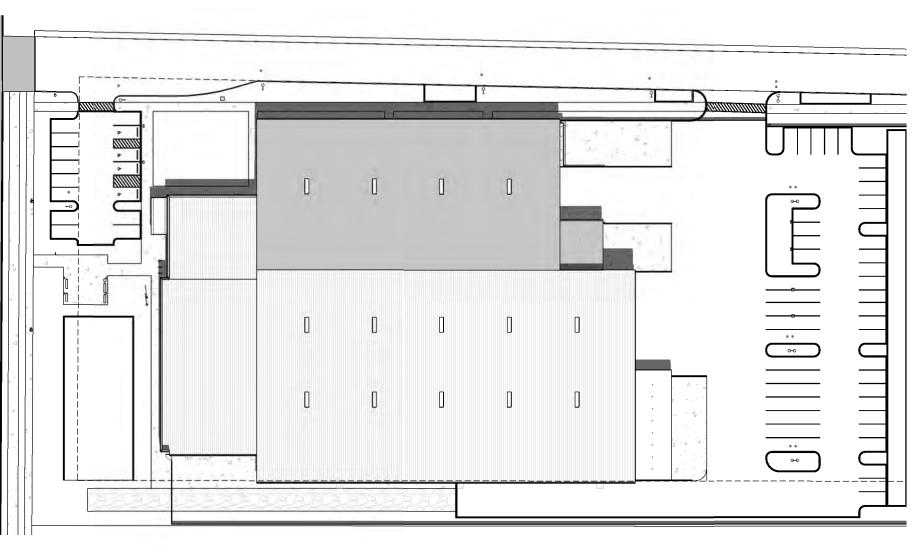

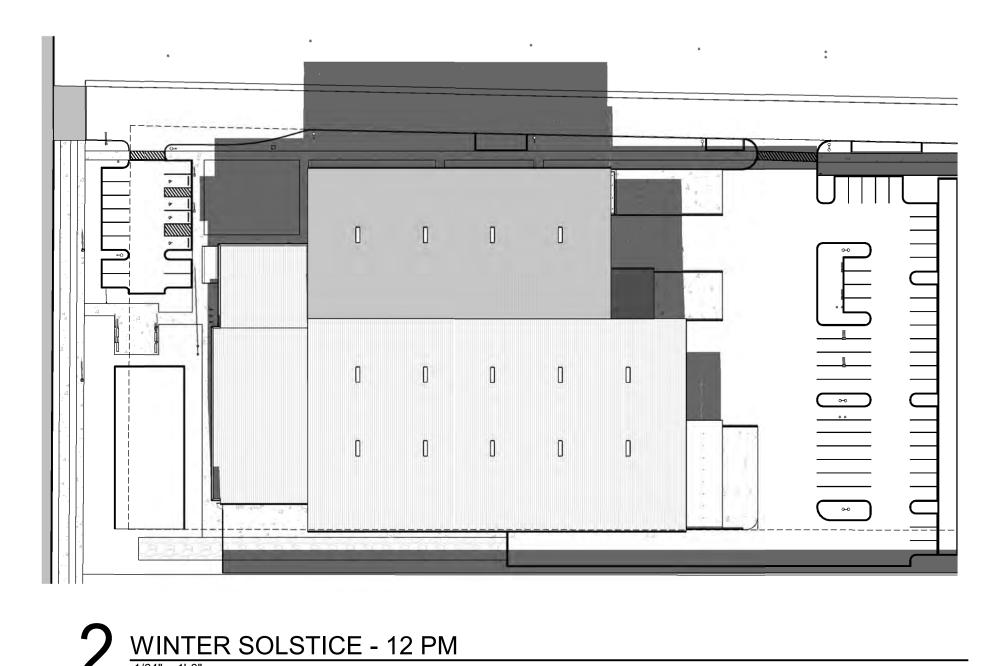

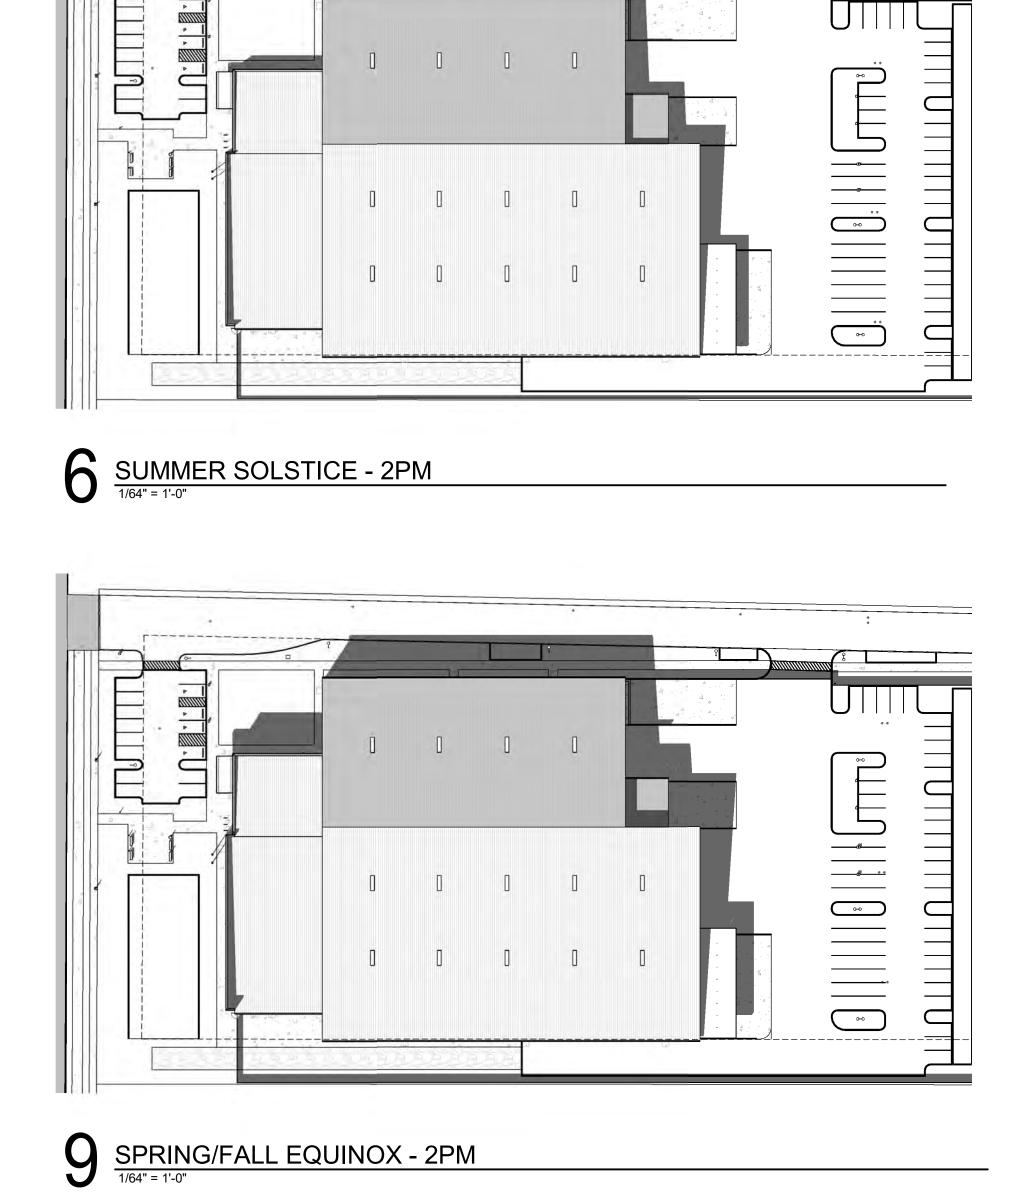

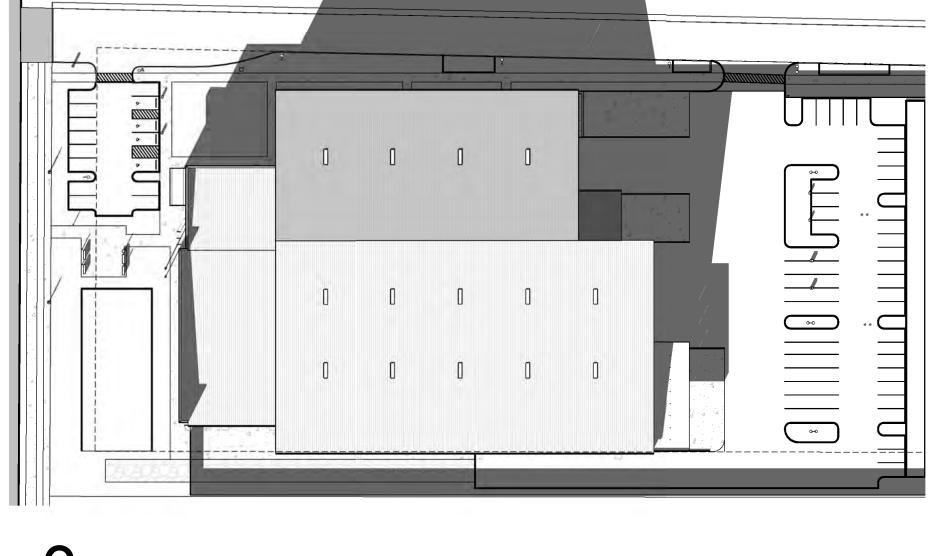


.


1/64 – 1-0

.


:

Q WINTER SOLSTICE - 2PM

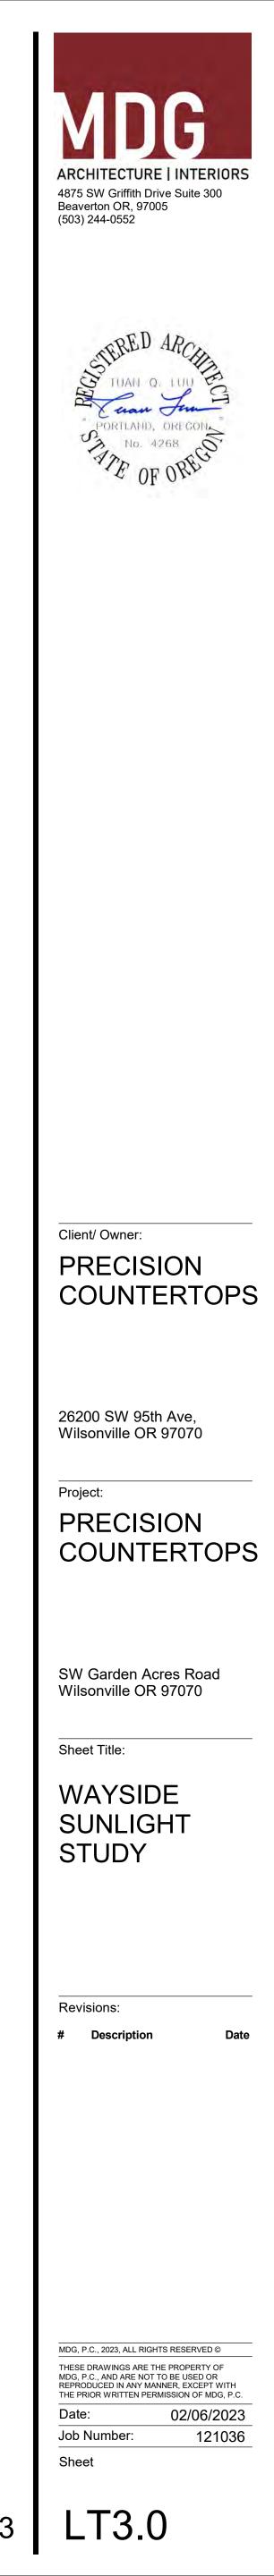



- APPROVED FIRE DEPARTMENT ACCESS ROADS, REQURIED WATER SUPPLY, FIRE HYDRANTS AND SAFETY PRECAUTIONS SHALL BE MADE AVAILABLE PRIOR TO COMBUSTIBLE MATERIALS
- ARRIVING ON SITE. FIRE LANES SHALL BE DESIGNED WITH A UNIFORM ALL-WEATHER DRIVING SURFACE TO 2
- SUPPORT THE IMPOSED GVW OF 75,000 LBS WITH A WHEEL LOAD OF 12,500 LBS AND A VERTICAL CLEARANCE OF NOT LESS THAN 13'-6". GRADING SHALL NOT EXCEED 10%. WHERE REQUIRED BY FIRE MARSHAL, FIRE APPARATUS ACCESS ROADS SHALL BE MARKED WITH 3 PERMANENT "NO PARKING - FIRE LANE" SIGNS COMPLYING WITH OFC APPENDIX D103.6. FIRE
- APPARATUS ACCESS ROADS 20-26 FT WIDE SHALL BE POSTED ON BOTHS SIDES, AND ON ONE SIDE WHERE 26-32 FT WIDE. 4. DUMPSTERS AND CONTAINERS WITH AN INDIVIDUAL CAPACITY OF 1.5 CU YD OR MORE SHALL
- NOT BE STORED IN BUILDINGS OR PLACED WITHIN 5 FT OF COMBUSTIBLE WALLS, OPENINGS, OR COMBUSTIBLE ROOF EVES UNLESS AREA IS PROTECTED BY AN APPROVED AUTOMATIC FIRE SPRINKLER SYSTEM.
- ABOVE-GROUND GAS METERS, REGULATORS AND PIPING EXPOSED TO VEHICULAR DAMAGE DUE TO PROXIMITY TO ALLEYS, DRIVEWAYS OR PARKING AREAS SHALL BE PROTECTED IN AN
- APPROVED MANNER. 6. 3 FOOT CLEAR SPACE SHALL BE MAINTAINED AROUND THE CIRCUMFERENCE OF FIRE HYDRANTS. WHEN EXPOSED TO VEHICULAR DAMAGE, CONCRETE CURBING, SIDEWALKS OR 4-INCH CONCRETE FILLED BOLLARDS PLACED 3 FT FROM HYDRANTS SHALL SUITABLY PROTECT FIRE HYDRANTS. HYDRANTS SHALL BE COATED WITH APPROVED RED PAINT COLOR AND MARKINGS.
- FIRE EXTINGUISHERS SHALL BE INSTALLED THROUGHOUT THE FACILITY PER SECTION 906 OF THE FIRE CODE AND NFPA 10. THE SIZE AND DISTRIBUTION OF FIRE EXTINGUISHERS SHALL BE IN ACCORDANCE WITH SECTIONS 906.3.1 THROUGH 906.3.4. FIRE EXTINGUISHER RATING SHALL NOT BE LESS THAN A 2A:10BC. MAX UNOBSTRUCTED TRAVEL DISTANCE TO ANY APPROVED EXTINGUISHER SHALL NOT BE MORE THAN 75 FT.
- DELEGATED DESIGN NFPA 13 FIRE SPRINKLER SYSTEM DESIGNED IN ACCORDANCE WITH OSSC 903.3.1.1 WILL BE A DEFERRED SUBMITTAL. PLANS FOR FIRE DEPARTMENT CONNECTION (FDC) INDICATING SHUTOFF VALVES (WIV OR PIV) 9. AND WATER VAULTS FOR FIRE SUPPRESSION SYSTEMS SHALL BE SUBMITTED TO THE FIRE OFFICIAL FOR APPROVAL PRIOR TO CONSTRUCTION.

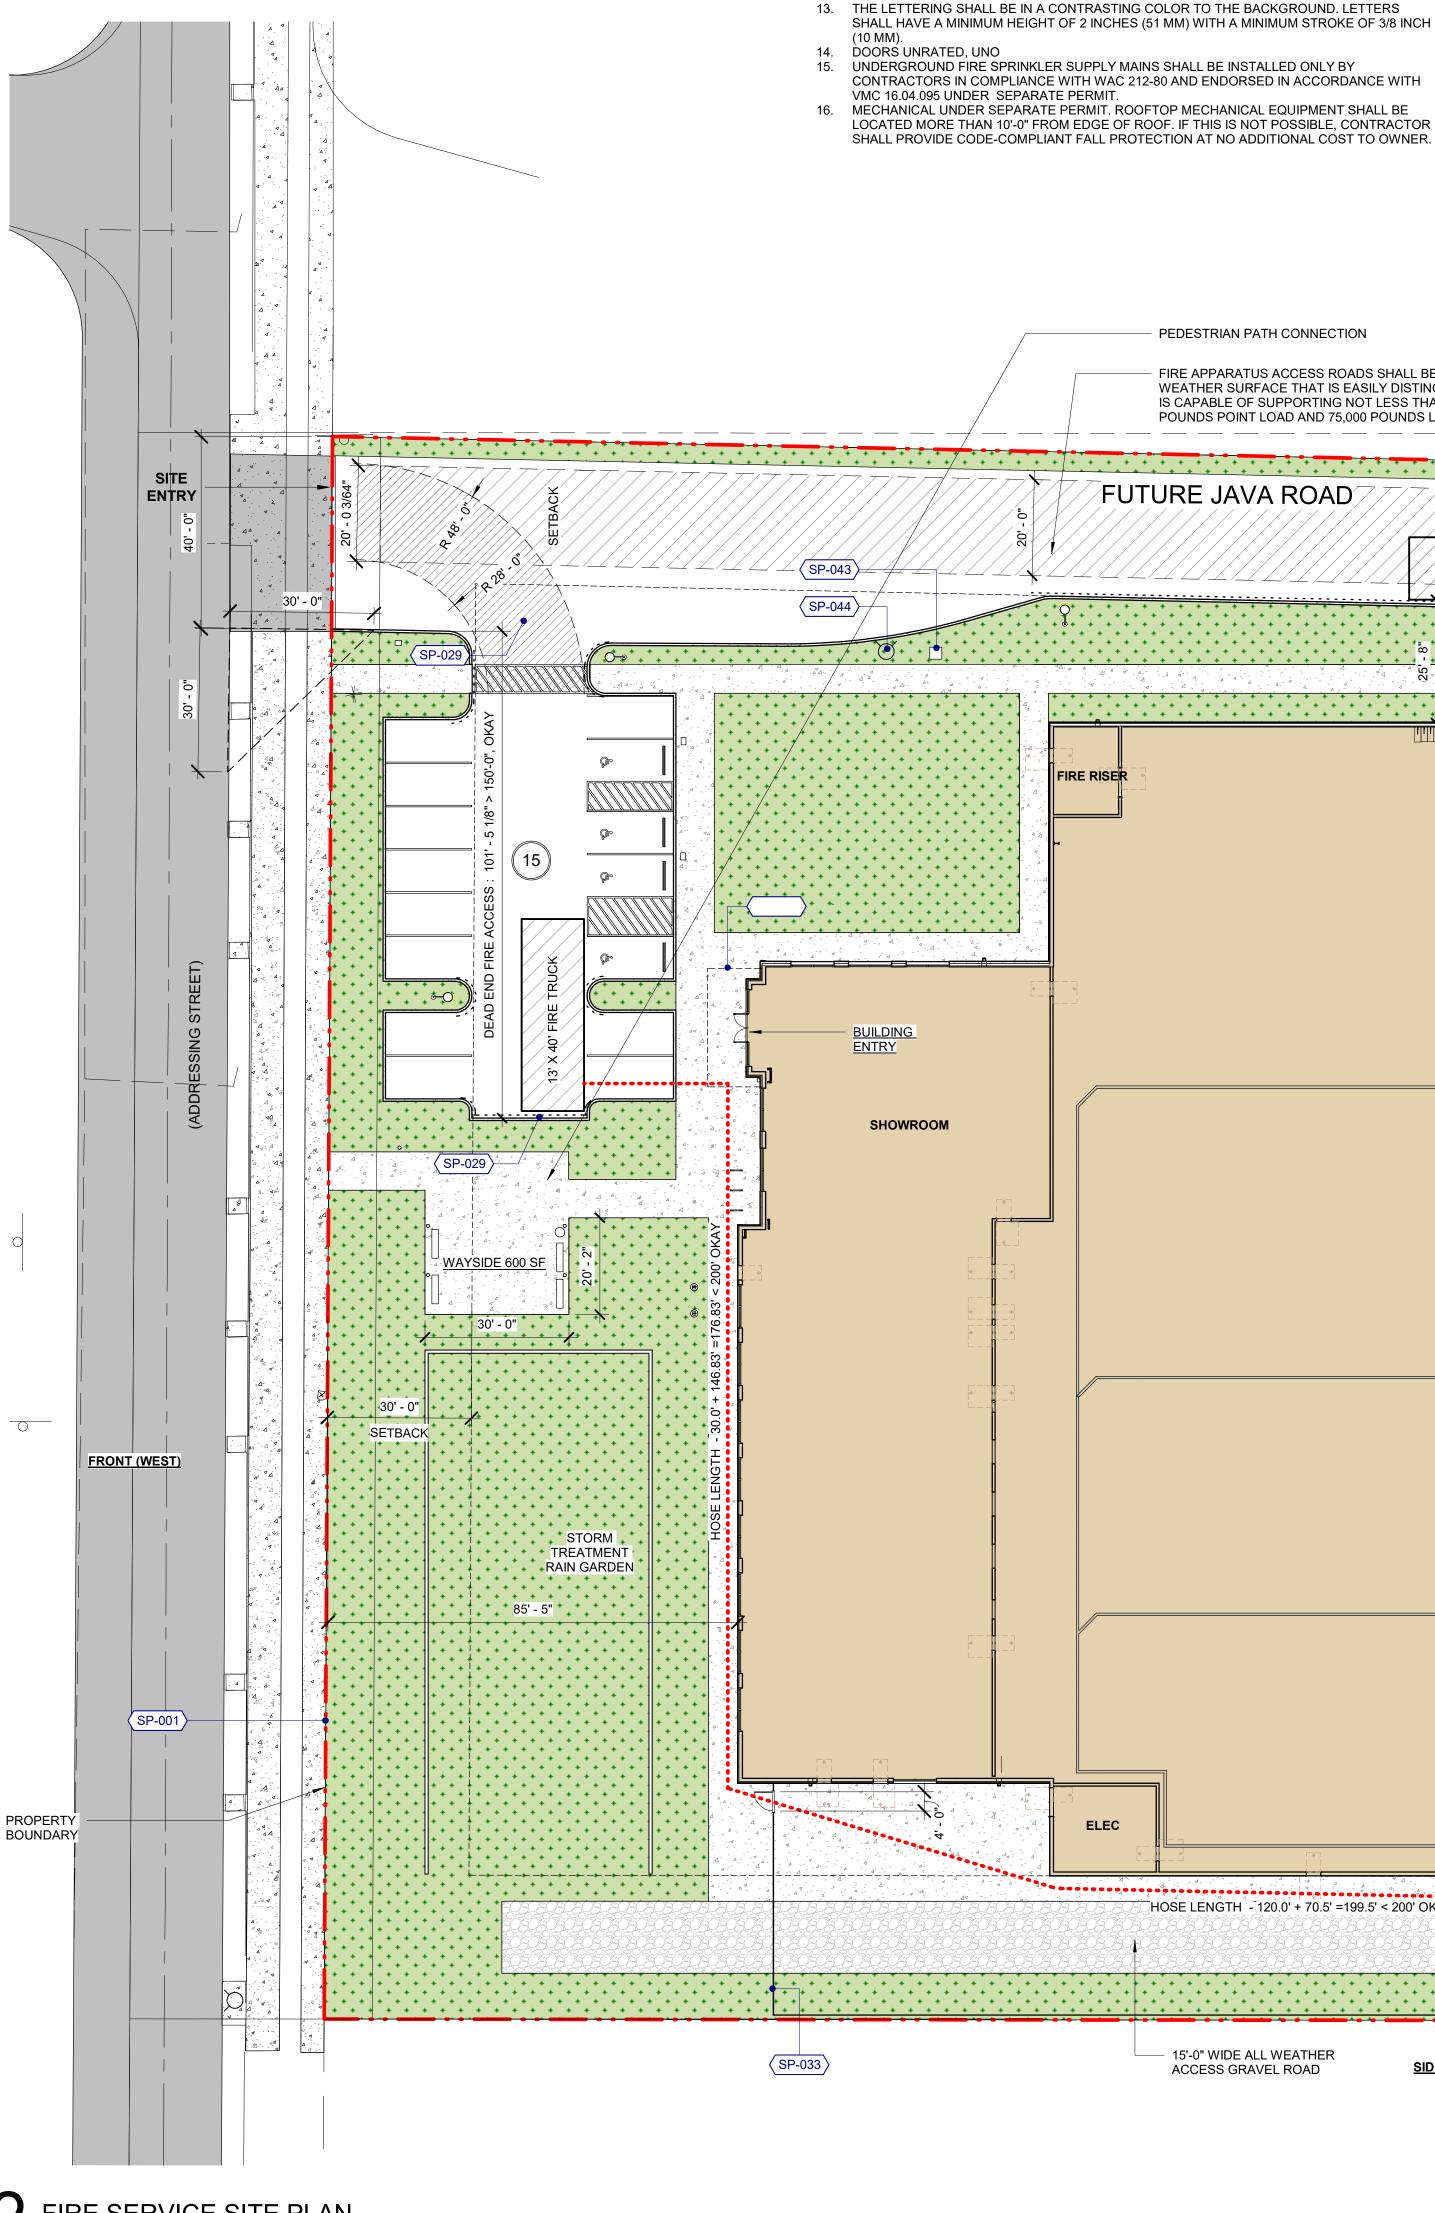

		FIRE RESPONSE PLAN LEGENI	D	KEY
L	TIRE SUPPRESSION CONNECTIONS, VALVES AND VAULTS SHALL BE INSTALLED IN REMOTE OCATIONS AWAY FROM THE BUILDINGS PROTECTED.	FIRE HYDRANT	Ŋ	SP-001 F
	FIRE FLOW DEMAND PER OFC APPENDIX B: A. PER TABLE B105.2, SECTION 903.3.1.1 DESIGN STANDARD:			SP-028 K SP-029 F
F	TABLE B105.1(2) - TYPE IIB, 65,071 SF: FIRE FLOW RATE: 2,750 GPM	FIRE APPARATUS ACCESS ROAD, 20'W UNO		5F-029 F F S
	FIRE FLOW DURATION: 2 HRS TABLE B105.2 REQUIRED FIRE FLOW - SPRINKLERED PER IFC 903.3.1.1:	FIRE LANE CURB MARKING PER OFC 503.3		SP-031 F
	FIRE FLOW REDUCTION: 2,750 GPM x 0.25 = 687.5 GPM ^a	FIRE LANE CORB MARKING PER OFC 503.3		SP-033 G
	aTHE REDUCED FIRE FLOW RATE SHALL NOT BE LESS THAN 1,000 GPM			ے SP-043 F
	MIN. REQUIRED FIRE FLOW RATE = 1,000 GPM	HOSE PULL	•••••••••••••	SP-043 F SP-044 F
1 0	MIN. REQUIRED FIRE FLOW DURATION = 2 HRS SIGNAGE NOTES:			36-044 1
i. c				
	MATERIALS, PERMANENTLY INSTALLED AND READILY VISIBLE. SIGNAGE TO BE			
h	APPROVED PRIOR TO OCCUPANCY. PER OFC 605.3.1 AND NEPA 20: DOORS INTO ELECTRICAL CONTROL PANEL ROOMS			
b	SHALL BE MARKED WITH A PLAINLY VISIBLE AND LEGIBLE SIGN STATING "ELECTRICAL ROOM". SIGNAGE TO BE APPROVED PRIOR TO OCCUPANCY.			
с				
-	COMPLYING WITH ICC A117.1 SHALL BE PROVIDED ADJACENT TO EACH DOOR IN AN			
	AREA OF REFUGE, EXTERIOR AREA FOR ASSISTED RESCUE, EXIT STAIRWAY, EXIT			

RAMP, EXIT PASSAGEWAY AND EXIT DISCHARGE. FIRE DEPARTMENT ACCESS DOORS SHALL BE LABELED ON THE EXTERIOR SIDE WITH THE FOLLOWING SIGN OR OTHER APPROVED SIGN: FIRE DEPARTMENT ACCESS DOOR DO NOT BLOCK

d.

13. THE LETTERING SHALL BE IN A CONTRASTING COLOR TO THE BACKGROUND. LETTERS SHALL HAVE A MINIMUM HEIGHT OF 2 INCHES (51 MM) WITH A MINIMUM STROKE OF 3/8 INCH

CONTRACTORS IN COMPLIANCE WITH WAC 212-80 AND ENDORSED IN ACCORDANCE WITH 16. MECHANICAL UNDER SEPARATE PERMIT. ROOFTOP MECHANICAL EQUIPMENT SHALL BE LOCATED MORE THAN 10'-0" FROM EDGE OF ROOF. IF THIS IS NOT POSSIBLE, CONTRACTOR

PEDESTRIAN PATH CONNECTION

FIRE APPARATUS ACCESS ROADS SHALL BE OF AN ALL WEATHER SURFACE THAT IS EASILY DISTINGUISHABLE AND IS CAPABLE OF SUPPORTING NOT LESS THAN 12,500

POUNDS POINT LOAD AND 75,000 POUNDS LIVE LOAD.		<u>SIDE (NORTH)</u>	<u>{SP-001</u> }
FUTURE JAVA ROAD 13' X 40' FIRE TRUCK			
			.5'x6'. COMMINGLE
WAI	REHOUSE	- <	
WAREHOUSE		40 YD DUMPSTER 40 YD DUMPSTER	
ELEC	- 24'-3 1/2" (GREATER THAN 20'-0" PER OFC 5	03.2.1)	
HOSE LENGTH - 120.0' + 70.5' =199.5' < 200' OKAY	13' X 40' FIRE TRUCK	166' - 6"	24' - 2 1/2"
15'-0" WIDE ALL WEATHER	* * * * * * * * * * * * * * * * * * *	CESS = 129' - 9" > 150'-0", OKAY	

ACCESS GRAVEL ROAD

<u>SIDE (SOUTH)</u>

NOTES

PROPERTY LINE

KNOX BOX, COORDINATE FINAL LOCATION(S) WITH FIRE MARSHAL FIRE LANE CURB PAINTED RED, MARKED "NO PARKING FIRE LANE" AT 20 FT INTERVALS AND CHANGES IN DIRECTION, WHITE LETTERING: 1"

STROKE, 6" HIGH FENCE, ORNAMENTAL BLACK BAR, 6'-0"H

GATE, ORNAMENTAL BLACK BAR, 20'W MIN CLR. ELECTRIC GATES SHALL BE EQUIPPED WITH A MEANS FOR OPERATION BY FIRE DEPT PERSONNEL

FDC - COORDINATE LOCATION WITH FIRE MARSHAL FIRE HYDRANT (N)

